


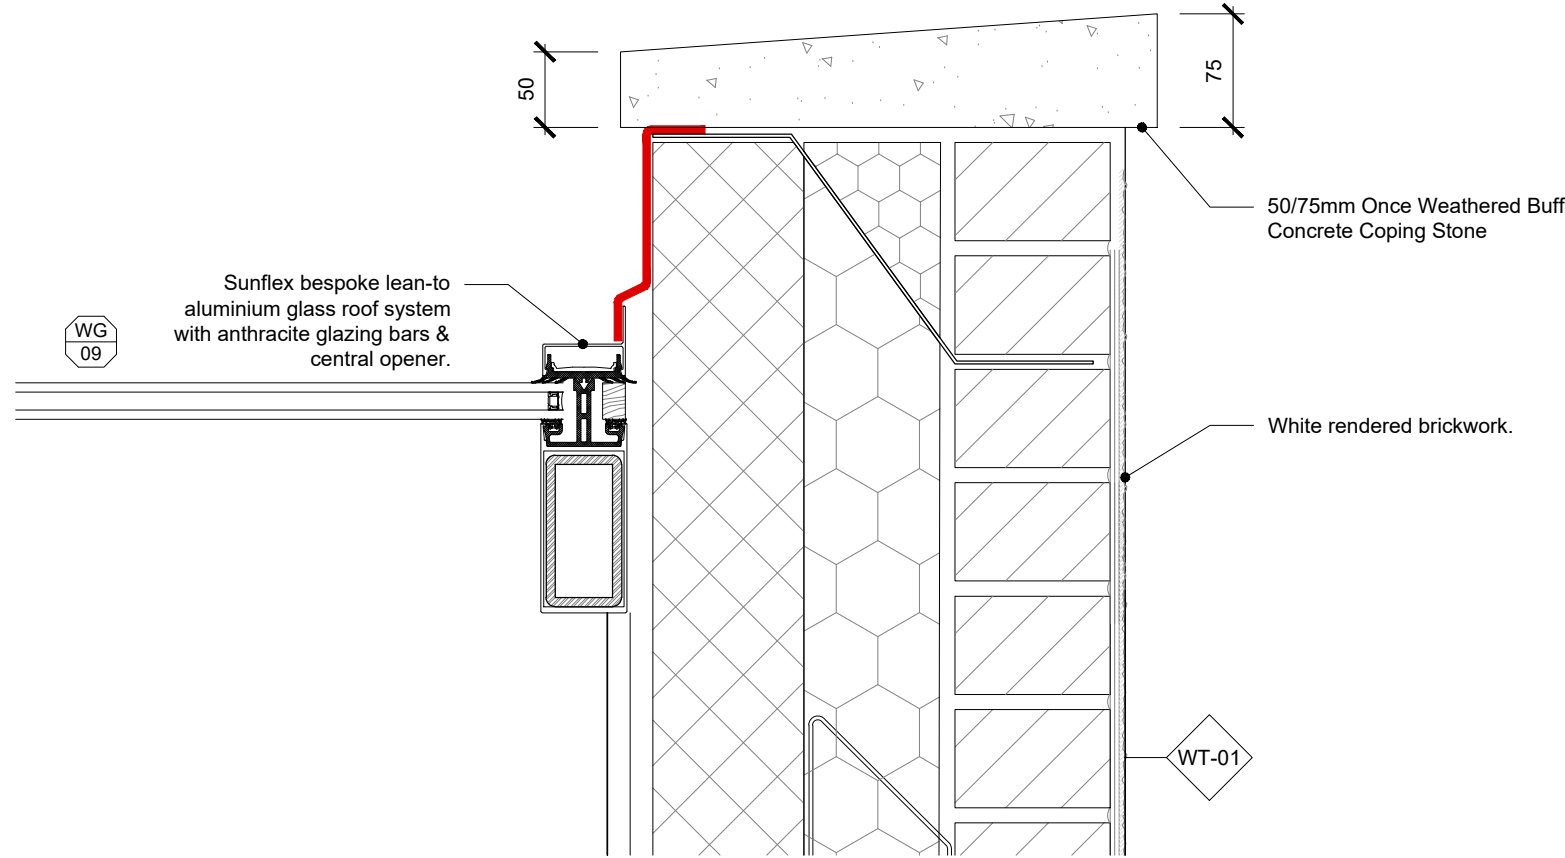
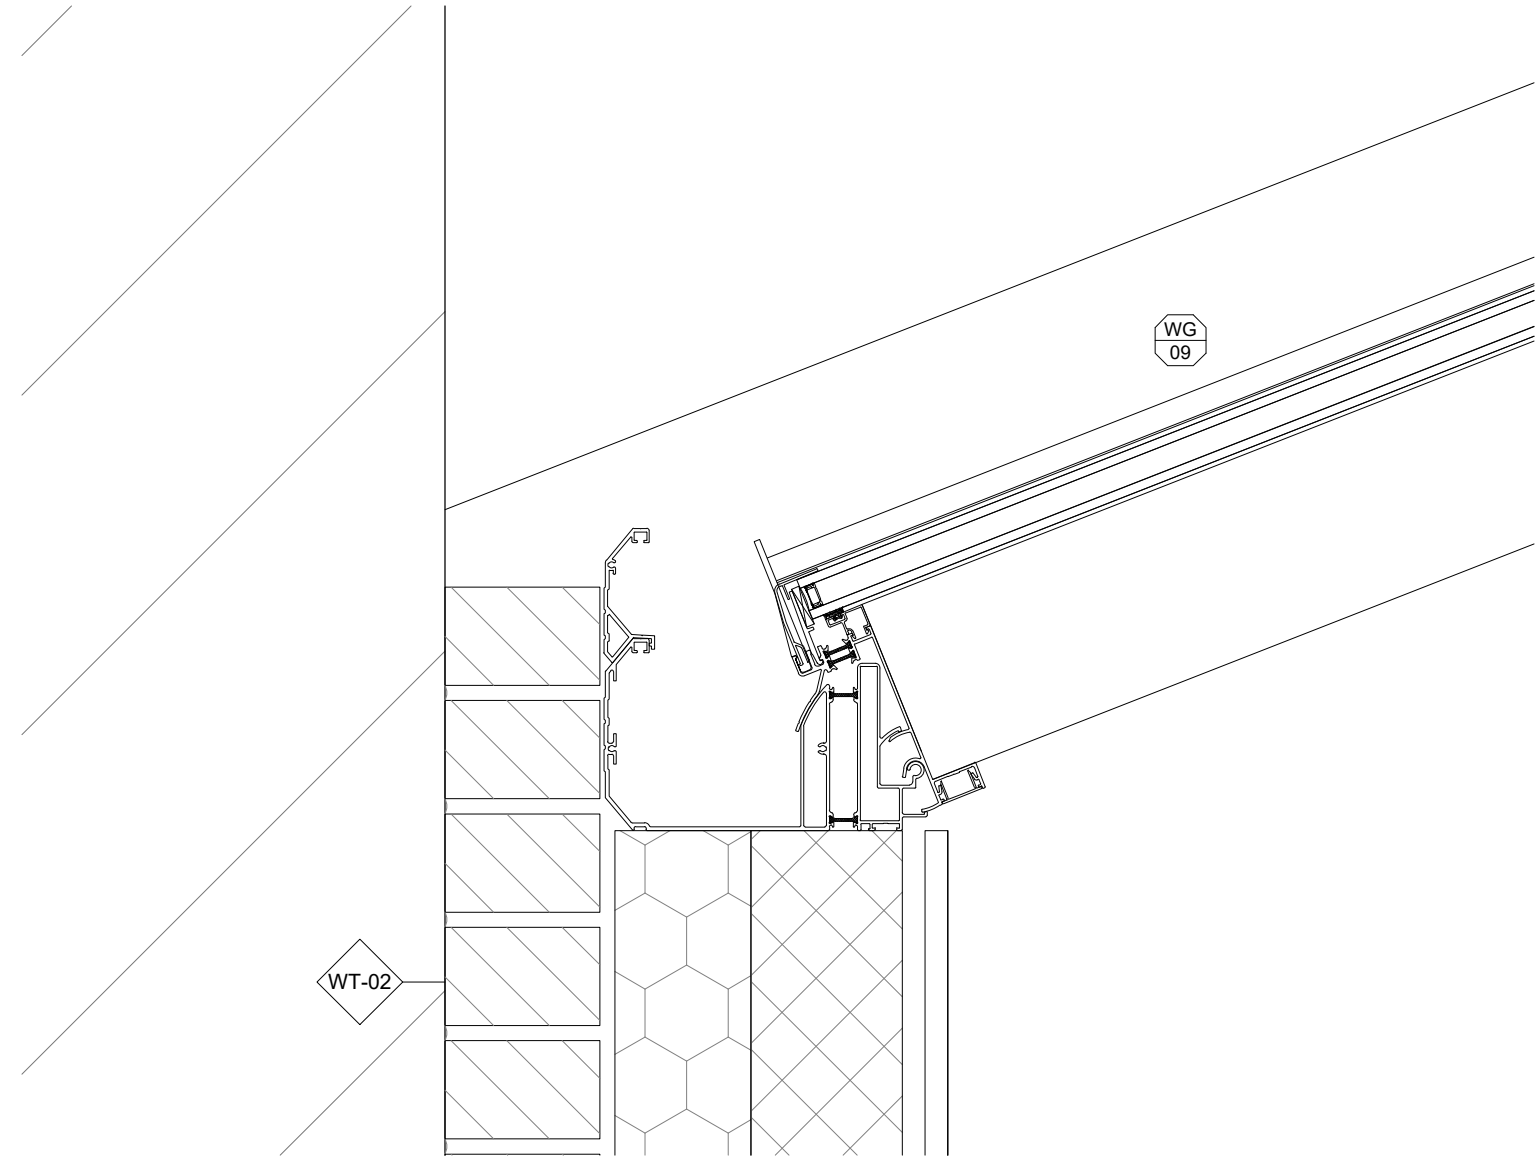






1 Proposed - Junction 1:5
Wall Type 01 Parapet to Glazed Roof

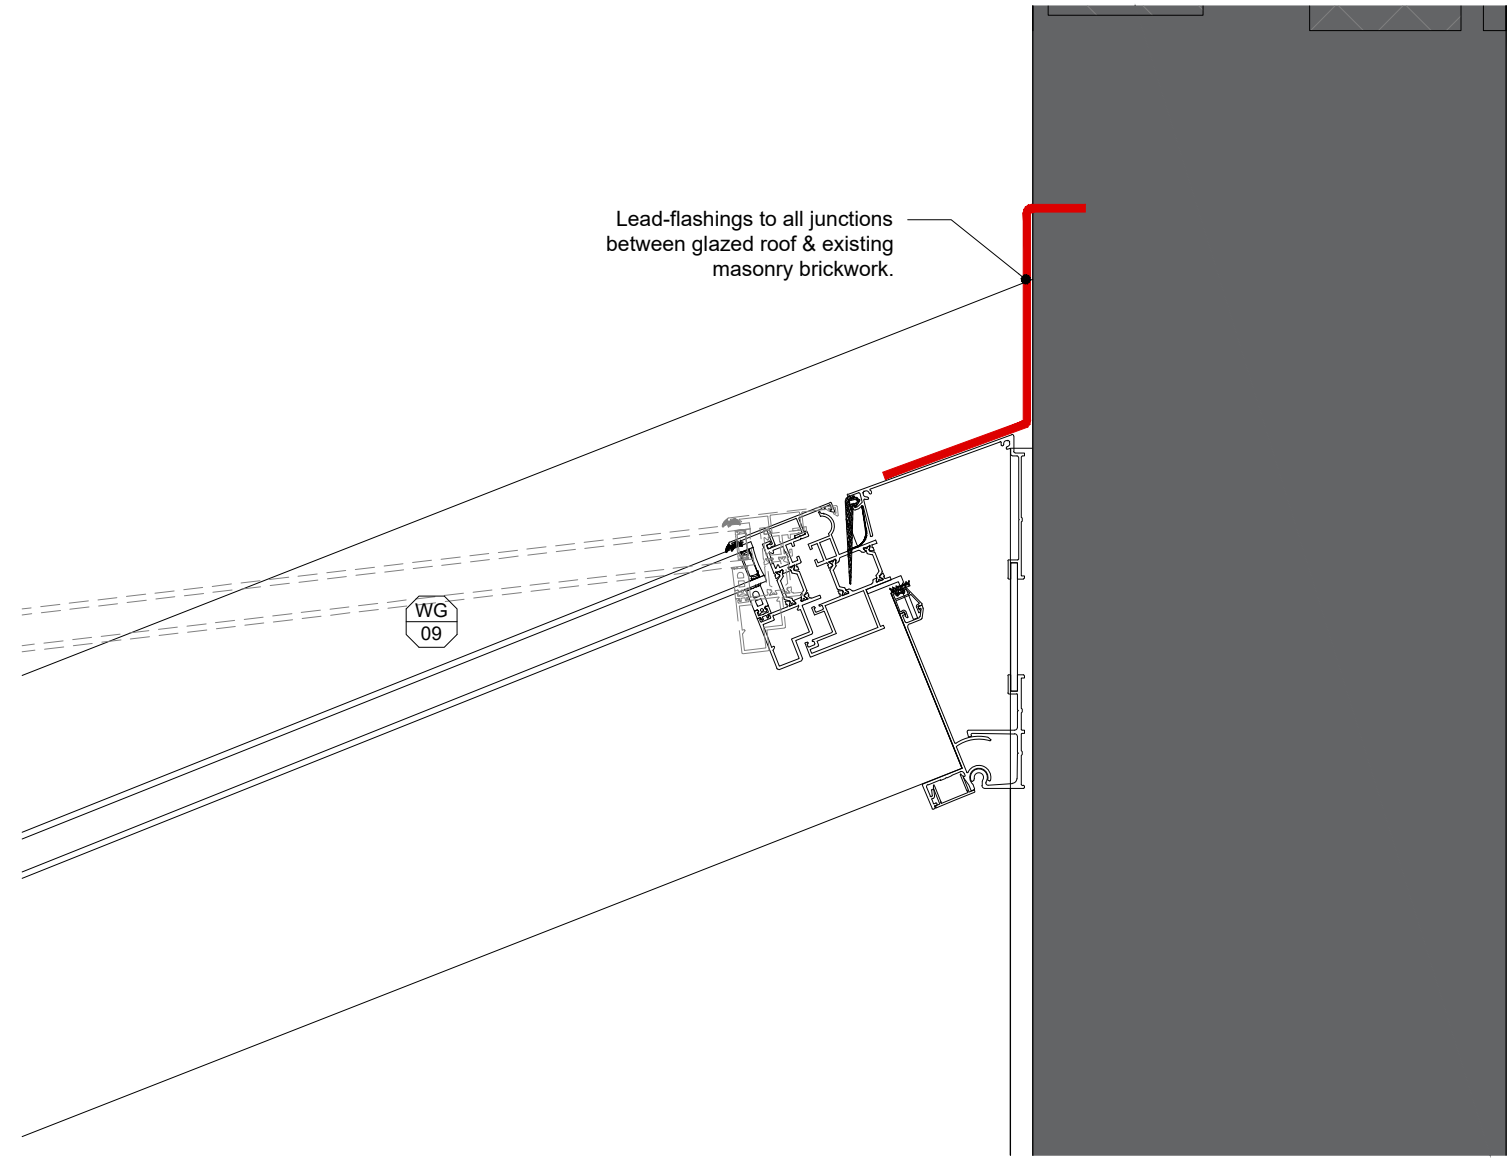


2 Proposed - Junction 1:5
Wall Type 02 Partii Wall to Glazed Roof




3 Proposed - Junction 1:5
Glazed Roof to Existing Masonry Wall

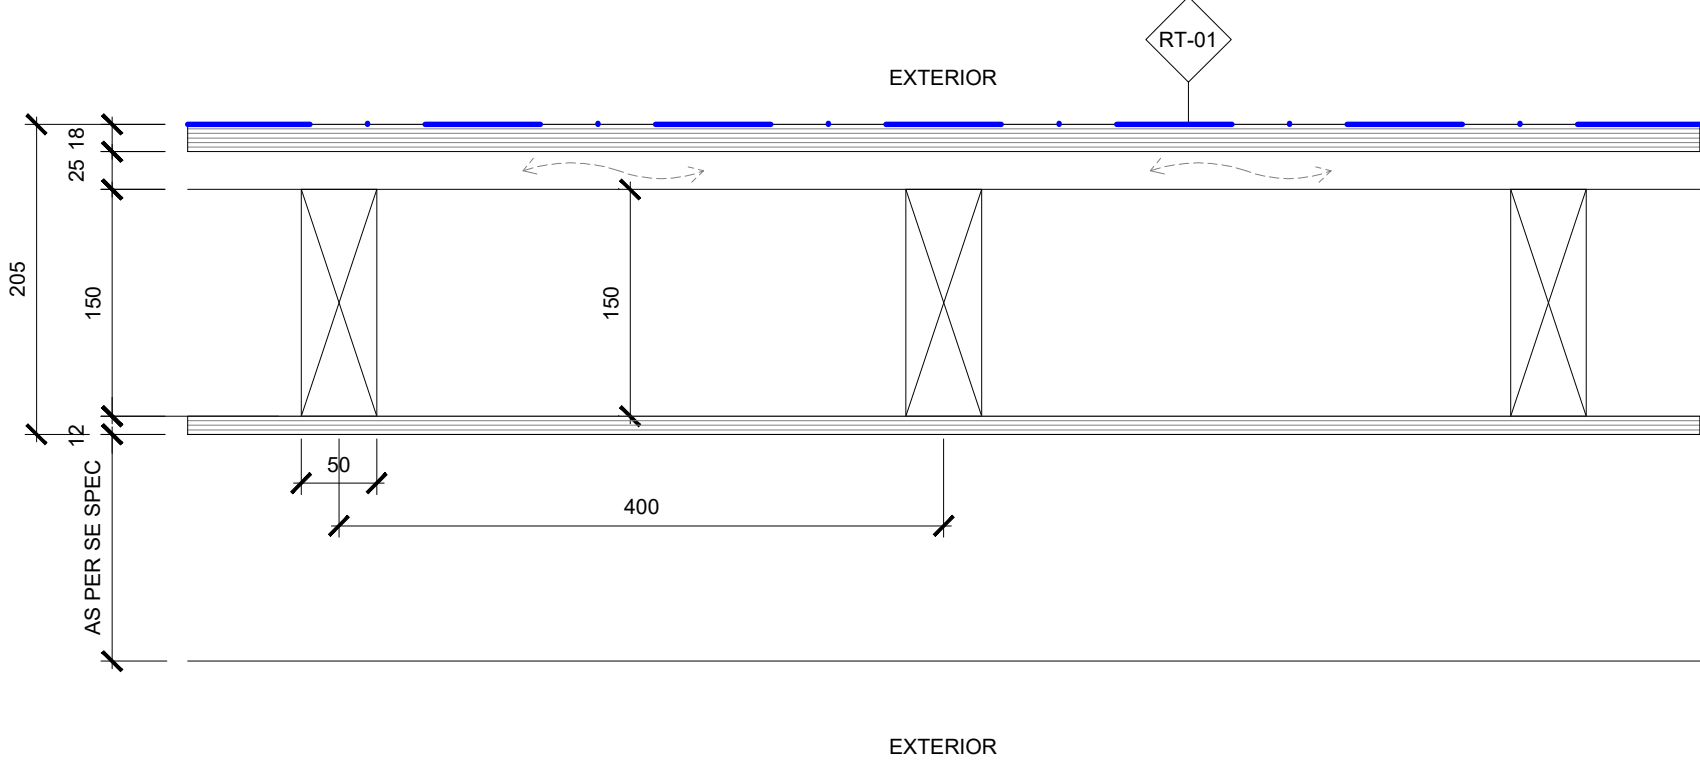

4 Proposed 1:5
Roof Type 01 - Carport



- ROOF TYPE 01 - Carport
U-Value: N/A (External)
- Single ply membrane GRP.
 - 18mm OSB Roof Deck
 - Softwood firings with varying depths to achieve 1:40 falls and minimum 25mm continuous ventilated void.
 - 50x150mm C16 Timber joists at 400mm c/c as per SE spec.
 - 12mm Exterior Plywood
 - Structural Timber beams as per SE spec.

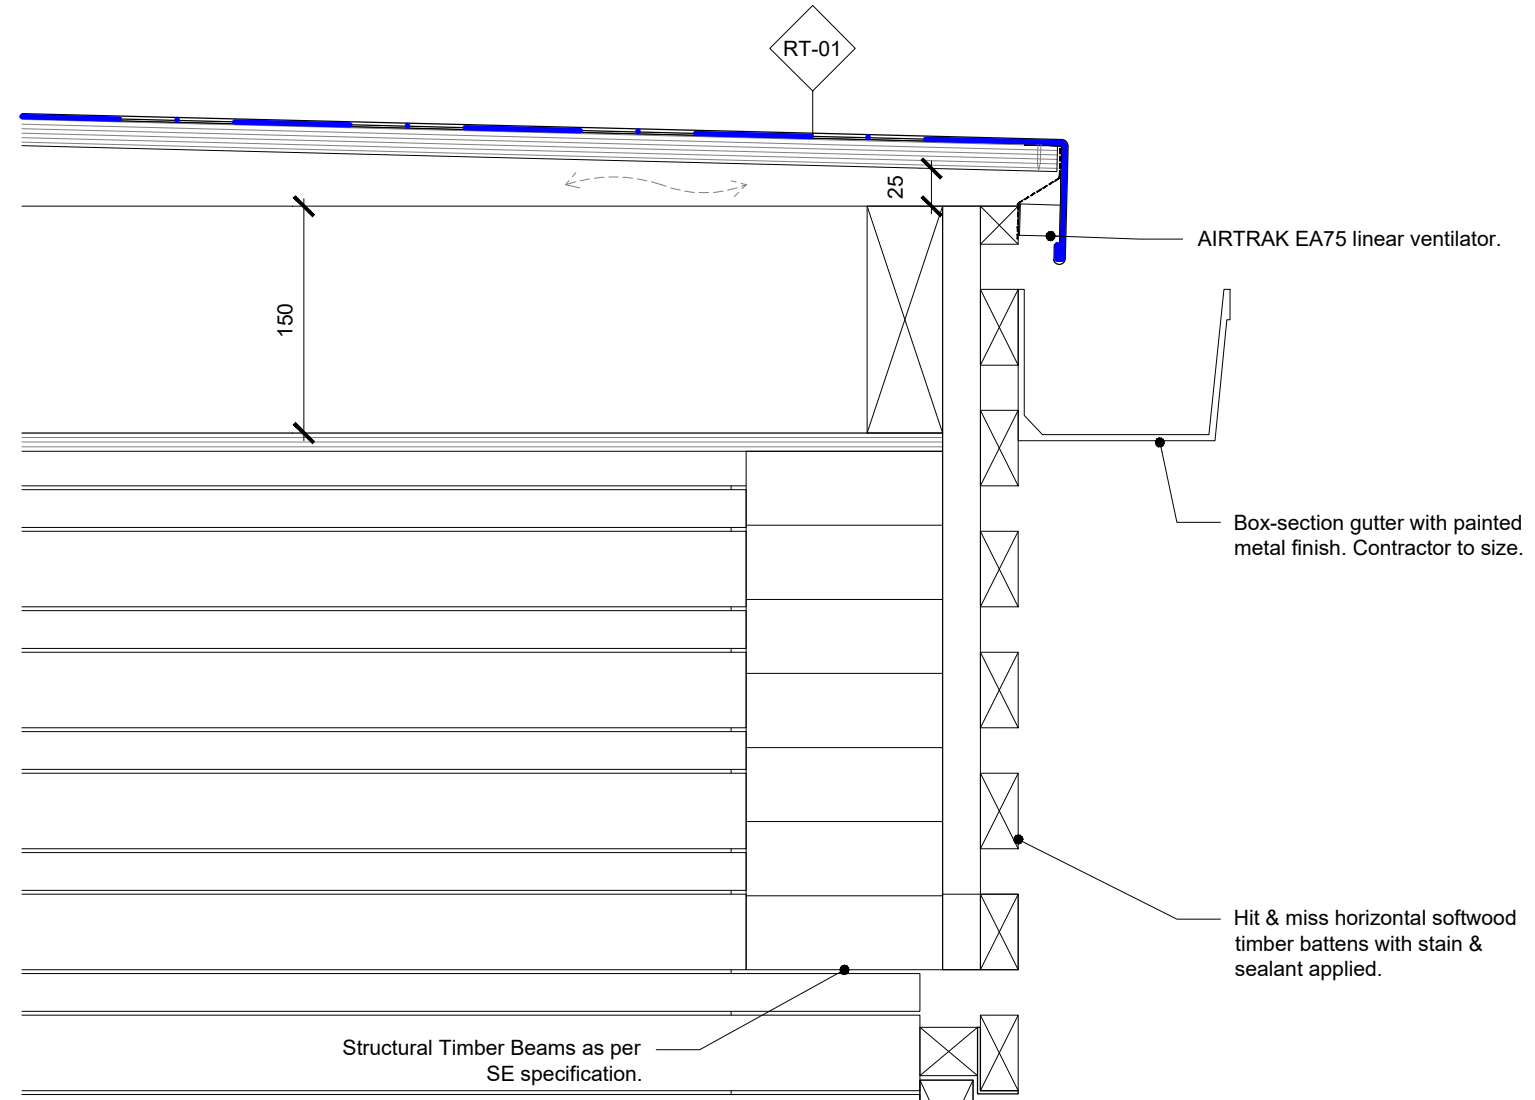

5 Proposed 1:5
Roof Type 01 - Eaves Detail - Carport

