


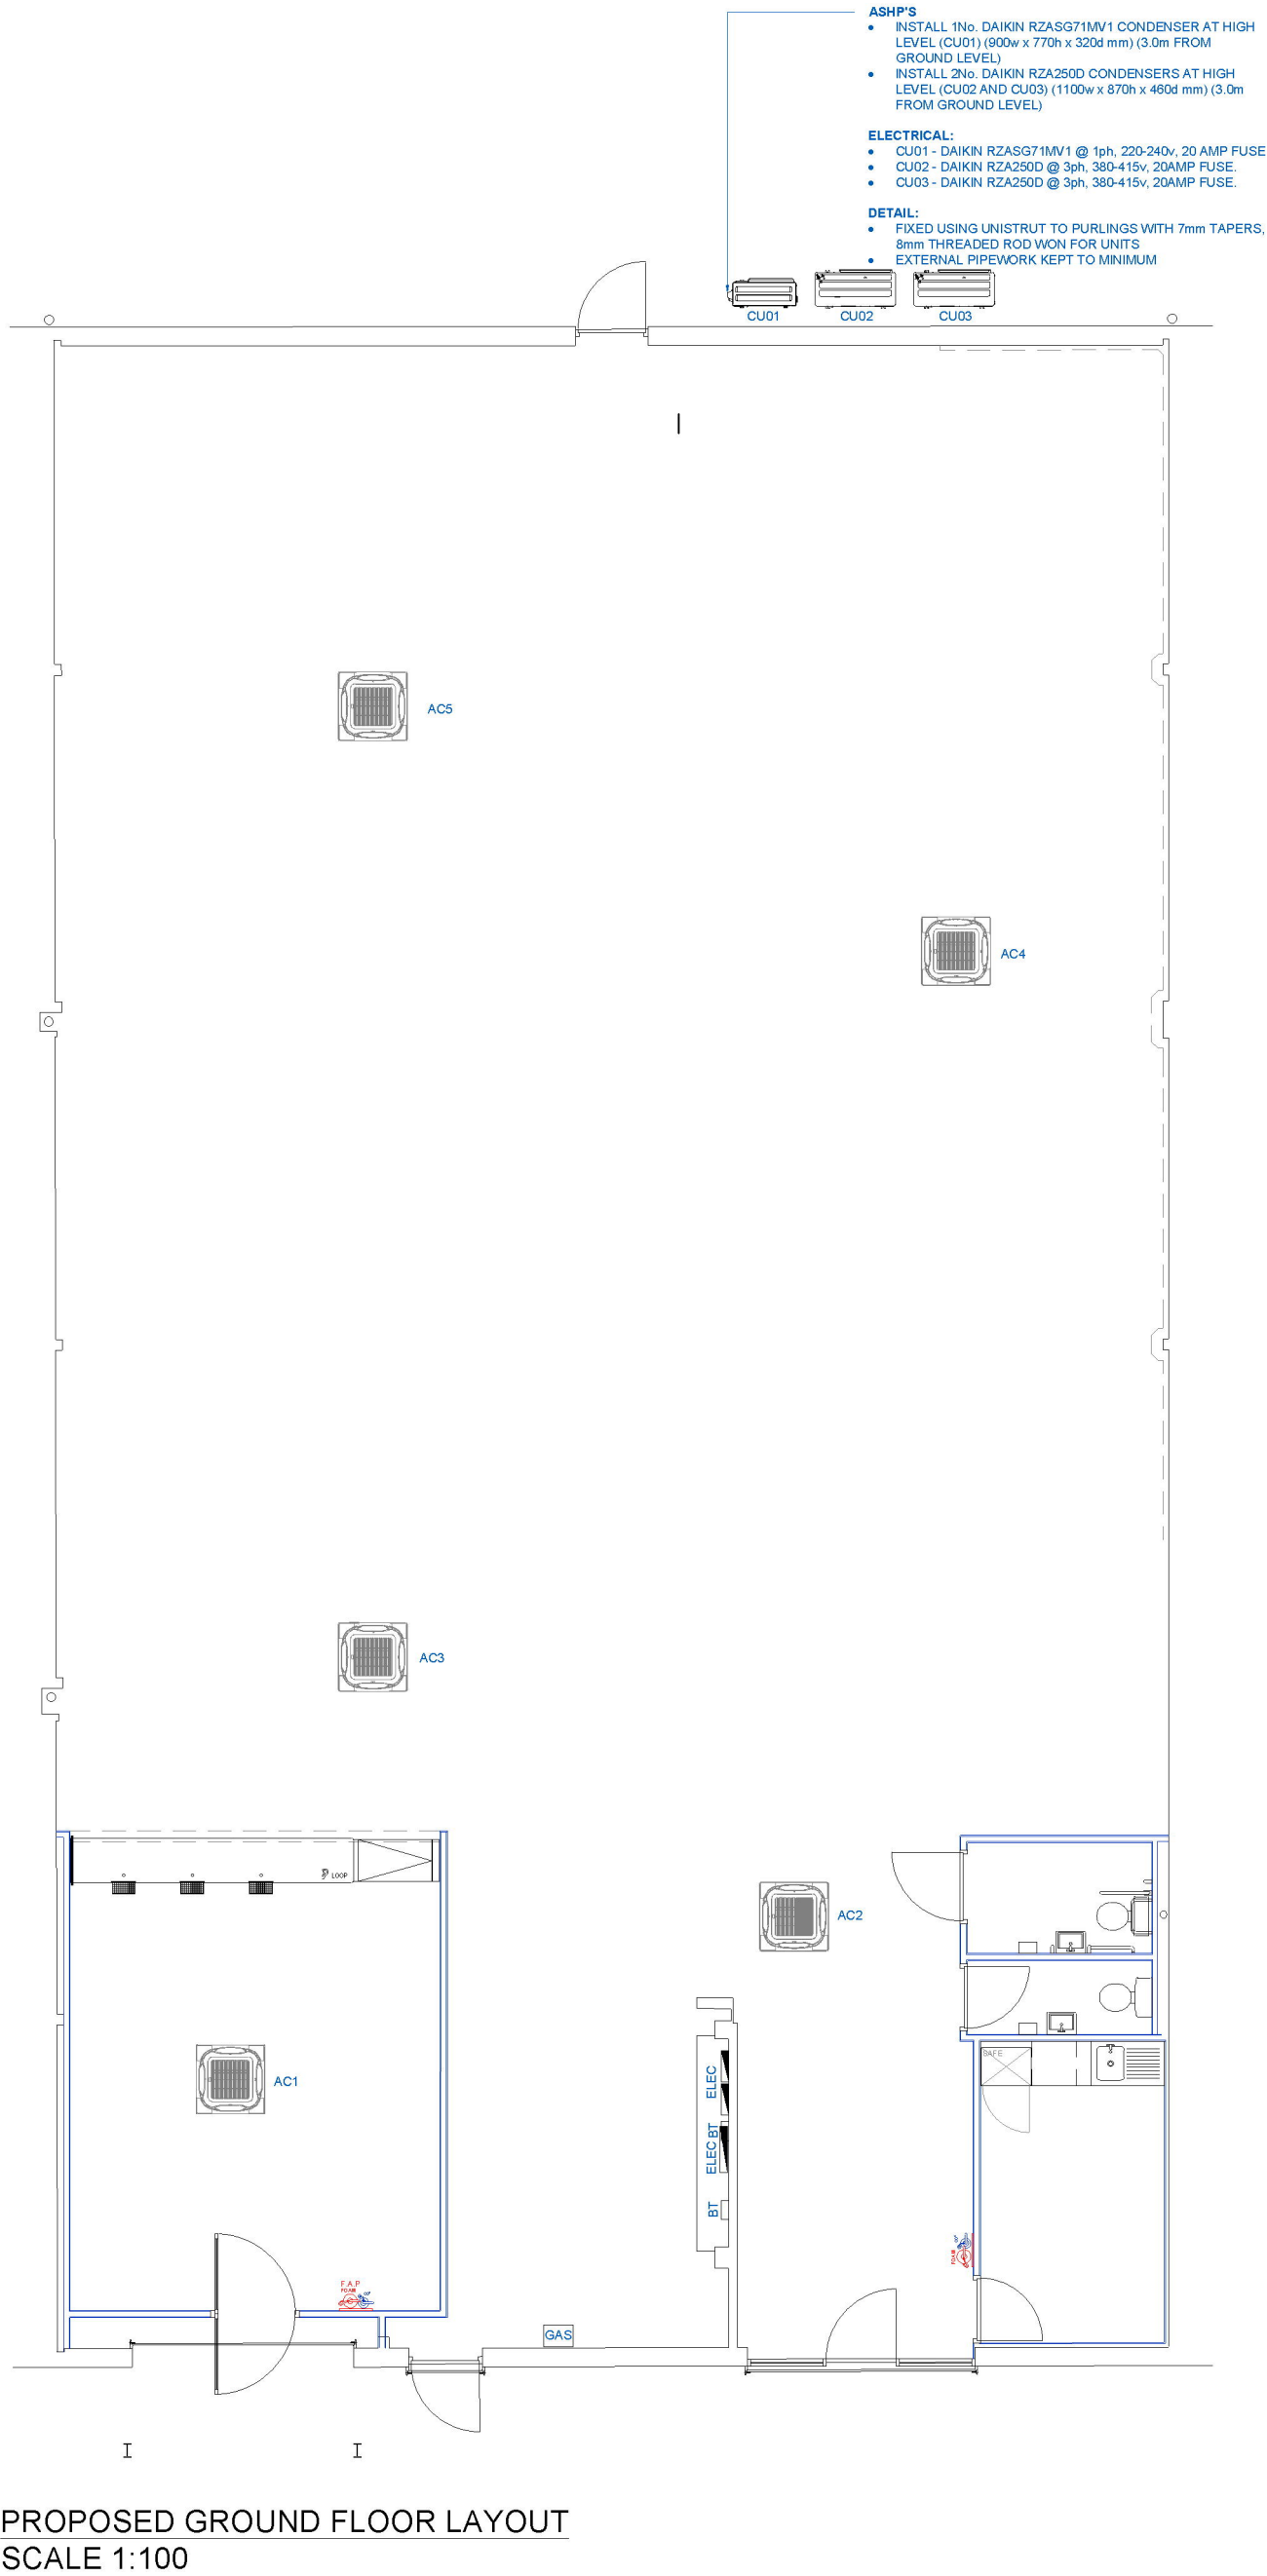

Specifications Table for RZASG-MV1

		RZASG1000/7Y1B		RZASG1250/7Y1B		RZASG1500/7Y1B	
Dimensions	Unit	Height	mm	940	940	940	940
		Width	mm	560	560	560	560
		Depth	mm	320	320	320	320
Weight	Unit	kg	60	70	70	70	70
		kg	60	70	70	70	70
Compressor	Type			Hermetically sealed swing compressor	Hermetically sealed swing compressor	Hermetically sealed swing compressor	Hermetically sealed swing compressor
Operation range	Cooling	Ambient	Min.	°CDB -15	-15	-15	-15
		Max.	°CDB	46	46	46	46
	Heating	Ambient	Min.	°CDB	15	15	15
Sound power level	Cooling	Ambient	Max.	°CDB	15.5	15.5	15.5
		Max.	°CDB	15.5	15.5	15.5	15.5
	Heating	Ambient	Max.	°CDB	15	15	15
Sound pressure level	Cooling	Ambient	Max.	dB(A)	65	70	70
		Max.	dB(A)	65	70	70	70
	Heating	Ambient	Max.	dB(A)	65	70	70
Refrigerant	Type	Ambient	Max.	dB(A)	65	70	70
		Max.	dB(A)	65	70	70	70
	Heating	Ambient	Max.	dB(A)	65	70	70
Piping connections	Liquid	OD	mm	9.52	9.52	9.52	9.52
		OD	mm	9.52	9.52	9.52	9.52
	Gas	OD	mm	15.9	15.9	15.9	15.9
Piping length	CU - IU	Max.	m	50	50	50	50
		Max.	m	50	50	50	50
	System	Equivalent	m	70	70	70	70
Additional refrigerant charge	CU - IU	Max.	kg/m	30	30	30	30
		Max.	kg/m	30	30	30	30
	System	Equivalent	m	70	70	70	70
Level difference	CU - IU	Max.	m	30	30	30	30
		Max.	m	30	30	30	30
	System	Equivalent	m	70	70	70	70
Standard Accessories	Installation manual	1	1	1	1	1	1
		1	1	1	1	1	1
	Refrigerant label for F-gas regulation	1	1	1	1	1	1
Power supply	Phase	1~	1~	1~	1~	1~	1~
		1~	1~	1~	1~	1~	1~
	Frequency	Hz	50	50	50	50	50
Voltage	V	220-240	220-240	220-240	220-240	220-240	220-240
		220-240	220-240	220-240	220-240	220-240	220-240
	Maximum fuse amps (MFA)	A	20	20	20	20	20
Notes	(1)	According to ENER Lot 21	(1)	According to ENER Lot 21	(1)	According to ENER Lot 21	(1)
		(1)	(1)	(1)	(1)	(1)	(1)
	(2)	According to ENER Lot 21	(2)	According to ENER Lot 21	(2)	According to ENER Lot 21	(2)

Spec - CU01

Specifications Table for RZA-D

		RZA2000/7Y1B		RZA2500/7Y1B	
Dimensions	Unit	Height	mm	870	870
		Width	mm	1,100	1,100
		Depth	mm	460	460
Weight	Unit	kg	117	117	117
		kg	117	117	117
Compressor	Type			Hermetically sealed scroll compressor	Hermetically sealed scroll compressor
	Operation range	Ambient	Min.	°CDB	-20
Sound power level	Cooling	Ambient	Max.	°CDB	46
		Max.	°CDB	46	46
	Heating	Ambient	Min.	°CWB	-20
Sound pressure level	Cooling	Ambient	Max.	°CWB	15
		Max.	°CWB	15	15
	Heating	Ambient	Max.	°CWB	15
Refrigerant	Type	Ambient	Max.	°CWB	15
		Max.	°CWB	15	15
	Charge	Ambient	Max.	°CWB	15
Piping connections	Liquid	OD	mm	9.52	9.52
		OD	mm	9.52	9.52
	Gas	OD	mm	15.9	15.9
Piping length	CU - IU	Max.	m	100	100
		Max.	m	100	100
	System	Equivalent	m	30	30
Standard Accessories	Installation manual	1	1	1	1
		1	1	1	1
	General safety precautions	1	1	1	1
Power supply	Phase	1~	1~	1~	1~
		1~	1~	1~	1~
	Frequency	Hz	50	50	50
Voltage	V	220-240	220-240	220-240	220-240
		220-240	220-240	220-240	220-240
	Maximum fuse amps (MFA)	A	20	20	20
Notes	(1)	According to ENER Lot 21	(1)	According to ENER Lot 21	(1)
		(1)	(1)	(1)	(1)
	(2)	According to ENER Lot 21	(2)	According to ENER Lot 21	(2)

Spec - CU01 & CU03



Example image

R1 NOTED ADDED FOLLOWING PLANNING COMMENTS 20.05.2026 PG

REVISIONS DATE INIT

ISSUED FOR
PLANNING

DRAWING PROJECT
UNIT 2, 23-25 BRIDGE ROAD,
HAYWARDS HEATH, RH16 1UA

DRAWING TITLE
**PROPOSED
FLOOR PLAN**

CLIENT
SCREWFIX DIRECT LIMITED

DRAWN BY
TM

CHECKED BY
MH/CD

SCALE
1:100 @ A1

DATE
29.01.2026

DRAWING NUMBER
8767-SF_HAYWARDS_HEATH-FLD-00-XX-DR-I-0021-GA-P3-R1

SCALE BAR @1:100
0 1m 5m 10m

Resolution
INTERIORS

REGISTERED IN ENGLAND & WALES NO. 3678965, VAT REGISTRATION NO. 723652246
GEORGE SMITH WAY, LUTON 2000 BUSINESS PARK, TROVIL, SOMERSET, BA2 2QR
01582 42270 - 01582 42271 - 01582 42272 - 01582 42273 - 01582 42274 - 01582 42275 - 01582 42276 - 01582 42277 - 01582 42278 - 01582 42279 - 01582 42280
COPYRIGHT OF THIS DRAWING IS RESERVED BY RESOLUTION INTERIORS LIMITED. THE DRAWING IS ISSUED ON THE CONDITION THAT IT IS NOT COPIED, REPRODUCED OR DISCLOSED TO A THIRD PARTY WITHOUT CONSENT

Please note the internal trade counter layout is subject to a separate planning application LPA ref: DM/26/0592 and the external alterations are also subject to a separate planning application LPA ref: DM/26/0593