


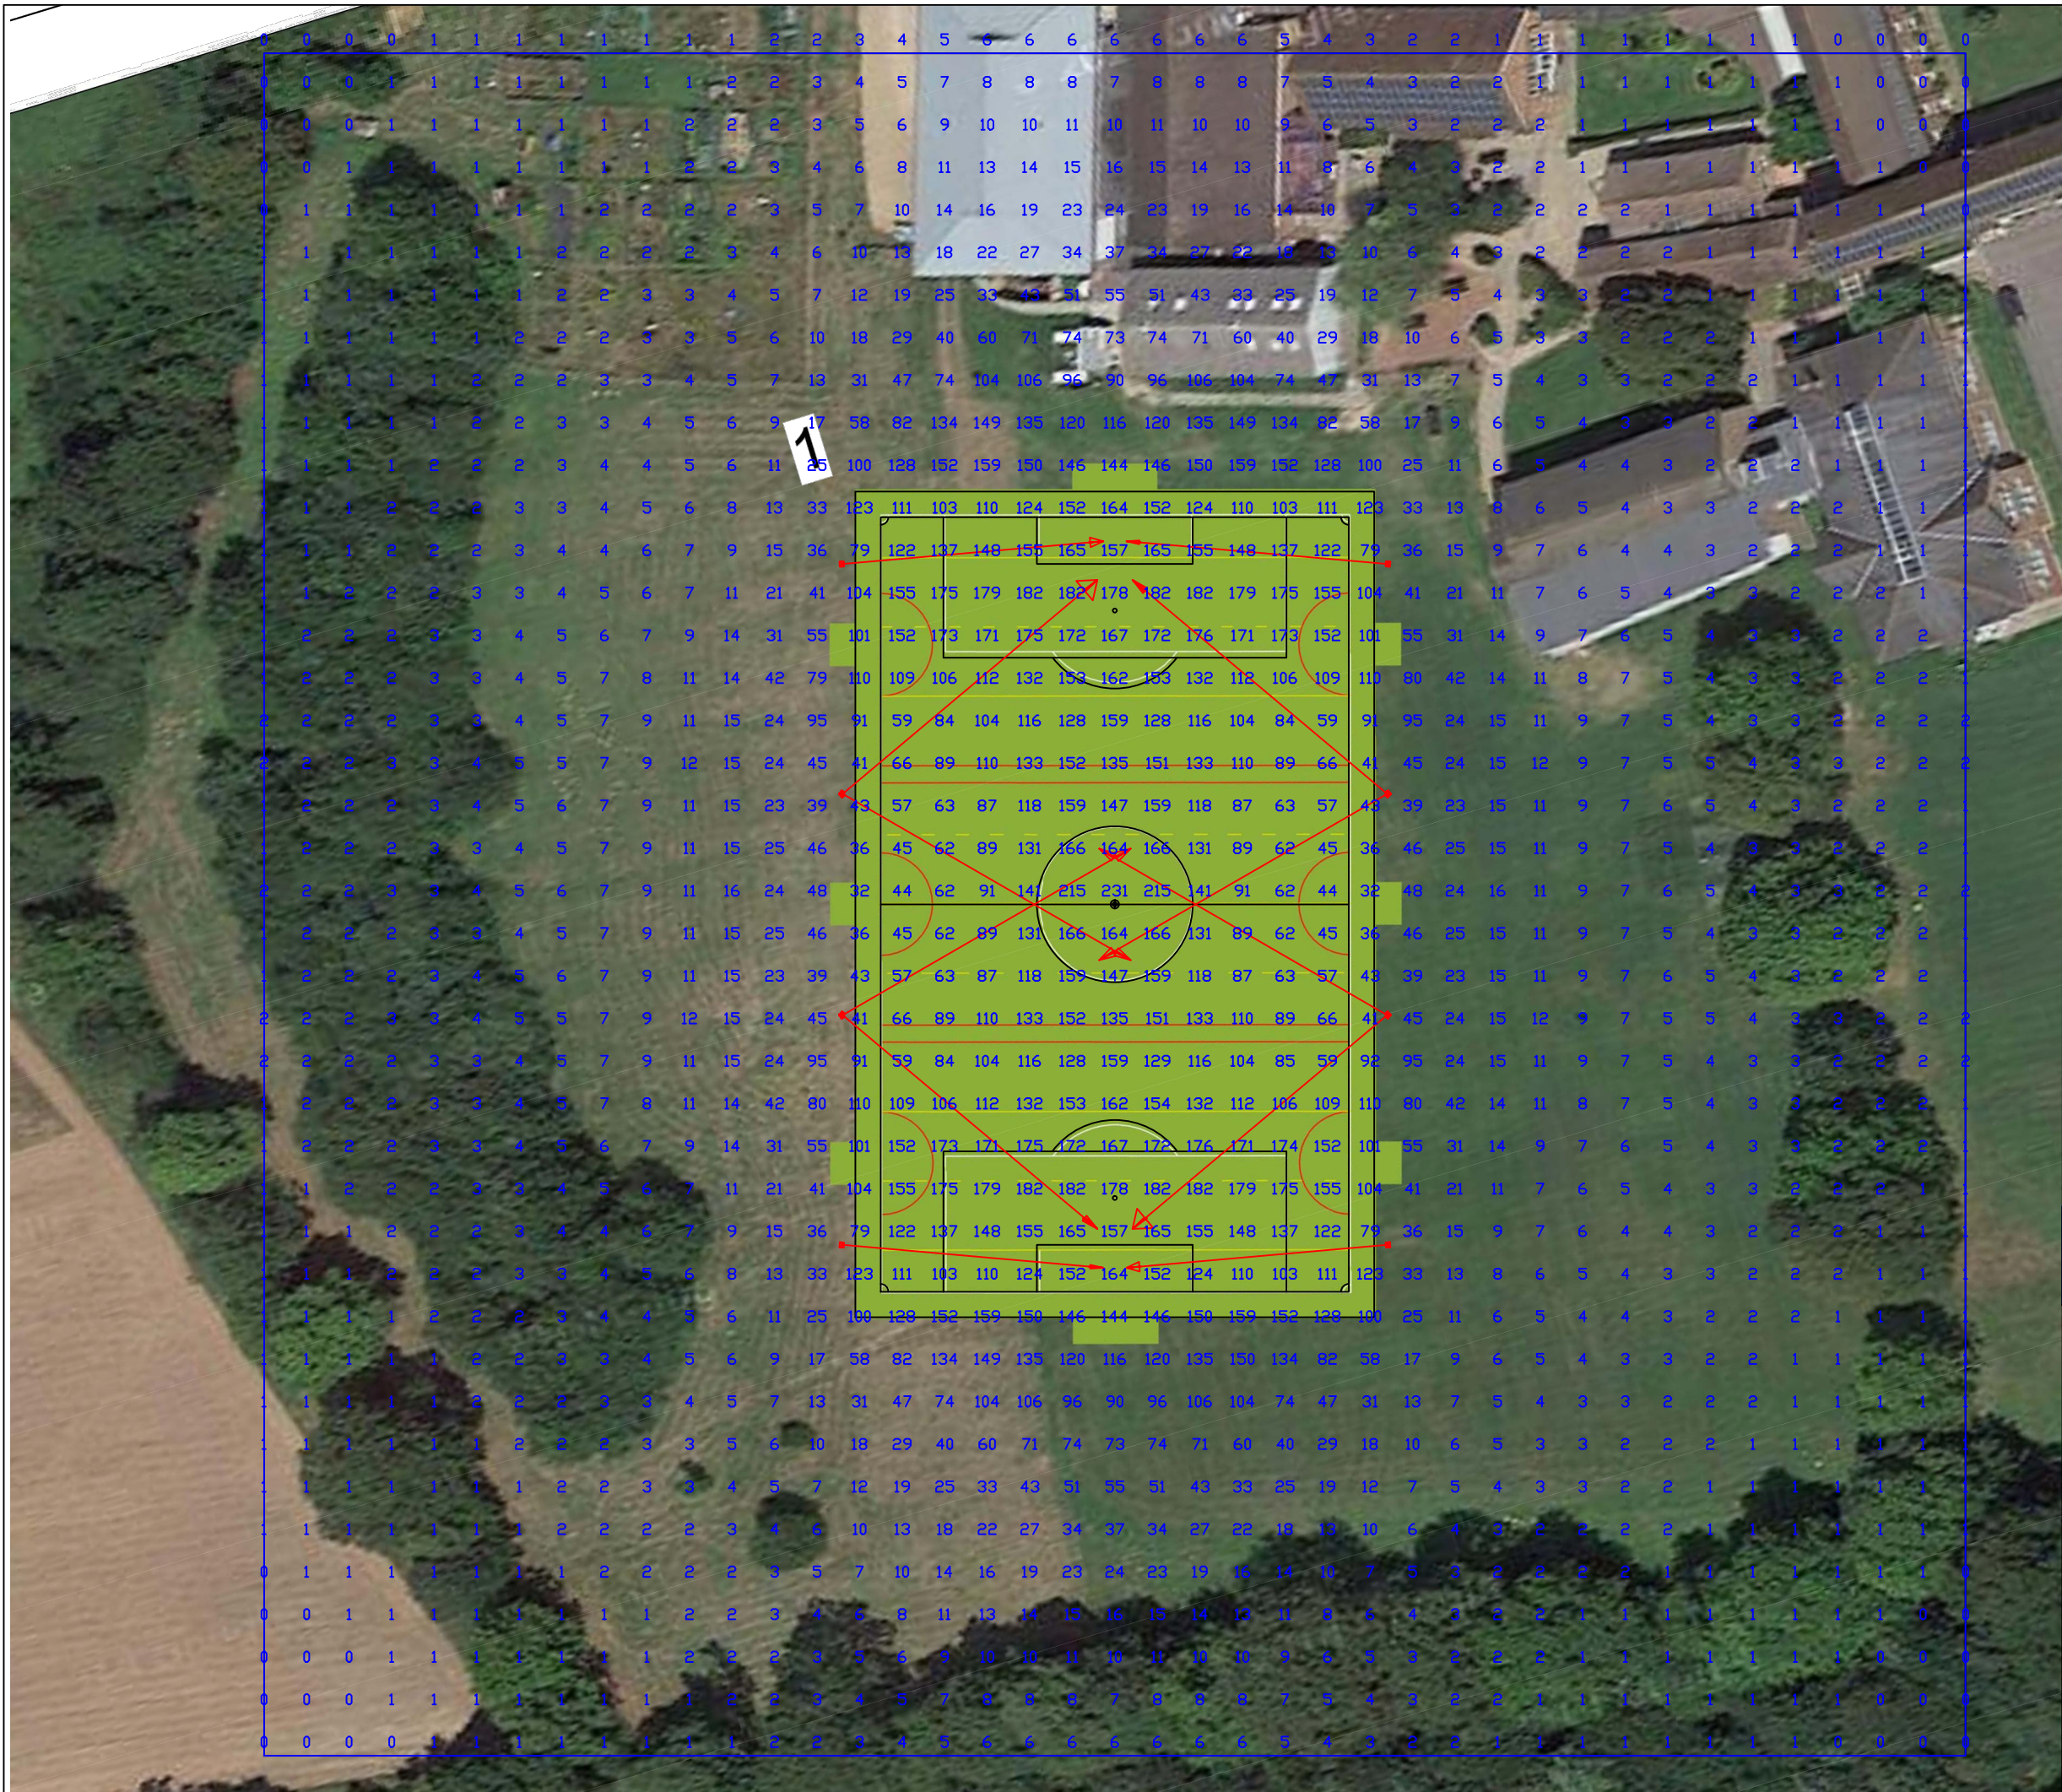

Notes

Floodlighting Equipment  
8 x 15m Masts (M1-M8)

Each carrying the following  
Floodlights :-  
M1,M4,M5,M8..1 x WB03/2KW/A3MAXI  
M2,M3,M6,M7..2 x WB03/2KW/A3MAXI

Lamps (OSRAM)  
2000W/HQI-TS/W/N/L  
(230 000 INITIAL Lm)

Illuminance Levels  
Initial -  
(100hrs) E.i.ave = 287Lux  
Maintained -  
(4000hrs) E.i.ave = 230Lux  
Uniformity  
Emin/Eave = 0.63

Grid values in Lux(initial).  
Grid interval = 5m.  
Contour values in Lux (initial).  
Contours: 5, 20, 50 Lux.  
Maintenance Factor = 0.80

**VERTICAL OVERSPILL LEVELS TAKEN  
AT 3.5m ABOVE GROUND**

HALLIDAY LIGHTING

Project

Warden Park Academy

www.hallidaylighting.co.uk

Drawing Title

Vertical overspill

Drawn By (print)

JS

Date

05/04/2016

Project No

0996

Scale

1:750 @A3

Drawing No

HLS0966.1

Status

Proposal