

Heat Pump Noise Level Calculation Form

Wykehurst Place

J4 Mechanical Engineering Services Ltd

james@j4-mes.co.uk

Site Address:

Wykehurst Place, Bolney

Date of Calculation: 13th June 2026

This is to establish that the proposed location of the heat pump has a noise level lower than 42 dB (A) and would not require planning permission from the local authorities.

For the purpose of the calculation procedure, the following notes have been issued:

- Assessment position means a position one metre external to the centre point of any door or window to a habitable room of a neighbouring property as measured perpendicular to the plane of the door or window;
- Habitable room means a room other than a bathroom, shower room, water closet or kitchen;
- Neighbouring property means any building used for any of the purposes of Class C Town and Country Planning (Use Classes) Order 1987 (as amended) (includes dwelling houses, hotels, residential institutions and houses in multiple occupations). In instances where the heat pump would be installed on a block of flats, the neighbouring property includes flats within the same block of flats (excluding the flat of the "owner(s)" of the heat pump).

Description of Assessment Position Tested

This description must be detailed enough to allow for identification, including property address, exact location of window/door opening and floor level. It is recommended that a map, sketch, photograph or other record be attached.

For example: The assessment position is the first-floor bedroom window of 1 Oak Street and it is 4 meters away from the location of the proposed heat pump.

This assessment has been based on the external location of the 4 No. ASHP at Wykehurst Place, Bolney. The units are located at a remote location to the main building indicated as the **red square on the map location at the end of this document.**

Distance to Wykehurst place nearest habitable room indicated in **green on the map is 49 metres.**

Distance to property (north) indicated in **blue on the map is 106 metres**

Distance to property (west) indicated in **yellow on the map is also 106 metres**

Step	Instructions	MCS Contractor's Results/Notes
1.	From the manufacturer's data, obtain the A-weighted sound power level of the heat pump. <u>See "Note 1: Sound Power Level" below.</u> The highest sound power level specified should be used (the power in "low noise mode" <u>should not</u> be used). <i>Example: Manufacturers data states the sound power level of the heat pump is 55 dB(A)</i>	Step 1 Result
		62 dB
2.	Use "<u>Note 2: Sound Pressure level</u>" and "<u>Note 3: Determination of directivity</u>" below to establish the directivity "Q" of the heat pump noise. <i>Example: The heat pump is to be installed on the ground against a single wall; hence, the directivity (Q) of the heat pump is Q4.</i>	Step 2 Result
		Q4
3.	Measure the distance from the heat pump to the assessment position in metres. <i>For the purpose of this calculation we are using the nearest window of Wykehurst Place highlighted by the green direction line. Q4 in the step above gives direction of the noise more likely to affect this property.</i> <i>Example: Distance between heat pump and assessment position is 4 metres</i>	Step 3 Result
		49 m
4.	Use the table in "<u>Note 4: dB distance reduction</u>" below to obtain a dB reduction. <i>Note maximum reduction in the table is for 30 metres.</i> <i>Example: 4 metres @ Q4 = -17 dB.</i>	Step 4 Result
		-34 dB
5.	Establish whether there is a solid barrier between the heat pump and the assessment position using "<u>Note 5: Barriers between the heat pump and the assessment position</u>" and note any dB reduction. NB – the ASHP would be shielded from this house by trees which would produce a reduction in noise but is not a solid partition so zero has been entered. <i>Example: There is a brick wall between the heat pump and the assessment position. Moving less than 25cm enables the assessment position to be seen. dB reduction = -5 dB.</i>	Step 5 Result
		-10dB

Step	Instructions	MCS Contractor's Results/Notes
6.	Calculate the sound pressure level (see Note 2: Sound pressure level") from the heat pump at the assessment position using the following calculation: (STEP 1) + (STEP 4) + (STEP 5) <i>Example: (55) + (-17) + (-5) = 33 dB (A) Lp</i>	Step 6 Result
		18 dB

7.	Background noise level. For the purposes of the MCS Planning Standard for heat pumps the background noise level is assumed to be 40 dB (A)Lp. For information see "Note 6: MCS Planning Standard for heat pumps background noise level" <i>Example: Background noise level is 40 dB(A)</i>	Step 7 Result
		40 dB
8.	Determine the difference between the STEP 7 background noise level and the heat pump noise level using the following calculation: (STEP 7) – (STEP 6) <i>Example: 40 dB (A) (background) – 33 dB(A) (Heat Pump)= 7dB (A)</i>	Step 8 Result
		22 dB
9.	Using the table in "Note 7: Decibel correction" obtain an adjustment figure and then add this to whichever is higher dB figure from STEP 6 and STEP 7. <u>Round this number up to the nearest whole number.</u> <i>Example: The adjustment figure is 0.8 dB and the higher figure is 40 dB (A)</i> $40 + 0.8 = 40.8 \text{ dB (A)}$ <i>Rounded up to 41 dB(A)</i> <i>Final result at this assessment position is 41 dB(A)</i>	Step 9 Result
		40 dB
10.	Is the FINAL RESULT in STEP 9 lower than the permitted development noise limit of 42 dB (A)? If YES – the heat pump will comply with the permitted development noise limit for this assessment position and may be permitted development (subject to compliance with other permitted development limitations/conditions and parts of the MCS 020 standard.) NOTE – other assessment positions may also need to be tested. If NO – the heat pump will not be permitted for development. This installation may still go ahead if planning permission is granted by the local planning authority. <i>Example: 41 dB(A) is lower than 42 dB(A).</i>	Step 10 Result
		YES

Notes for Calculation Procedure

Note 1: Sound Power Level (STEP 1)


Sound Power is the total acoustical energy emitted by a sound source and is an absolute value. It is not affected by the environment or the location of the listener.

Note 2: Sound Pressure level (STEP 2)

Sound pressure is what we hear. It is a pressure disturbance at a specific point in the atmosphere whose intensity is influenced not only by the sound power of the source but also by the surroundings and the distance from the source to the point at which the sound is heard.

Note 3: Determination of “Directivity” (STEP 2)

The sound pressure level increases with the number of reflecting surfaces. Use the illustrations below to establish the directivity “Q” for the installation. A reflective surface is any surface (including the ground) within 1 metre of the heat pump.

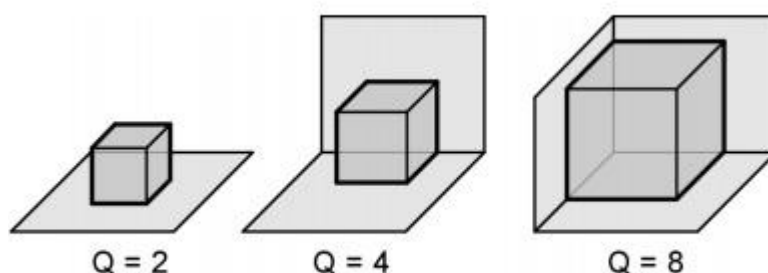

The following examples may be used as a guide:

- Q2 = a heat pump with one reflecting surface (i.e. the ground or a single wall if mounted on a wall off the ground);
- Q4 = a heat pump with two reflecting surfaces (i.e. ground mounted and against a wall or mounted off ground level against two walls);
- Q8 = a heat pump with three reflecting surfaces (i.e. ground mounted and against two walls or mounted off ground level between three walls);
- NOTE – a heat pump with more than three reflective surfaces (for example those within small lightwells) will not meet the MCS planning standards.

Note 4: dB distance reduction (STEP 4)

Distance from Heat Pump (metres) (STEP 3 RESULT)														
	1	1.5	2	3	4	5	6	8	10	12	15	20	25	30
Q (STEP 2 RESULT)														
2	-8	-11	-14	-17	-20	-21	-23	-26	-28	-29	-31	-34	-36	-37
4	-5	-8	-11	-14	-17	-19	-20	-23	-25	-26	-28	-31	-33	-34
8	-2	-5	-8	-11	-14	-16	-17	-20	-22	-23	-25	-28	-30	-31

Where a precise distance is not indicated in the above table, then the next lowest value for that distance should be used. E.g. if the distance was 2.5m, then the values for 2m should be used.

Note 5: Barriers between the heat pump and the assessment position (STEP 5)

A correction should be made for attenuation due to barriers between the heat pump and an assessment position. A correction will be necessary if an installer is unable to see an assessment position from the top edge of the heat pump. Use the following instructions to determine whether a correction is appropriate:

- For a solid barrier (e.g. a brick wall or a fence) that completely obscures an installer's vision of an assessment position from the top edge of the heat pump attenuation of -10 dB may be assumed;
- Where a solid barrier completely obscures an installer's vision of an assessment position from the top or side edges of the heat pump, but moving a maximum distance of 25cm in any direction to the heat pump allows an assessment position to be seen, attenuation of -5 dB may be assumed;
- If it is possible for an installer to see any part of an assessment position from the top or side edges of a heat pump no attenuation may be assumed.

Note 6: MCS Planning Standard for a heat pump background noise level (STEP 7)

The MCS Planning Standard assumes a background noise level of 40 dB (A) for the purposes of the heat pump calculation procedure. A different value for background noise should not be used as part of this calculation procedure.

Note 7: Decibel Correction (STEP 9)

Please note that the left-hand column should be used for both positive and negative differences (e.g. a difference of +3 and – 3 both attract a correction of 1.8 dB).

Difference between the two noise levels (dB) (+/-)	Add this correction to the higher noise level (dB)
0	3.0
1	2.5
2	2.1
3	1.8
4	1.5
5	1.2
6	1.0
7	0.8
8	0.6
9	0.5
10	0.4
11	0.3
12	0.3
13	0.2
14	0.2
15	0.1

Location map

