

REV	DATE	DESCRIPTION	DRW	CHK
C01	17.10.25	INITIAL ISSUE	DW	RH
C02	18.12.25	CONSTRUCTION ISSUE	MTB	AST

GENERAL NOTES

DRAWINGS AND SPECIFICATIONS: This drawing is to be read in conjunction with all relevant Architects, Engineers and Specialists drawings together with the specification.

Refer to Craddys drawing 13599-CDY-XX-XX-DR-C-0050.


C D M : SIGNIFICANT HAZARDS
THE FOLLOWING HEALTH AND SAFETY HAZARDS ARE IDENTIFIED BY THE DESIGNER AS ABNORMAL IN PURSUANCE OF THE CURRENT CONSTRUCTION DESIGN AND MANAGEMENT REGULATIONS.
RISKS DURING CONSTRUCTION: Refer to Craddys drawing: 13599-CDY-XX-XX-DR-C-0050.
OPERATION / MAINTENANCE RISKS: Refer to Craddys drawing: 13599-CDY-XX-XX-DR-C-0050.
RISKS DURING DEMOLITION/DECOMMISSIONING/DISMANTLING/ALTERATIONS: Refer to Craddys drawing: 13599-CDY-XX-XX-DR-C-0050.
IT IS ASSUMED THAT ALL WORKS WILL BE CARRIED OUT BY COMPETENT & ADEQUATELY RESOURCED CONTRACTOR(S) TO SAFE SYSTEMS OF WORK.
THIS DRAWING IS THE COPYRIGHT OF CRADDY PITCHERS LTD AND MUST NOT BE COPIED, REPRODUCED OR SUBMITTED TO OTHER PARTIES WITHOUT THEIR PERMISSION.

Client	ALDI - Aldi Stores Ltd.
Project Title	ALDI STORE
Project Address	PERRYMOUNT ROAD HAYWARDS HEATH

PROPOSED DRAINAGE DETAILS
SHEET 4


Job No.	Originator	Zone	Level	Type	Role
13599	CDY	XX	XX	DR	C
System Classification	Drawing No.	Suitability	Revision		
Ss_15_10_00	0058	A5	C02		
Drawn	Checked	Date	Scale	Size	
DW	RH	17.10.25	AS SHOWN	A1	

Approved	Craddys Job#	IF YOU HAVE A QUERY CALL US
RAG	13599	SCALING FROM THIS DRAWING OR OBTAINING DIMENSIONS ELECTRONICALLY MAY NOT PROVIDE ACCURATE INFORMATION & SHOULD BE AVOIDED. WORK ONLY FROM FIGURED DIMENSIONS.

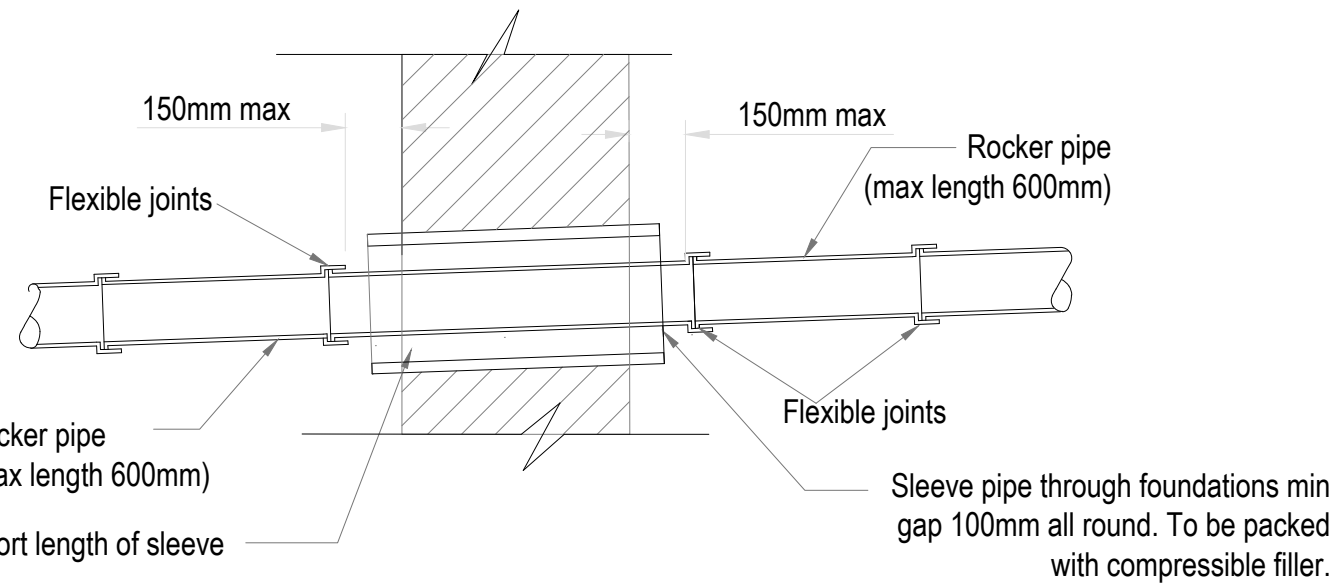

DETAIL FOR DRAINS THROUGH FOUNDATIONS IN SOILS WITH MEDIUM VOLUME
CHANGE POTENTIAL


Scale: 1:20

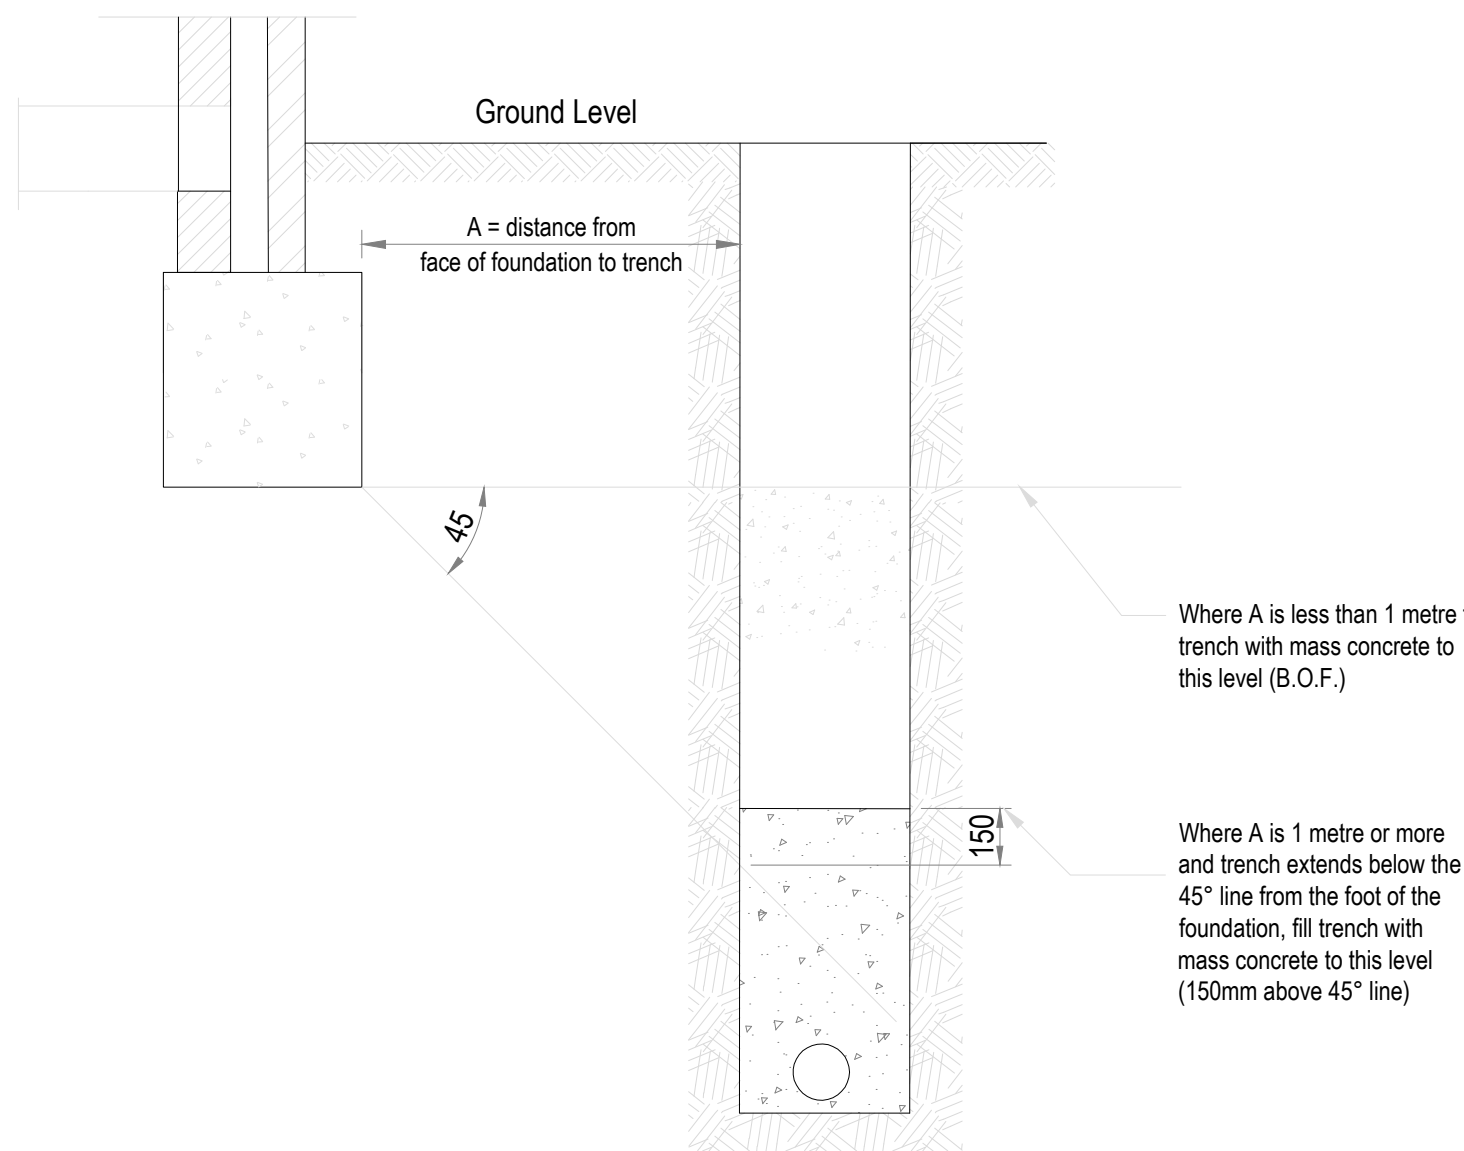

DETAIL FOR PRIVATE PIPE RUNS NEAR FOUNDATIONS

NTS

For adoptable drainage runs near foundations, refer to DCG

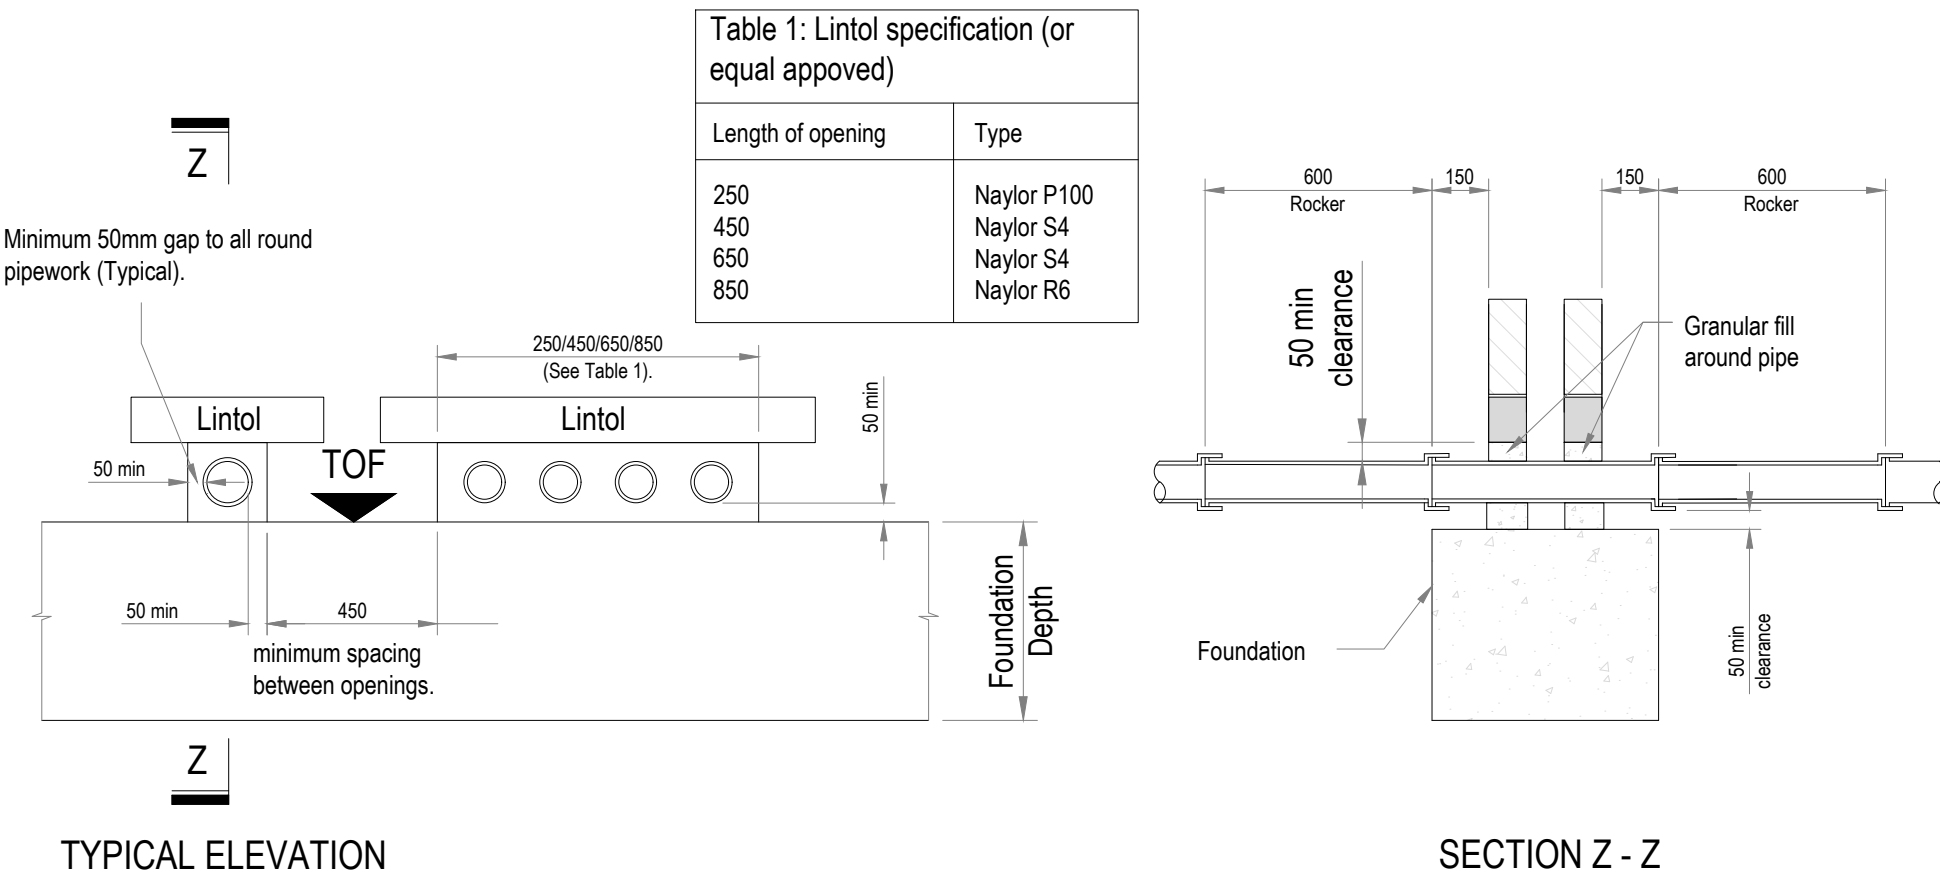


TYPICAL ELEVATION

SECTION Z - Z


DRAINAGE CROSSING DETAIL THROUGH MASONRY SUB-FLOOR WALLS

Scale 1:20

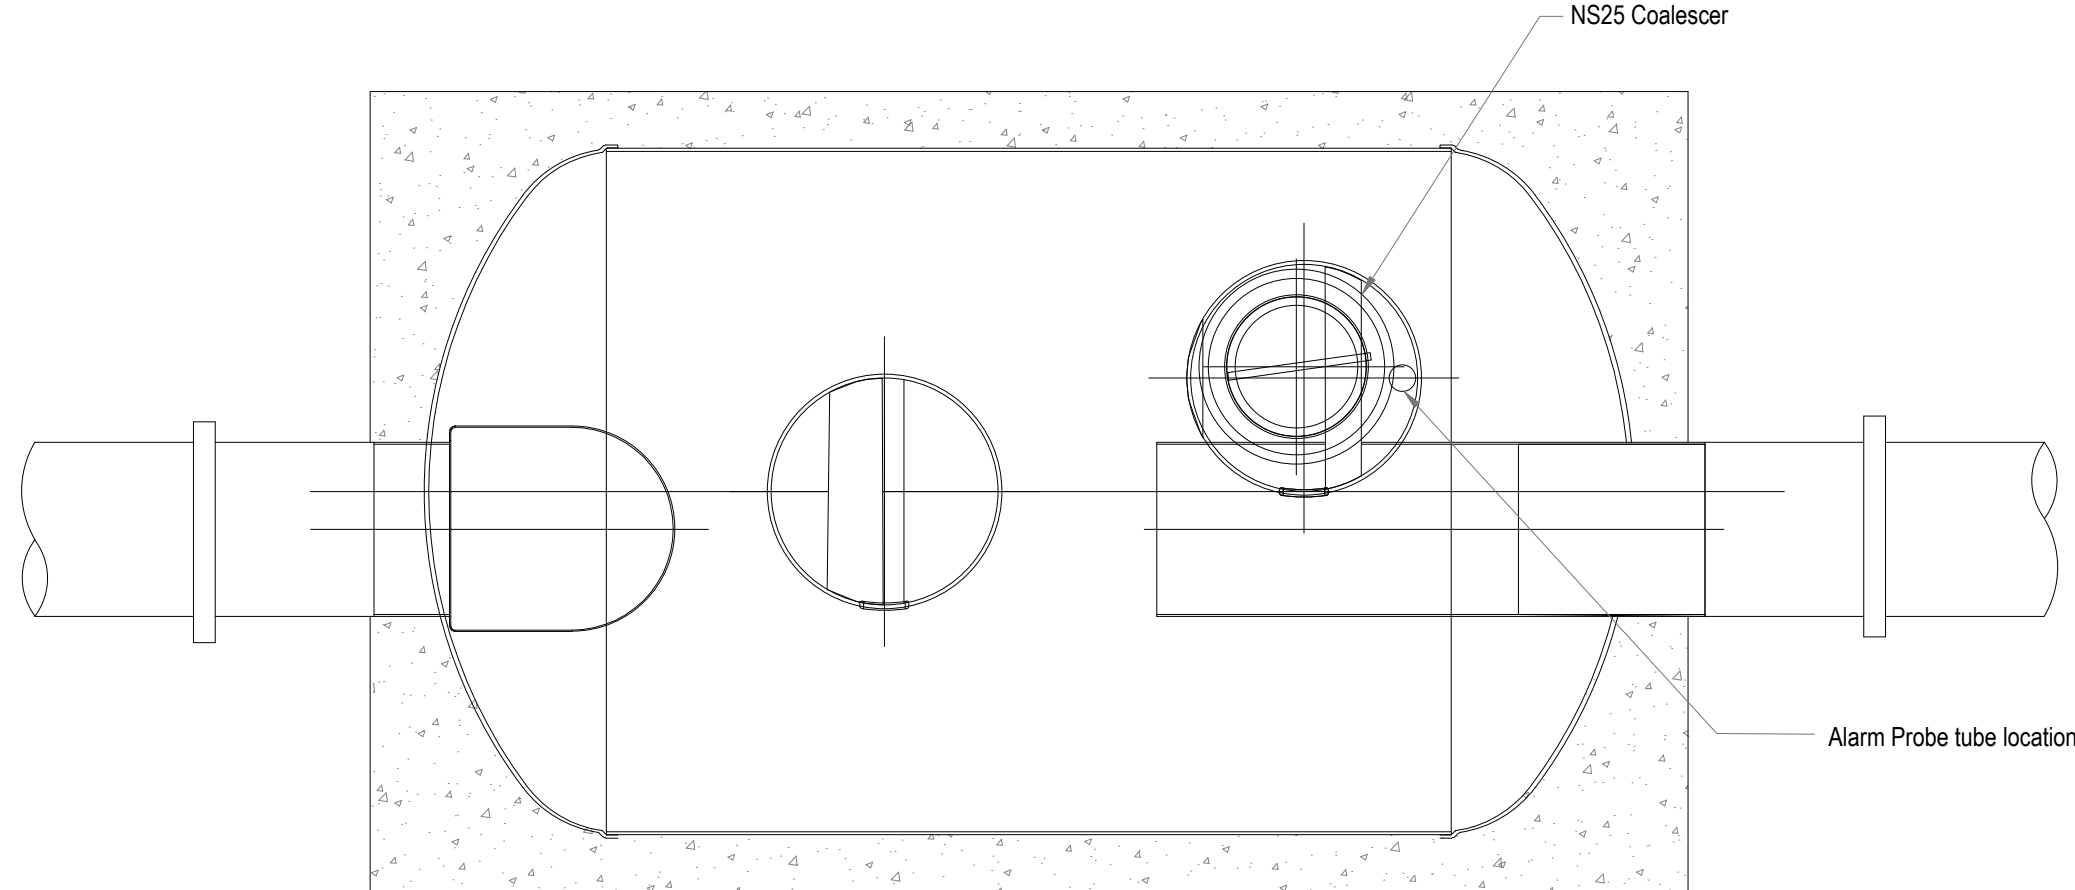

Provide max 600mm length of rocker pipe to inlet and outlet at the junction of the concrete surround.

Separator to be installed in accordance with the manufacturers installation guidelines.

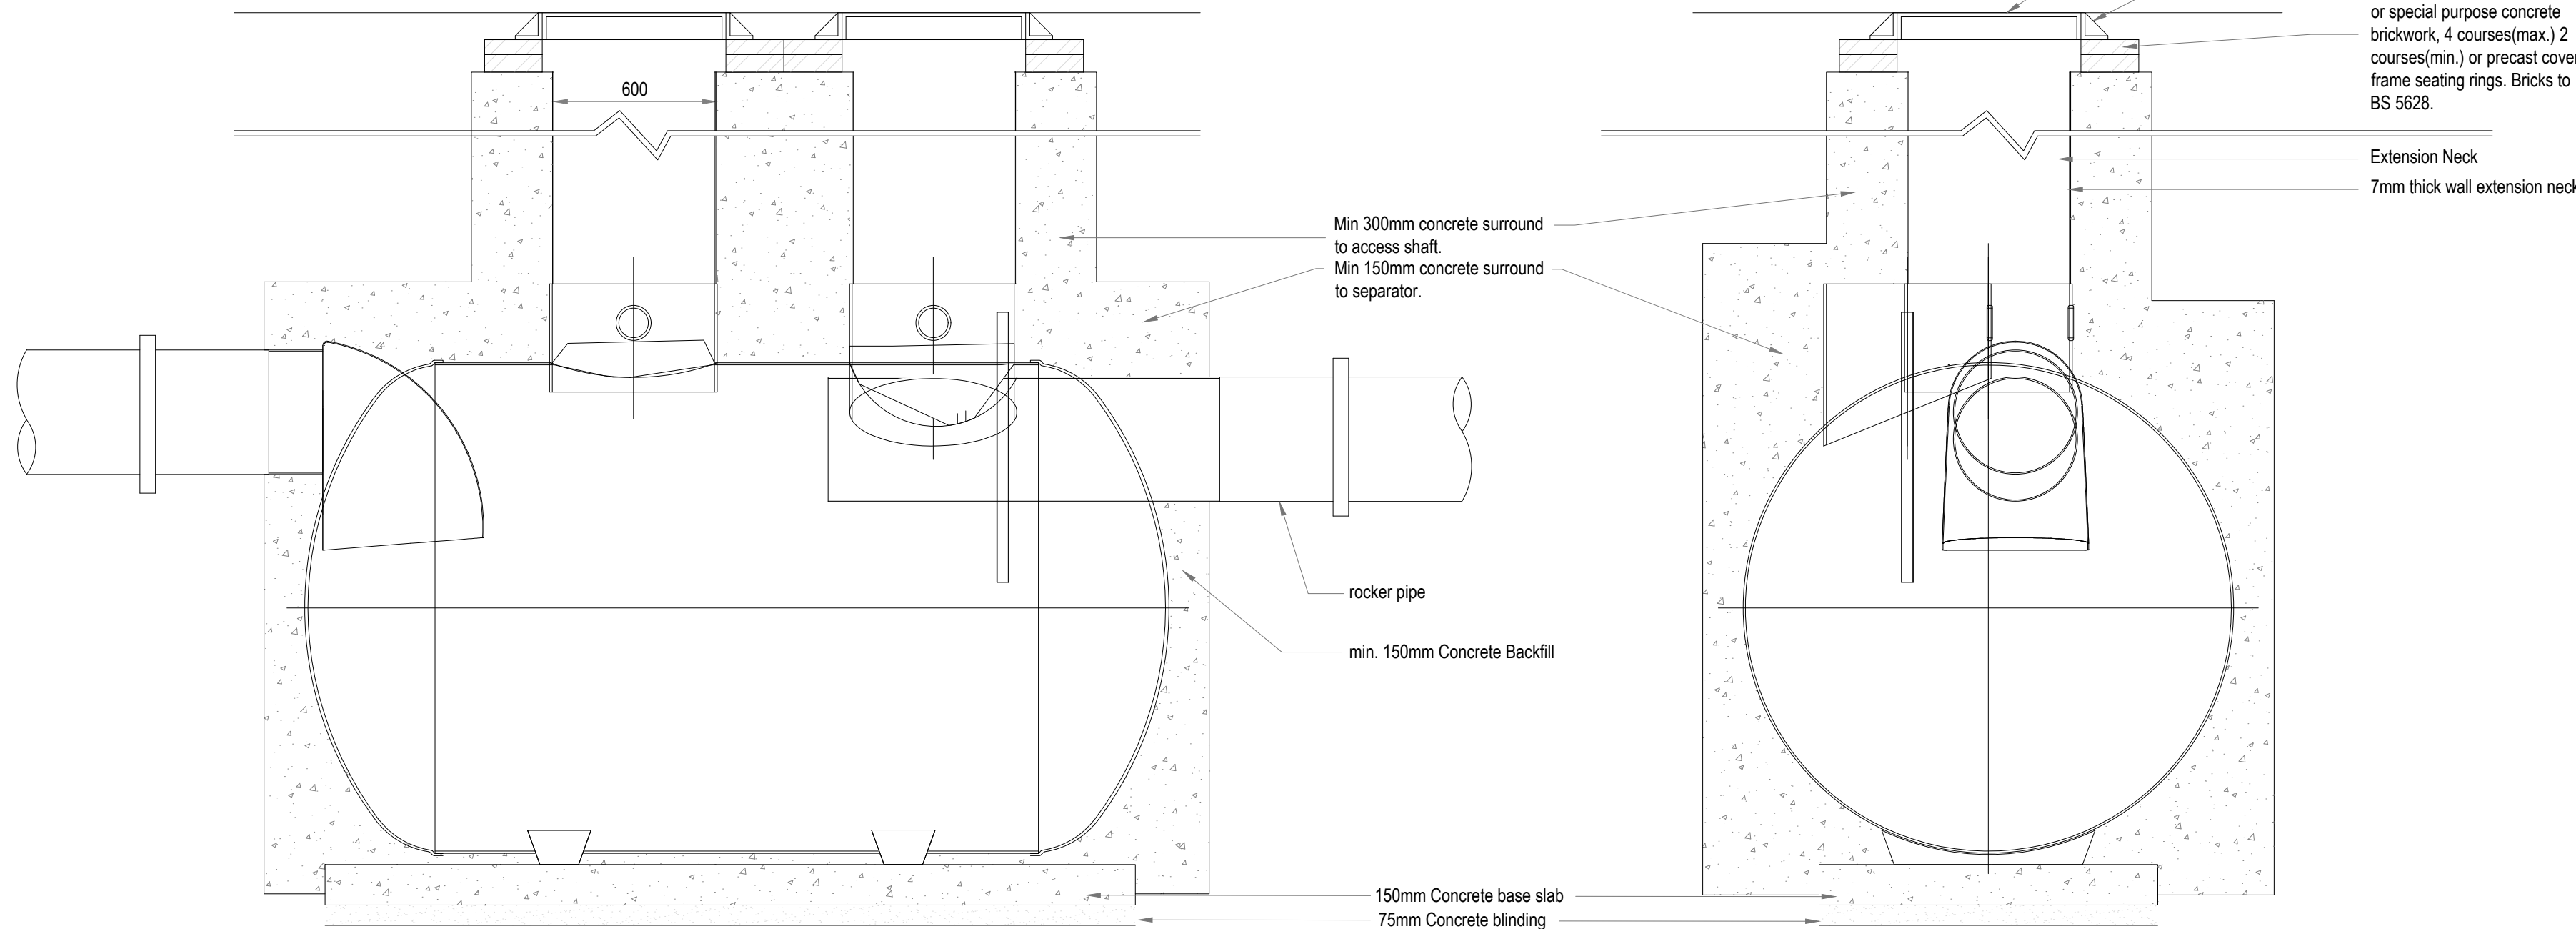

INDICATIVE SPEL 320 C1/ESR BYPASS SEPARATOR

NTS