


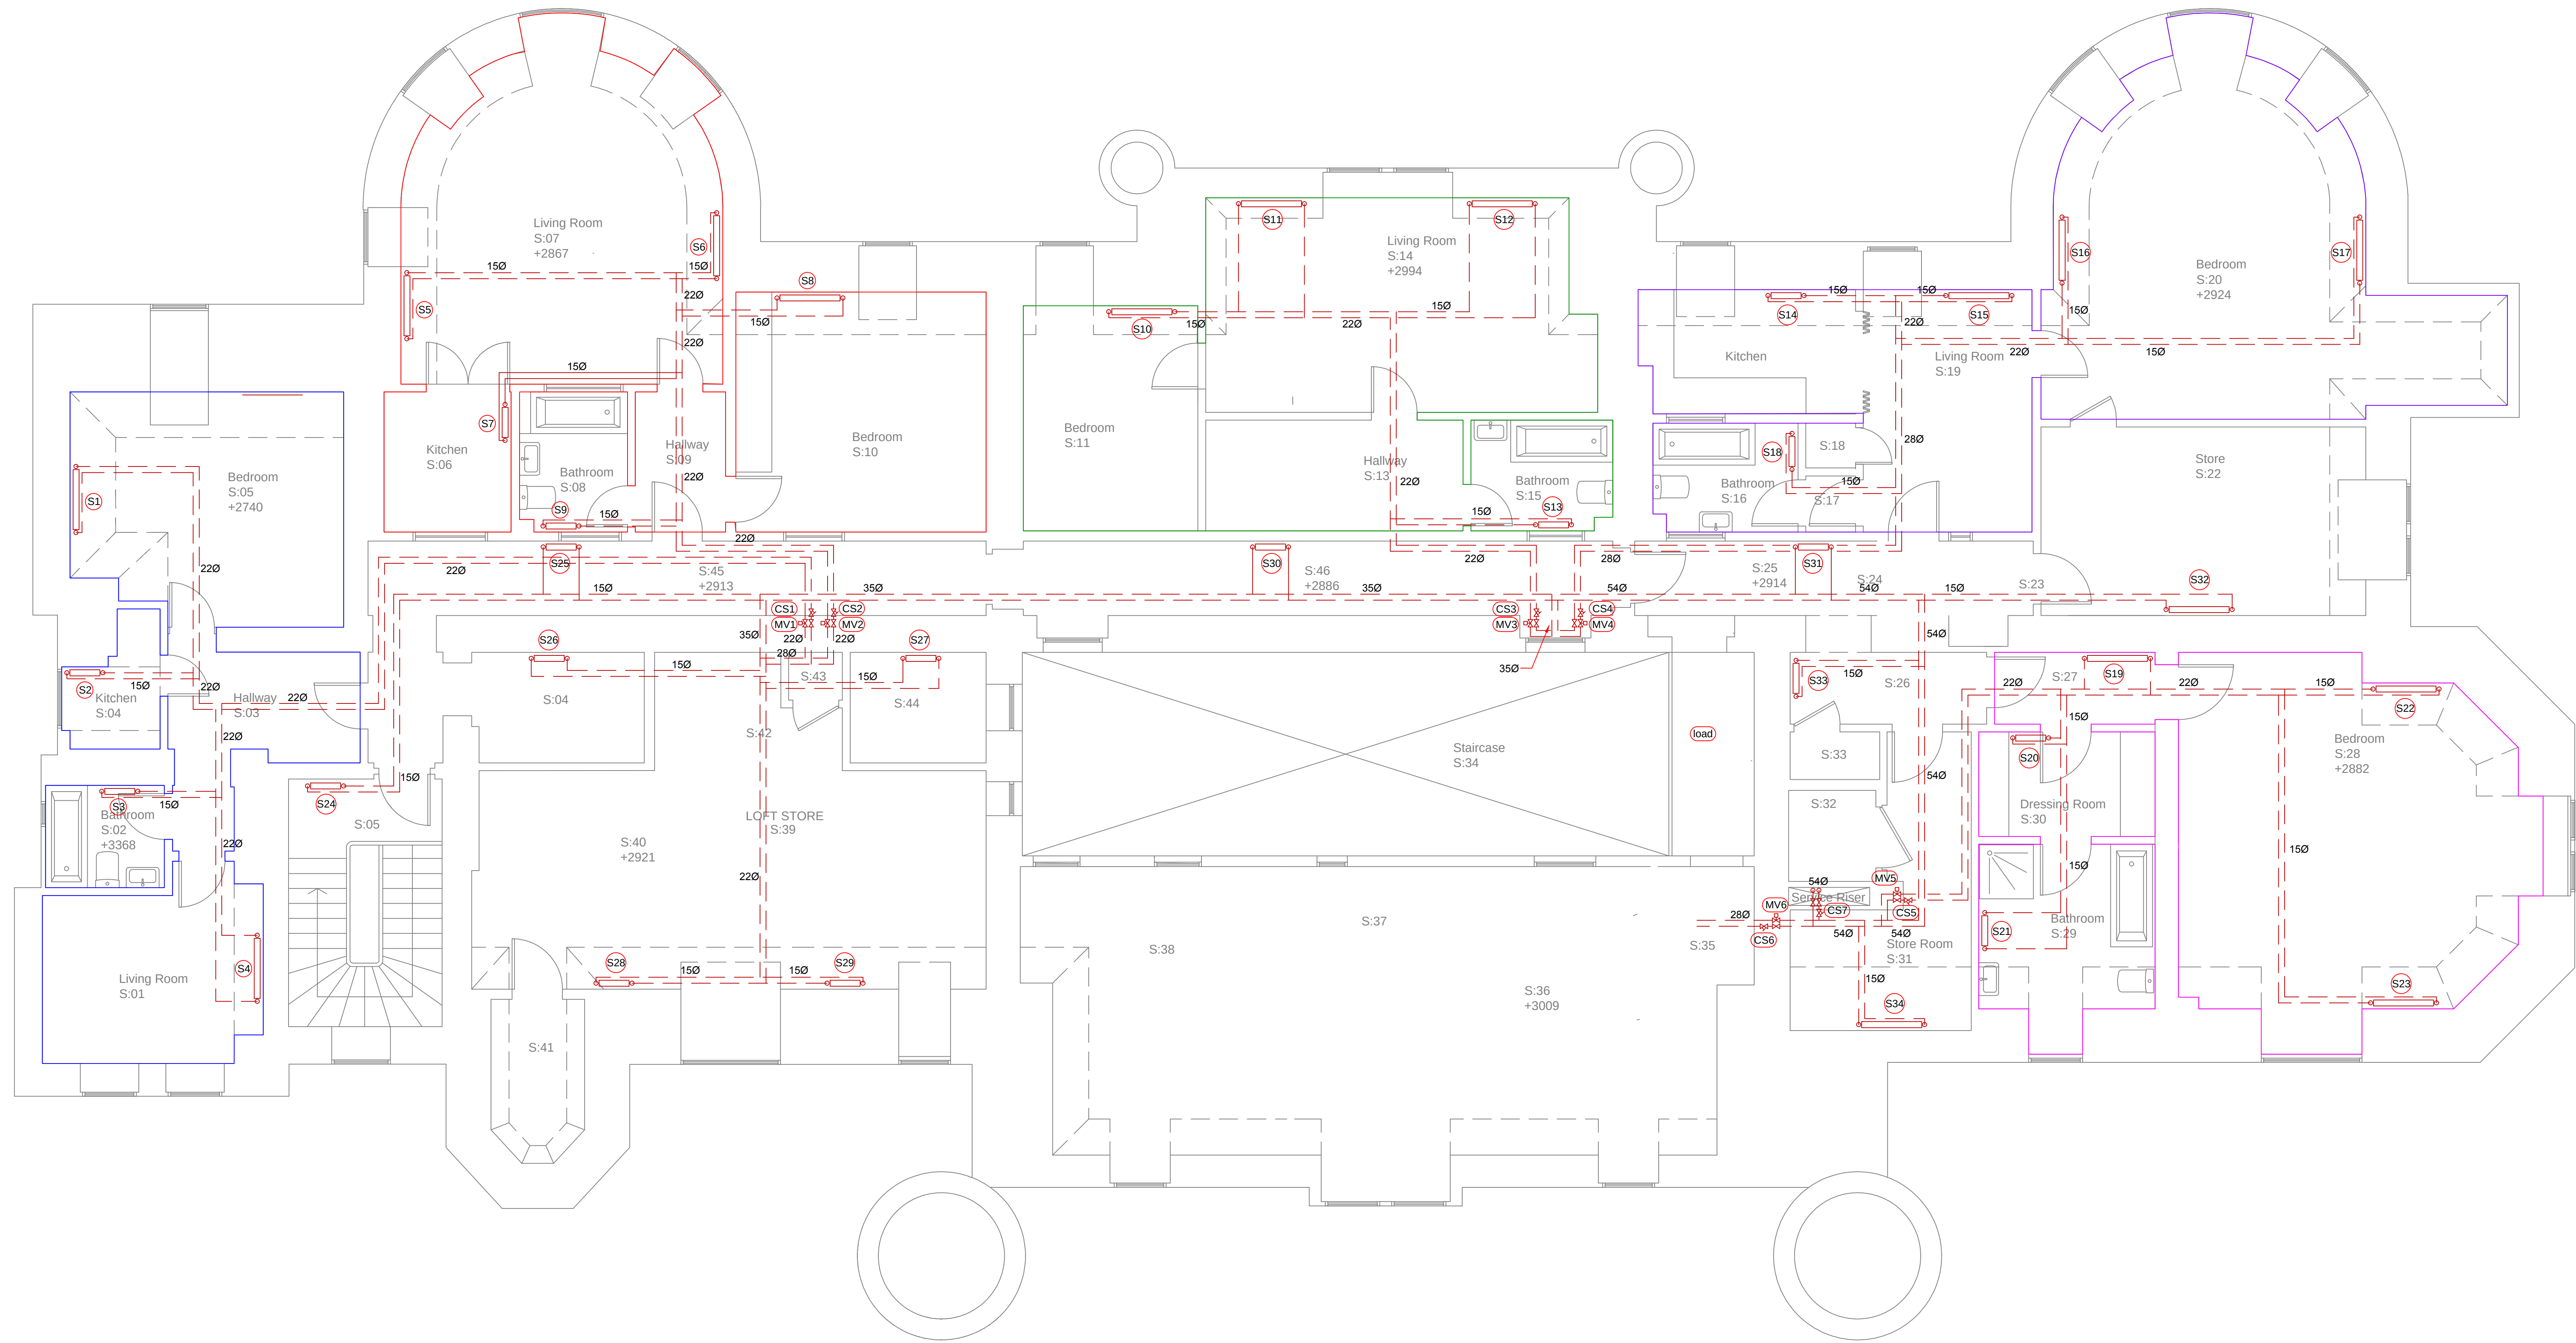

HAZARD NOTES:

 **Think safety**
Could your task affect the safety of anyone else? Have you got safe, adequate and correct means of access? Is there adequate lighting? Are you wearing the correct PPE and do you have the correct tools for the task you are undertaking? Is the task safe in today's environment and weather conditions? Are you in a work area free from conflicting activities?

 **Work at height**
Installation work involves work at height.

DO NOT SCALE THIS DRAWING
DIMENSIONS TO BE CHECKED ON SITE.

Notes:

Ref	Room	Heat Loss	Make	Model	Length	Height	Output
S1	S05 Bedroom	3563	Stelrad	K3	1400	700	3797
S2	S04 Kitchen	970	Stelrad	K2	500	700	980
S3	S02 Bathroom	1216	Stelrad	Caliente Double	500	1791	1402
S4	S01 Living Room	3313	Stelrad	K3	1400	700	3797
S5	S07 Living Room	6081	Stelrad	K3	1100	700	2983
S6	S07 Living Room		Stelrad	K3	1100	700	2983
S7	S06 Kitchen	842	Stelrad	P+	600	700	919
S8	S10 Bedroom	2751	Stelrad	K3	1000	700	2712
S9	S08 Bathroom	930	Stelrad	Caliente Single	500	1791	986
S10	S11 Bedroom	2751	Stelrad	K2	1400	700	2745
S11	S14 Living Room	5001	Stelrad	K3	1000	700	2712
S12	S14 Living Room		Stelrad	K3	1000	700	2712
S13	S15 Bathroom	1078	Stelrad	Caliente Single	600	1791	1158
S14	Kitchen	1910	Stelrad	K2	1000	700	1960
S15	S19 Living Room	2046	Stelrad	K2	1100	700	2156
S16	S20 Bedroom	6714	Stelrad	K3	1200	700	3254
S17	S20 Bedroom		Stelrad	K3	1200	700	3254
S18	S16 Bathroom	1069	Stelrad	Caliente Single	600	1791	1158
S19	S27 Corridor	429	Stelrad	K1	500	600	490
S20	S30 Dressing	647	Stelrad	Compact Vertical	400	1800	1146
S21	S29 Bathroom	2300	Stelrad	Caliente Double	750	2013	2321
S22	S28 Bedroom	6115	Stelrad	K3	1100	700	2983
S23	S28 Bedroom		Stelrad	K3	1100	700	2983
S24	S05 Stairs	1757	Stelrad	Compact Vertical	600	2000	1872
S25	S45 Corridor	1640	Stelrad	K2	1200	600	1616
S26	S04 Store	432	Stelrad	P+	500	450	528
S27	S44 Store	332	Stelrad	P+	500	450	528
S28	S39 Loft Store	4839	Stelrad	K2	1400	600	2424
S29	S39 Loft Store		Stelrad	K2	1400	600	2424
S30	S46 Corridor	1204	Stelrad	P+	1000	600	1347
S31	S24 Corridor	985	Stelrad	P+	800	600	1077
S32	S22 Store	2055	Stelrad	K2	1200	600	2078
S33	S26 Corridor	524	Stelrad	P+	500	450	528
S34	S31 Store	1084	Stelrad	P+	900	600	1212
S34	Staircase	4866	To be agreed				
S36	Habitable Room	11027	To be agreed				

P0	22.07.25	For Approval
Rev	Date	Description
Issue: FOR APPROVAL		
		
Client:	M Blencowe	
Project:	Wychcross Place	
Drawing Title:	Second Floor Heating	
Drawn By: JC	Checked	Date
Approved	Date	
Scale: 1:50 @ A0		Date: Jul 2025
DRG. No. JMS-0182-M103	REV: P0	