



LEGEND:

	1 Gang Switched Socket Outlet		Intruder alarm panel		Fire Alarm Panel
	2 Gang Switched Socket Outlet		Key pad		Fire Alarm Repeater Touchscreen
	1 Gang Unswitched Socket Outlet		Acoustic (glass break) sensor		Fire Alarm Interface Unit
	2 Gang Unswitched Socket Outlet		Door contact		Fire Sensor/detector c/w Sounder Base
	Switched Fuse Connection Unit		Dual technology antimask movement sensor	Fire sensor/detector - n denotes type:	
	Unswitched Fused Connection Unit		Door entry system door entry panel	SD = smoke detector	
	Double Pole Switch, 'n' Denotes Current Rating		Door entry system video entry panel	HD = heat detector	
	Flex Outlet, Including Final Connection to Appliance		Video entry system monitor/handset	CO = carbon monoxide	
	Fused Connection Unit, Controlling Unswitched Socket Outlet		Internal alarm sounder		Movement Sensor
	Appliances Isolation Panel		External alarm sounder		Window Contact
	Shaver Socket, Dual Voltage, Double Wound Isolating Transformer		CCTV dome camera		Door Contact
	SP&N Fused Switch Disconnector		Ceiling mounted recessed speaker		Keypad
	TP&N Fused Switch Disconnector		Triplex Integrated Reception System outlet (satellite, off air TV and FM/DAB radio)		Panic Button
	Electrical Vehicle Supply Equipment, 'n' Denotes Rating		Quad Integrated Reception System outlet (satellite, satellite, off air TV and FM/DAB radio)		
	'n' Gang Structured Wiring/Data Outlet Plate				
	WiFi Booster Point, High Level PoE				
	Accessory Mounted In Floor Box				
	Circuit Link				
	Final Connection (Load)				

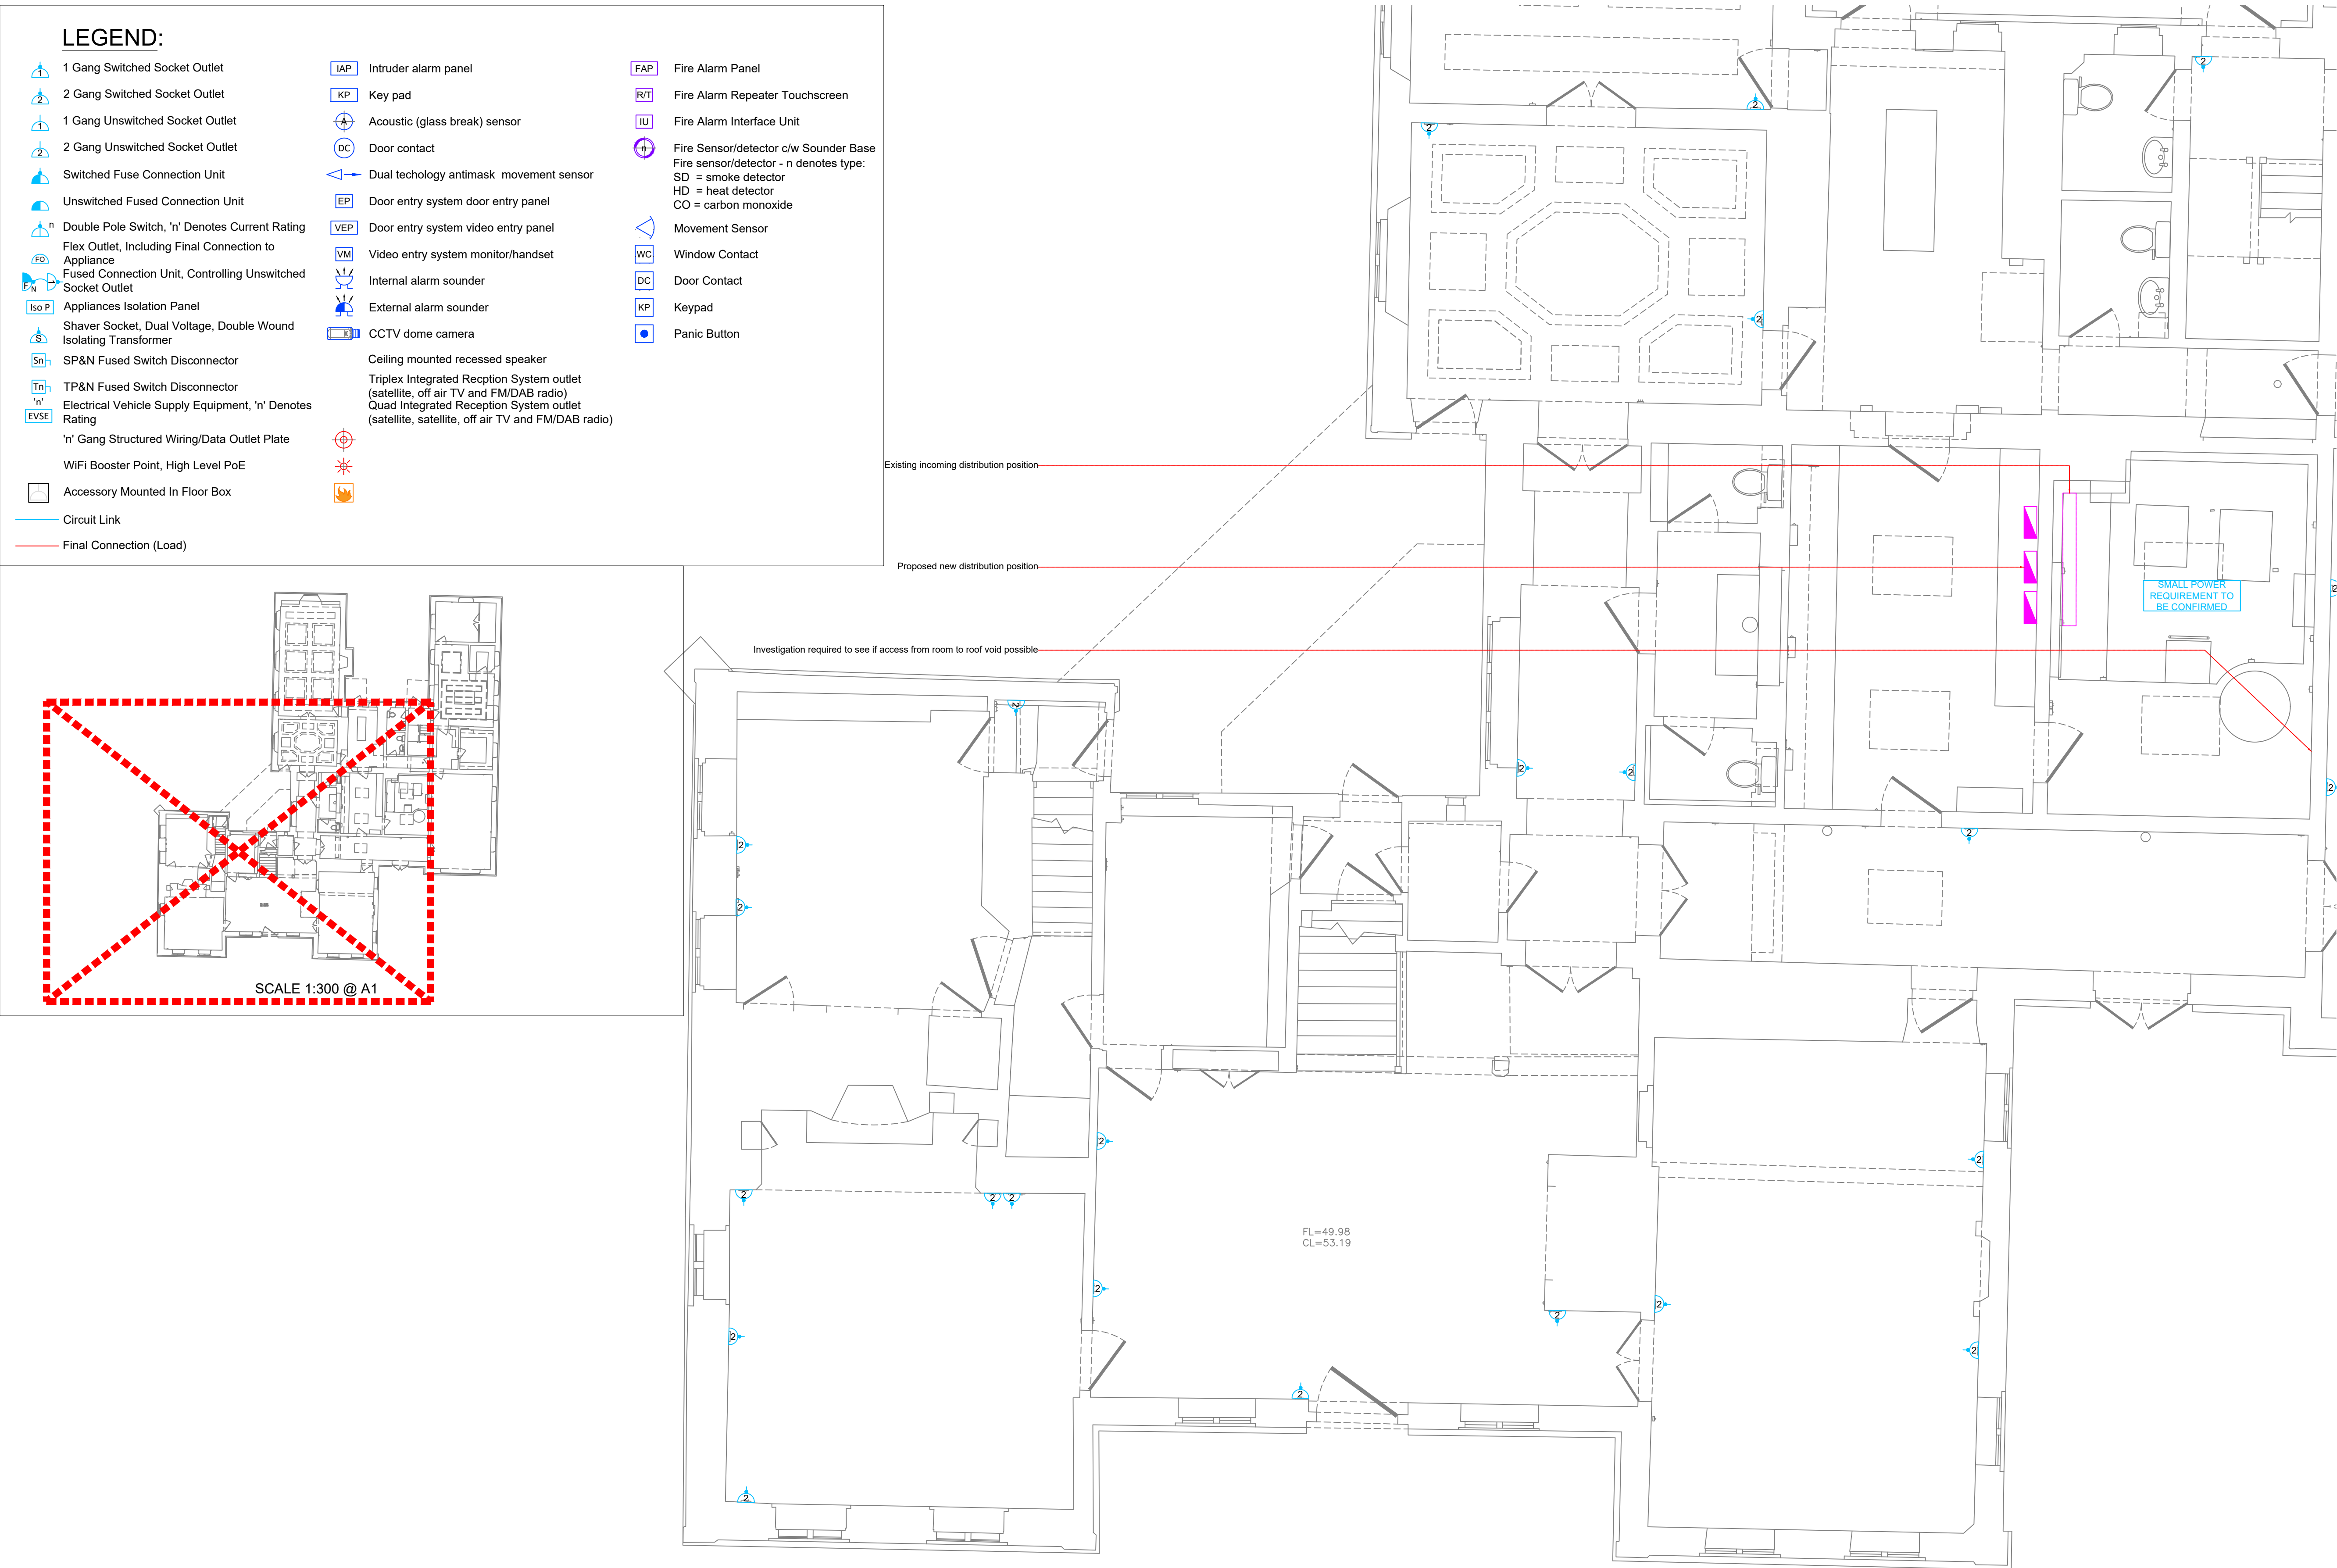

Rev	Revision Detail	Date

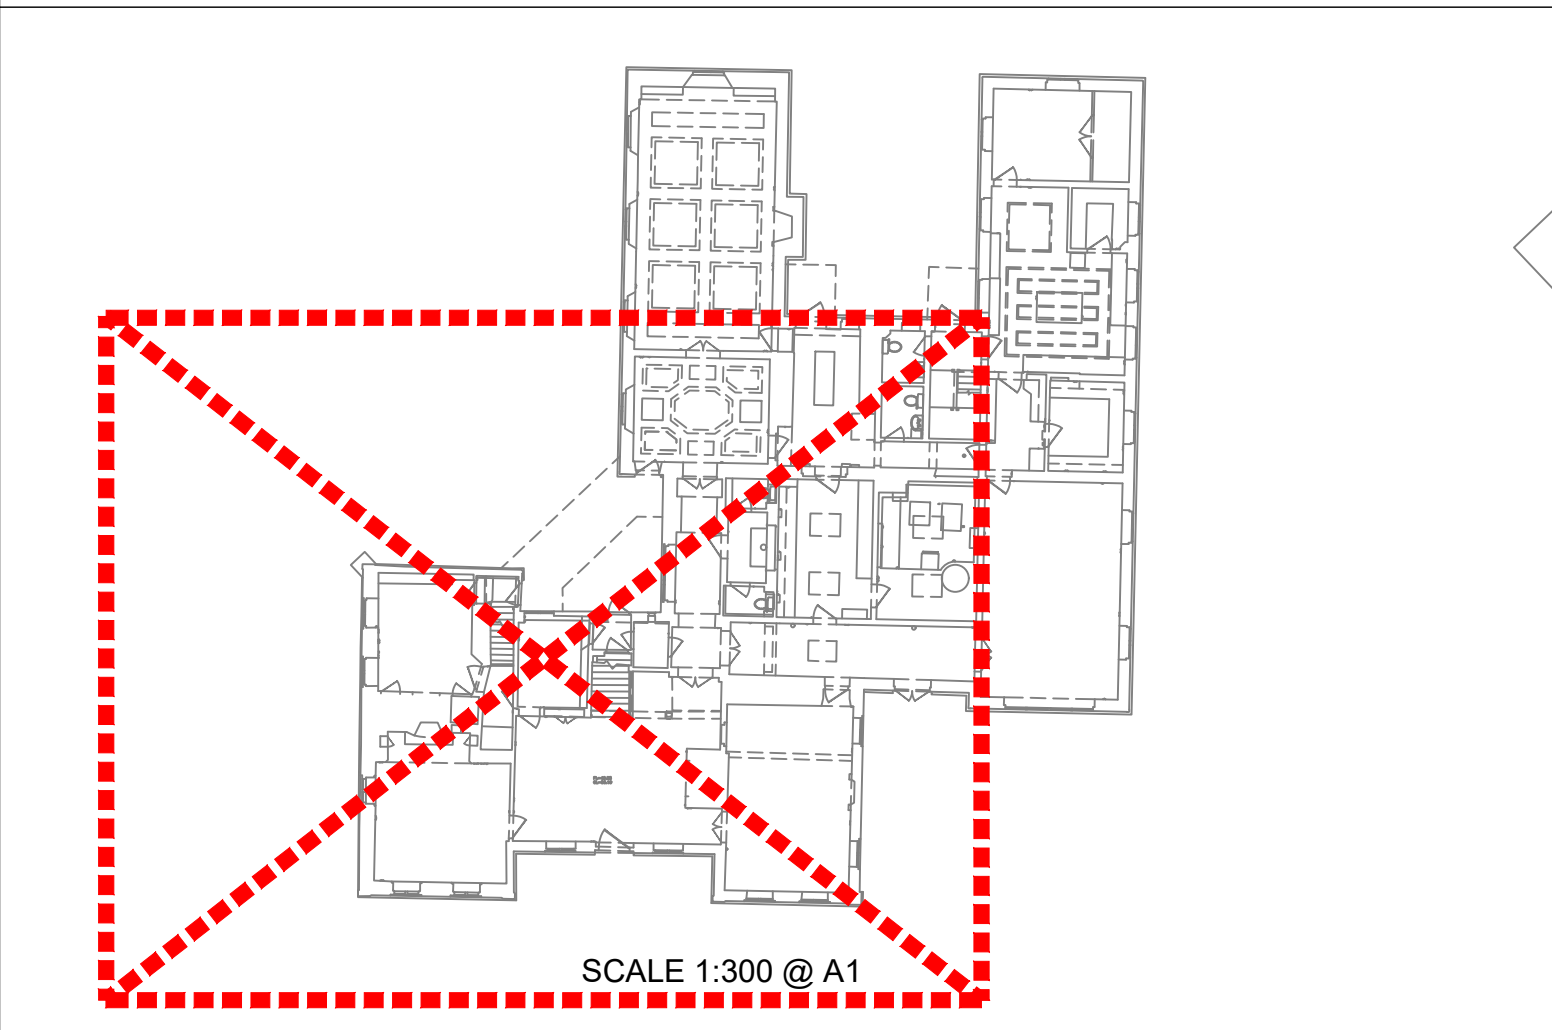

GM Monk Electrical Contractors Unit 8 Harvington Business Park, Brampton Road, Eastbourne BN22 9BN	TEL: 01323 841769 EMAIL: enquiries@gmm Monk.co.uk WEB: www.gmm Monk.co.uk
---	--

CLIENT:

PROJECT: STONEHALL,
HAYWARDS HEATH
ROAD, BALCOMBE,
RH17 6QN

TITLE:

GROUND FLOOR SMALL
POWER AND DATA 2 OF
2 FOR COMMENT

DRAWN SL	CHECKED KB	DATE JUNE 2024	SCALE 1:50 @ A1
DRAWING No. 1883-GMM-00-02-E-0302			REVISION P1