


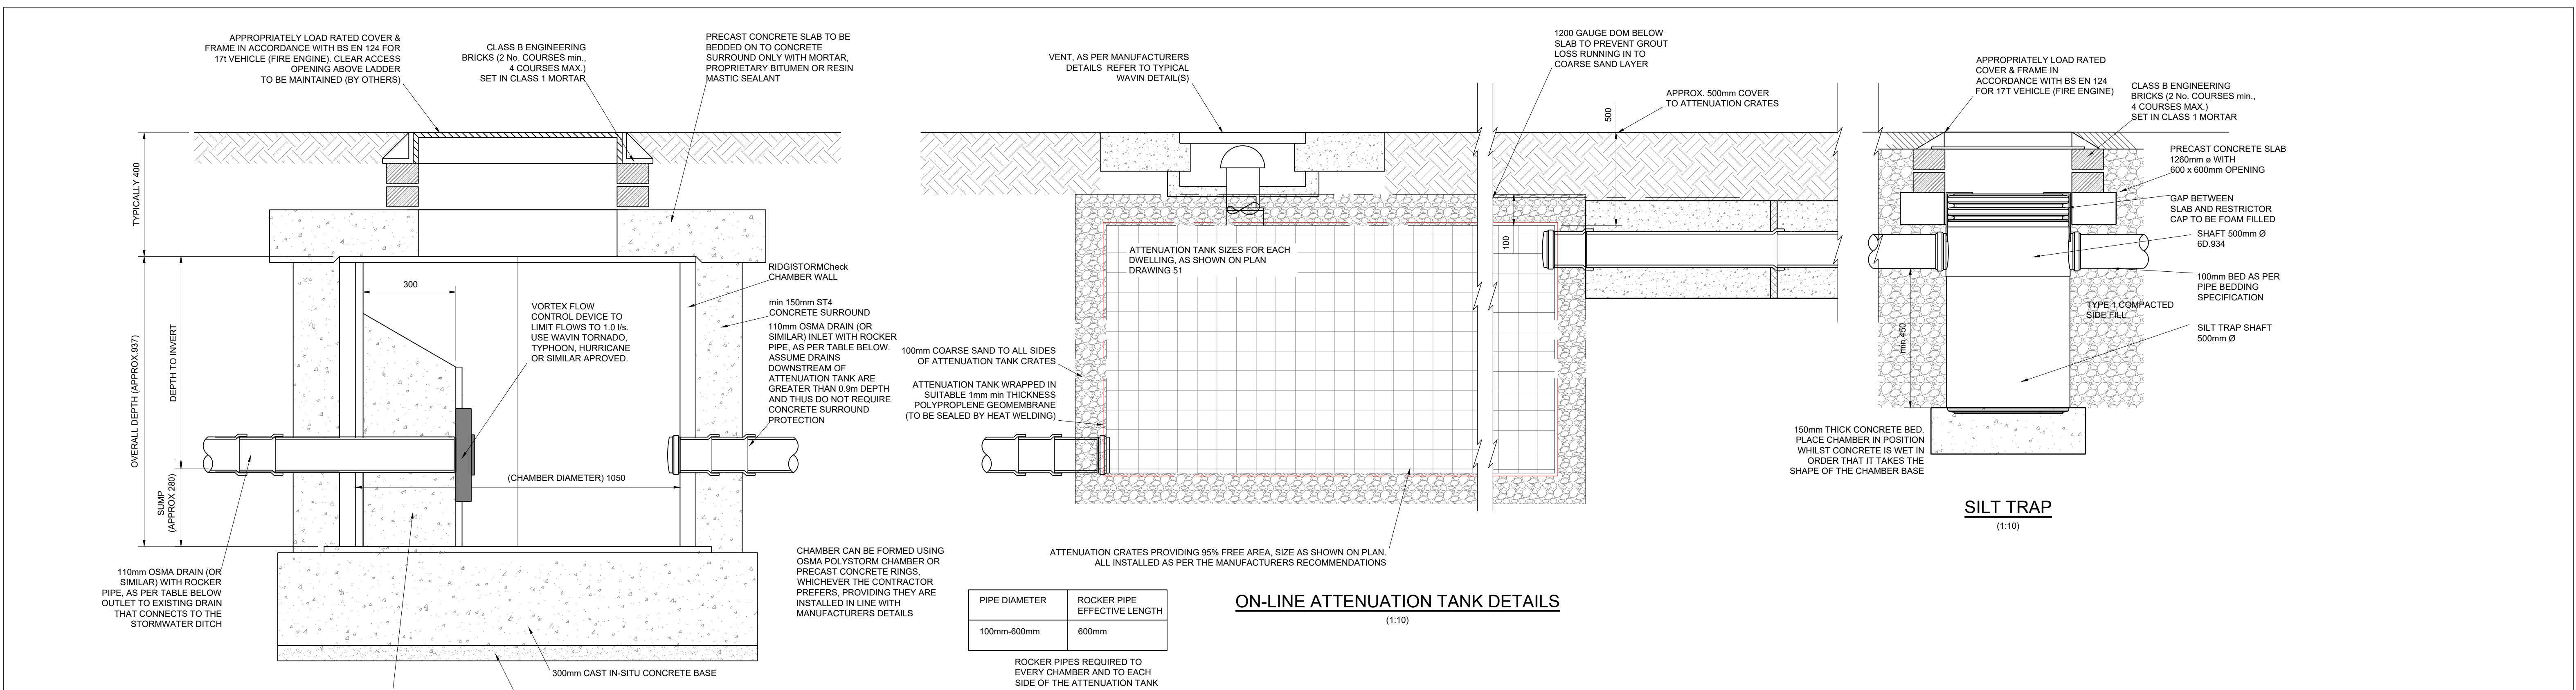

1.0 l/s RESTRICTED
OUTFLOW CHAMBER
(1:10)

ON-LINE ATTENUATION TANK DETAILS
(1:10)

SILT TRAP
(1:10)

MAINTENANCE NOTES
1. THE OWNER OF EACH DWELLING IS RESPONSIBLE FOR THE MAINTENANCE OF EACH DWELLING'S DRAINAGE ARRANGEMENT RESPECTIVELY.
2. NOTE THAT AN EASEMENT FOR MAINTENANCE AND ACCESS IS REQUIRED ON THE LAND OF RIVERSIDE TO SERVE THE LOXLEY HOUSE DRAINAGE.
THIS IS TO BE ENTERED IN TO ALL LEGAL DOCUMENTS

MAINTENANCE SCHEDULE - AS TAKEN FROM SUDS MANUAL, TABLE 21.3 FOR DOMESTIC FLOW CONTROL DEVICE
(THIS INFORMATION IS TO BE WRITTEN IN TO THE O&M MANUAL)


MAINTENANCE SCHEDULE	REQUIRED ACTION	TYPICAL FREQUENCY	PERSON RESPONSIBLE FOR UNDERTAKING OR COMMISSIONING SUITABLE PROFESSIONAL
	INSPECT AND IDENTIFY ANY AREAS THAT ARE NOT OPERATING CORRECTLY. IF REQUIRE, TAKE REMEDIAL ACTION	MONTHLY FOR 3 MONTHS, THEN ANNUALLY	CLIENT / END USER / BUILDING OWNER
REGULAR MAINTENANCE (ATTENUATION TANKS & FLOW CONTROL DEVICE/CHAMBER)	REMOVE DEBRIS FROM THE CATCHMENT SURFACE (WHERE IT MAY CAUSE RISKS TO PERFORMANCE)	MONTHLY	CLIENT / END USER / BUILDING OWNER
	FOR SYSTEMS WHERE RAINFALL INFILTRATES IN TO THE TANK FROM ABOVE, CHECK SURFACE OF FILTER FOR BLOCKAGE BY SEDIMENT, ALGAE OR OTHER MATTER; REMOVE AND REPLACE SURFACE INFILTRATION MEDIUM AS NECESSARY	ANNUALLY	CLIENT / END USER / BUILDING OWNER
REMEDIAL ACTIONS (ALL SUDS PARTS)	REPAIR / REHABILITATE INLETS, OUTLETS, OVERFLOW AND VENTS	AS REQUIRED	CLIENT / END USER / BUILDING OWNER
REMEDIAL ACTIONS (FLOW CONTROL DEVICE)	REMOVE BLOCKAGES TO THE FLOW CONTROL DEVICE, AS REQUIRED BY FOLLOWING THE MAINTENANCE INSTRUCTIONS RELATING TO THAT PARTICULAR DEVICE, i.e. FOR TORNADO STYLE DEVICE, OPEN DOOR USING STAINLESS STEEL ROPE PROVIDED, FOR TYPHOON STYLE DEVICE PULL OUT UP-STAND PIPE TO ACTIVATE DRAIN DOWN, AND FOR HURRICANE STYLE DEVICE, USE THE LIFTING ROD TO DRAIN DOWN AND CLEAR BLOCKAGE(S).	AS REQUIRED	CLIENT / END USER / BUILDING OWNER
MONITORING	INSPECT / CHECK ALL INLETS, OUTLETS, VENTS AND OVERFLOWS TO ENSURE THAT THEY ARE IN GOOD CONDITION AND OPERATING AS DESIGNED	ANNUALLY	CLIENT / END USER / BUILDING OWNER
	SURVEY INSIDE OF TANK FOR SEDIMENT BUILD-UP AND REMOVE, IF NECESSARY	EVERY 5 YEARS, OR AS REQUIRED	CLIENT / END USER / BUILDING OWNER

MAINTENANCE SCHEDULE - AS TAKEN FROM SUDS MANUA C753, APPENDIX B, BOX-B2 FOR PERVIOUS PAVEMENTS

MAINTENANCE SCHEDULE	REQUIRED ACTION	TYPICAL FREQUENCY	PERSON RESPONSIBLE FOR UNDERTAKING OR COMMISSIONING SUITABLE PROFESSIONAL
REGULAR MAINTENANCE	CLEANING BRUSH REGULARLY AND REMOVE SWEEPINGS FROM ALL HARD SURFACE	MONTHLY	SITE OWNER (MAINTENANCE CONTRACT)
OCCASIONAL TANKS	BRUSH AND VACUUM PERMEABLE PAVING SURFACE ONCE A YEAR TO PREVENT SILT BLOCKAGE AND ENHANCE DESIGN LIFE	ANNUALLY	SITE OWNER (MAINTENANCE CONTRACT)
REMEDIAL WORK	MONITOR EFFECTIVENESS OF PERMEABLE PAVEMENT, AND WHEN WATER DOES NOT INFILTRATE IMMEDIATELY ADVISE THE CLIENT OF POSSIBLE NEED FOR REINSTATEMENT OF TOP LAYERS OR SPECIALIST CLEANING. RECENT EXPERIENCE SUGGESTS THAT WET WASHING AND SUCTION CLEANING WILL SUBSTANTIALLY REINSTATE PAVEMENT TO 90% EFFICIENCY	AS REQUIRED	SITE OWNER (MAINTENANCE CONTRACT)

MAINTENANCE SCHEDULE - AS TAKEN FROM SUDS MANUA C753, APPENDIX B, BOX-B2 FOR INLETS, OUTLETS & INSPECTION CHAMBERS

MAINTENANCE SCHEDULE	REQUIRED ACTION	TYPICAL FREQUENCY	PERSON RESPONSIBLE FOR UNDERTAKING OR COMMISSIONING SUITABLE PROFESSIONAL
REGULAR MAINTENANCE	INLETS, OUTLETS AND SURFACE CONTROL STRUCTURES INSPECT SURFACE STRUCTURES, REMOVING OBSTRUCTIONS AND SILT AS NECESSARY. CHECK THERE IS NO PHYSICAL DAMAGE. STRIM VEGETATION 1m MIN. SURROUND TO STRUCTURES AND KEEP HARD APRONS FREE FROM SILT AND DEBRIS INSPECTION CHAMBERS AND BELOW-GROUND CONTROL CHAMBERS REMOVE COVER AND INSPECT, ENSURING THAT WATER IS FOWING FREELY AND THAT THE EXIT ROUTE FOR WATER IS UNOBSTRUCTED. REMOVE DEBRIS AND SILT. UNDERTAKE INSPECTION AFTER LEAF FALL IN AUTUMN	MONTHLY (OR AS REQUIRED)	SITE OWNER (MAINTENANCE CONTRACT)
		MONTHLY	SITE OWNER (MAINTENANCE CONTRACT)
		ANNUALLY	SITE OWNER (MAINTENANCE CONTRACT)
OCCASIONAL TANKS	CHECK TOPSOIL LEVELS ARE 20mm ABOVE EDGES OF BASKETS AND CHAMBERS TO AVOID MOWER DAMAGE	ANNUALLY (OR AS REQUIRED)	SITE OWNER (MAINTENANCE CONTRACT)
REMEDIAL WORK	REPAIR PHYSICAL DAMAGE IF NECESSARY	AS REQUIRED	SITE OWNER (MAINTENANCE CONTRACT)

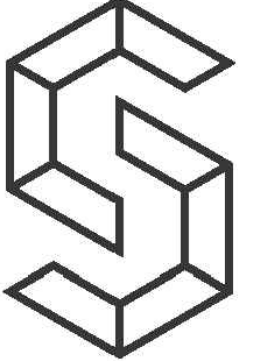

CREATIVE
STRUCTURES

Client

SOUTHERN ROCK PROPERTY

Project

RIVERSIDE

TWINEHAM, RH17 5NN

Title

TYPICAL DRAINAGE DETAILS

SHEET 2 of 2

ISSUED FOR PLANNING DOC

Date JULY 2023

Checked 25/07/2023

Sheet 23-040

Scale AS SHOWN AT A1

Engineer PW

Status PLANNING

Project Number 23-040

Drawing Number 51

Revision P6

REV

DESCRIPTION

DATE

BY

B1 DOC / BUILDING REGS 25.07.2023 PW

P6 CLIENT UPDATED ONLY 09.07.2024 PW

NOTES:-

1. THIS DRAWING IS NOT TO BE SCALED. WORK FROM GIVEN DIMENSIONS ONLY.

2. THIS DRAWING IS TO BE READ IN CONJUNCTION WITH ALL RELEVANT ARCHITECTS, SERVICE ENGINEERS AND SPECIALISTS DRAWINGS,

3. ANY DISCREPANCIES OR VARIATIONS ARE TO BE REPORTED IMMEDIATELY TO ENGINEER FOR CLARIFICATION BEFORE THE AFFECTED WORK COMMENCES.

4. ALL DIMENSIONS ARE TO BE CHECKED ON SITE, ANY DISCREPANCIES TO BE REPORTED TO ENGINEER IMMEDIATELY BEFORE THE AFFECTED WORK COMMENCES.

5. ALL PROPRIETARY PRODUCTS ARE TO BE USED IN ACCORDANCE WITH THE MANUFACTURERS DETAILS AND SPECIFICATIONS

6. THE CONTRACTOR IS TO ENSURE THAT TEMPORARY LOADS PLACED ONTO THE NEW STRUCTURES SHALL BE LESS THAN THE LOADS FOR WHICH IT HAS BEEN DESIGNED.

7. THE CONTRACTOR IS RESPONSIBLE FOR ALL TEMPORARY WORKS AND FOR THE STABILITY OF THE WORKS IN PROGRESS.

8. THESE DRAWINGS CONSTITUTE A FULL DESIGN FOR BUILDING CONTROL APPROVAL. THEY ARE NOT CONSTRUCTION STAGE DRAWINGS UNTIL BUILDING CONTROL HAVE APPROVED THE DESIGN(S)

9. FOR THE FULL COMPREHENSIVE GENERAL NOTES SEE GENERAL NOTES DRAWING 99.

WARNING IDENTIFICATION

⚠

PARTICULAR ATTENTION TO BE PAID WHERE THE HAZARD SYMBOL IS PLACED ON A DRAWING. THIS SYMBOL HIGHLIGHTS A PARTICULAR CONCERN IN RELATION TO THE DESIGN, SITE WORKING OR WHERE THE CONTRACTORS ATTENTION IS REQUIRED.

MEASURES TO MITIGATE RISK SHOULD BE CONSIDERED AT ALL STAGES OF DESIGN DEVELOPMENT AND CONSTRUCTION.

COORDINATION HIGHLIGHT

🔵

WHERE THE BLUE HIGHLIGHT SYMBOL IS PLACED ON A DRAWING PARTICULAR ATTENTION IS REQUIRED WITH REGARD TO COORDINATION.

STABILITY REQUIREMENT HIGHLIGHT

🟢

WHERE THE GREEN HIGHLIGHT SYMBOL IS PLACED ON A DRAWING THIS REFERS TO THIS ELEMENT OF THE DESIGN BEING CRITICAL TO THE STABILITY STRATEGY

© Copyright