


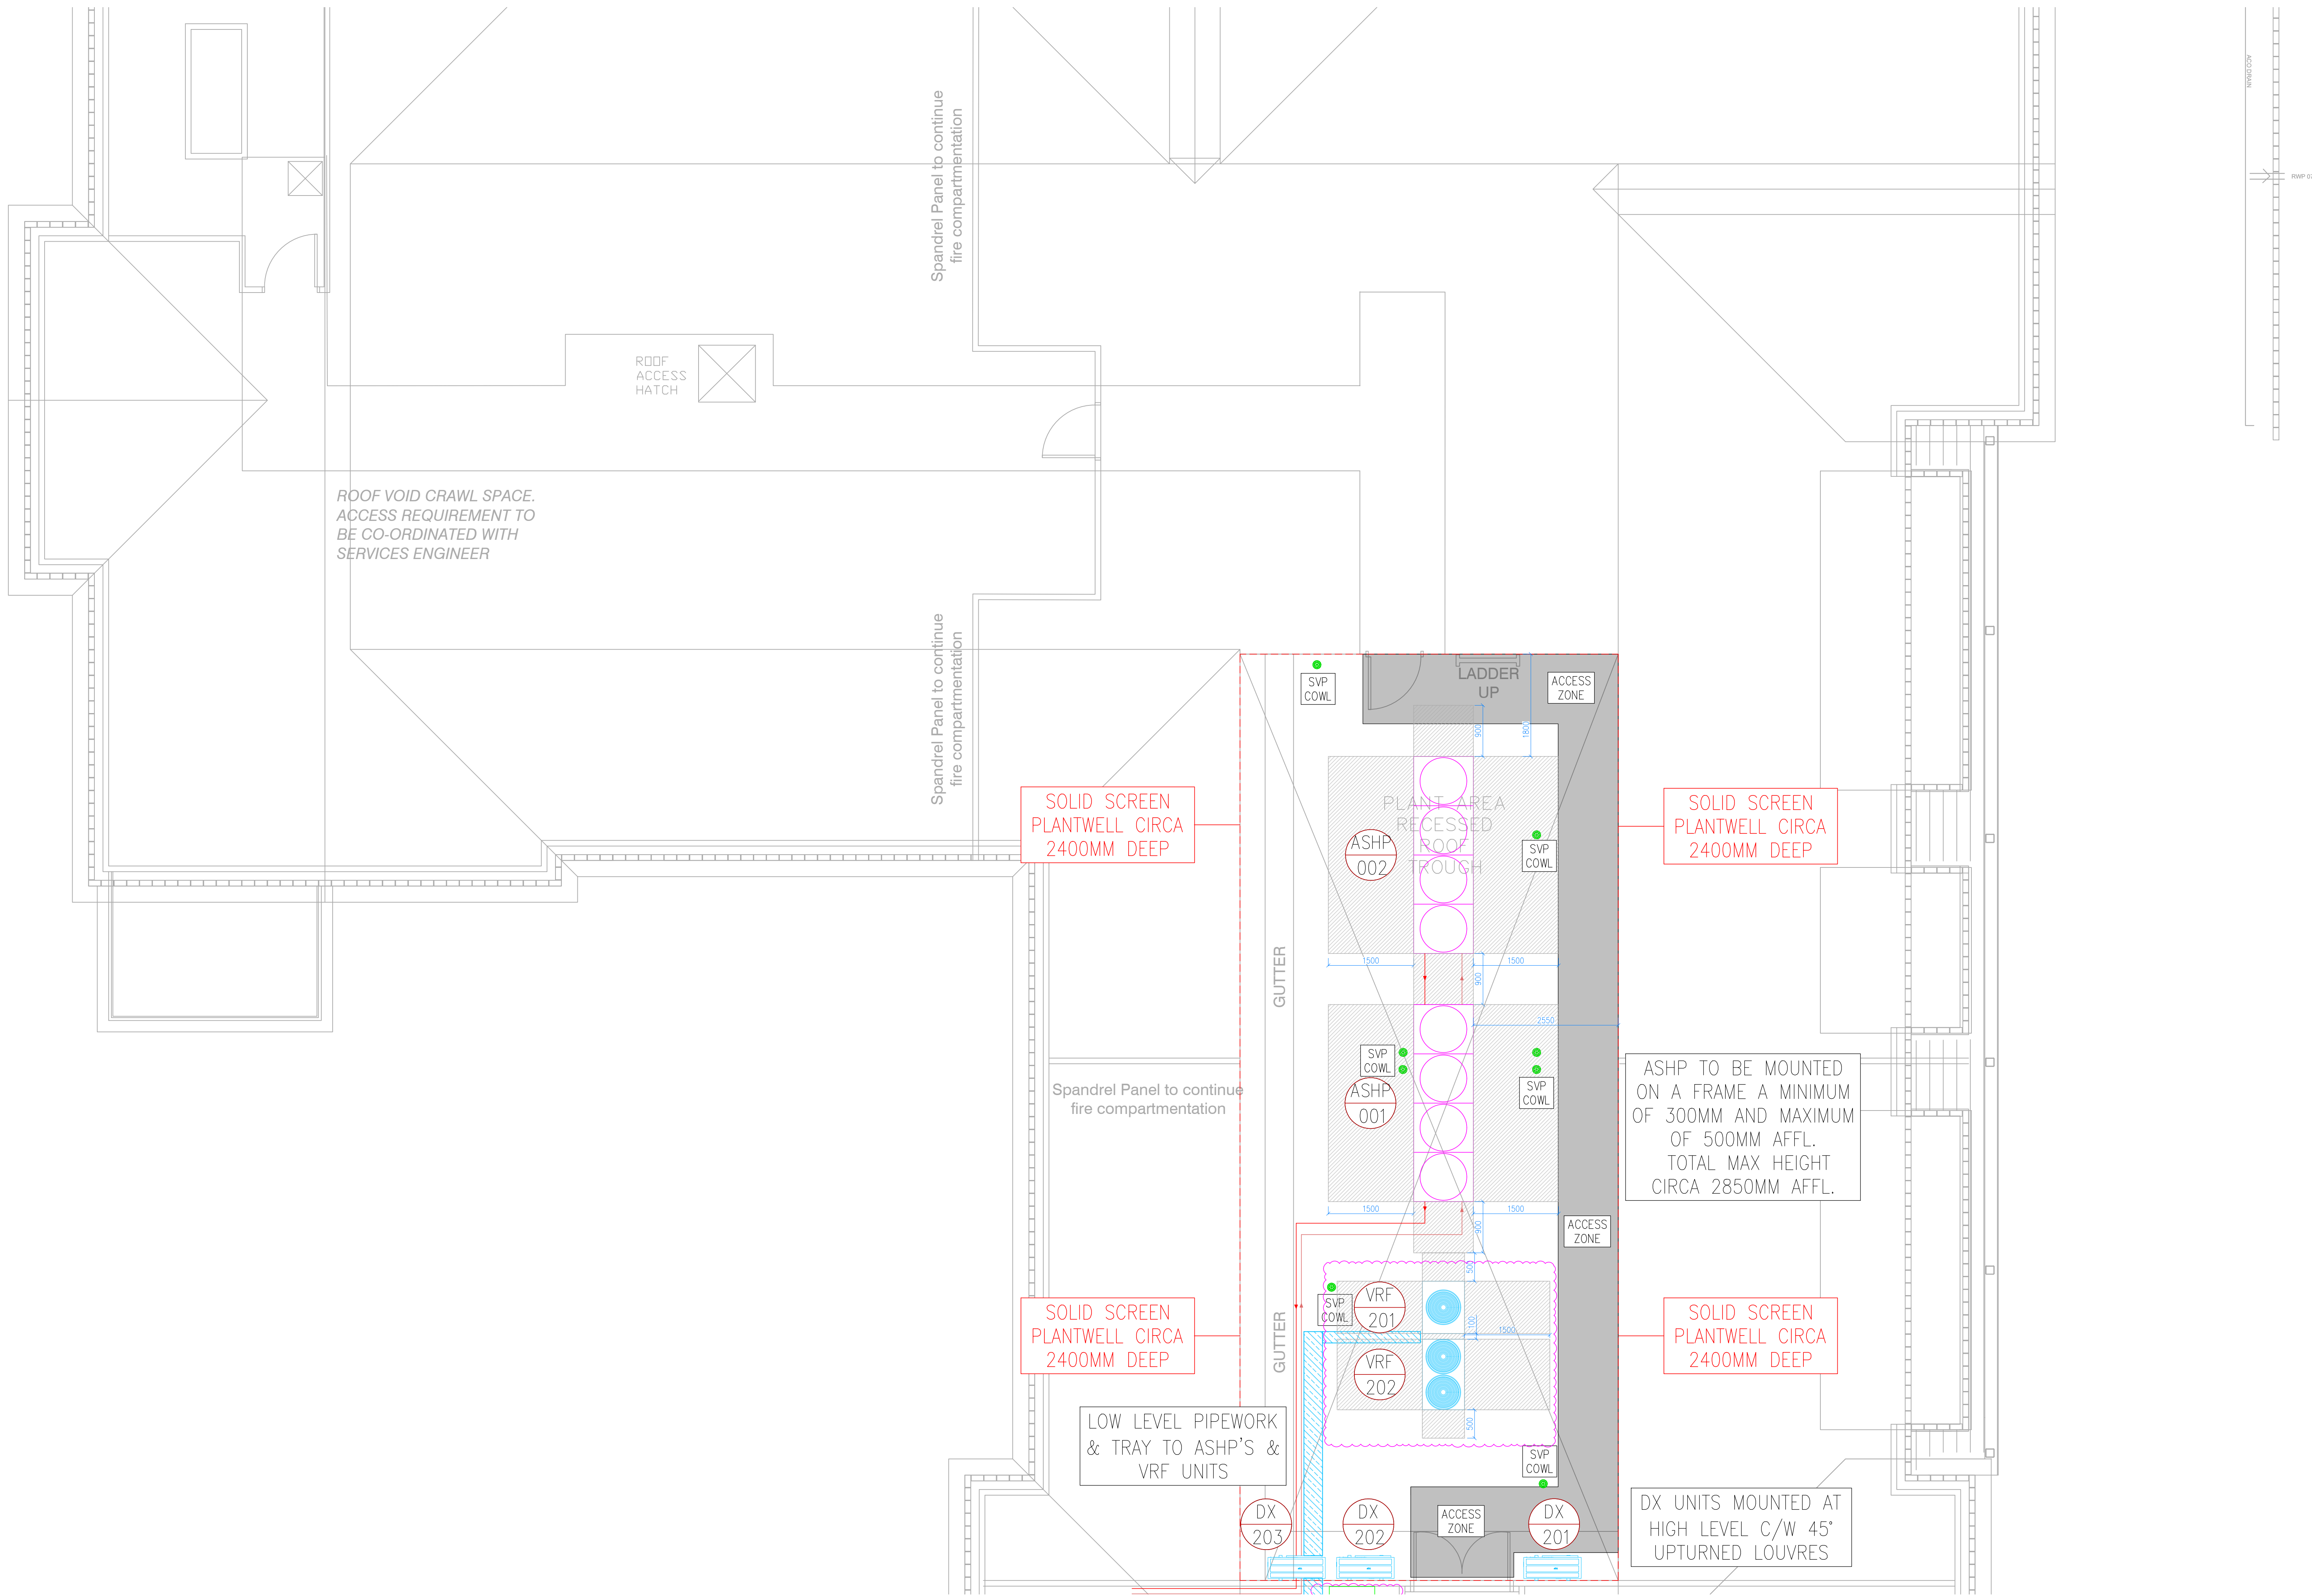

PLANT SCHEDULE						
REF	DESCRIPTION	MODEL NUMBER	DIMENSIONS (mm)	DRY WEIGHT (kg)	FULL WEIGHT (kg)	NOISE dBA
ASHP-001	HEATING AIR SOURCE HEAT PUMP	EAHV-M1500YCL(-N)	3280L x 1080W x 2350H	-	c. 1307kg	SEE DATA SHEET
ASHP-002	HEATING AIR SOURCE HEAT PUMP	EAHV-M1500YCL(-N)	3280L x 1080W x 2350H	-	c. 1307kg	SEE DATA SHEET
VRF-201	EXTERNAL CONDENSER	PURY-P300YWN-A2	740L X 920W X 1858H	-	c. 263kg	SEE DATA SHEET
VRF-202	EXTERNAL CONDENSER	PURY-P400YWN-A2	740L X 1240W X 1858H	-	c. 263kg	SEE DATA SHEET
DX-201	EXTERNAL CONDENSER	PUZ-ZM50YKA2	3000 X 809W X 630H	-	c. 46kg	SEE DATA SHEET
DX-202	EXTERNAL CONDENSER	PUZ-ZM200YKA2	3700 X 1050W X 1338H	-	c. 137kg	SEE DATA SHEET
DX-203	EXTERNAL CONDENSER	PUZ-ZM200YKA2	3700 X 1050W X 1338H	-	c. 137kg	SEE DATA SHEET

PLANT SELECTIONS ARE SHOWN INDICATIVELY AND ARE SUBJECT TO DETAILED DESIGN AND PROCUREMENT

- NOTES:
- THIS DRAWING SHALL BE READ IN CONJUNCTION WITH ANY RELEVANT STRUCTURAL, ARCHITECTURAL & CONSULTANTS DRAWINGS/SPECIFICATIONS.
 - THIS DRAWING IS NOT TO BE SCALED.
 - ALL DIMENSIONS STATED IN mm.
 - PIPEWORK SHALL BE INSTALLED IN ACCORDANCE WITH THE MEP SPECIFICATION – REFER TO TECHNICAL SUBMITTAL(S) FOR FURTHER DETAILS OF THE PROPOSED MATERIALS.
 - ALL HIGH POINTS TO BE FITTED WITH AIR VENTS.
 - ALL LOW POINTS TO BE FITTED WITH DRAIN COCKS.
 - INDIVIDUAL COMPONENTS & PIPEWORK NOT SHOWN FOR CLARITY. REFER TO THE HARNESS PLANT SCHEMATICS FOR FURTHER DETAILS.

C05	19.01.26	AMENDED AS CLOUDED	SG
C04	14.01.26	AMENDED AS CLOUDED FOLLOWING ASHP & VRF SPECIALIST REVIEW	SG
C03	12.12.25	DRAWING UPDATED AS CLOUDED	SG
C02	27.10.25	DRAWING UPDATED AS CLOUDED	SG
C01	10.10.25	DRAWING UPDATED AS CLOUDED & ISSUED FOR CONSTRUCTION	SG
P01	24.07.25	ISSUED FOR COMMENT	SG
REV	DATE	DETAILS OF REVISION	BY

HARNISS

1 Weekley Wood Avenue,
Kettering, Northants, NN14 1UQ
Tel: 01933 656850
Email: info@harniss.co.uk

CLIENT
HORIZON CONSTRUCTION GROUP
(BARCHESTER HEALTHCARE)

PROJECT
PROPOSED CARE HOME
TURNERS HILL ROAD
COPTHORNE, WEST SUSSEX

DRAWING TITLE
MEP SERVICES
SECOND FLOOR EXTERNAL
PLANTWELL LAYOUT

Issue Status			
Original Size		Scale	Drawn
A0		1:50	CP
HCL Project No.		Suitability	Checked
2537		-	SG
Project	Original	Issue	Rev
2537	HCL	ZZ	XX
DR - M - 5022			

DRAWING REF:	REV:	DATE:	DATE RECEIVED:	DATE UPDATED:
AL(1)102 - SF	C11	10.09.25	10.09.25	16.09.25