


LGH-160RVX3-E



FAN DATA SHEET



GRAPH

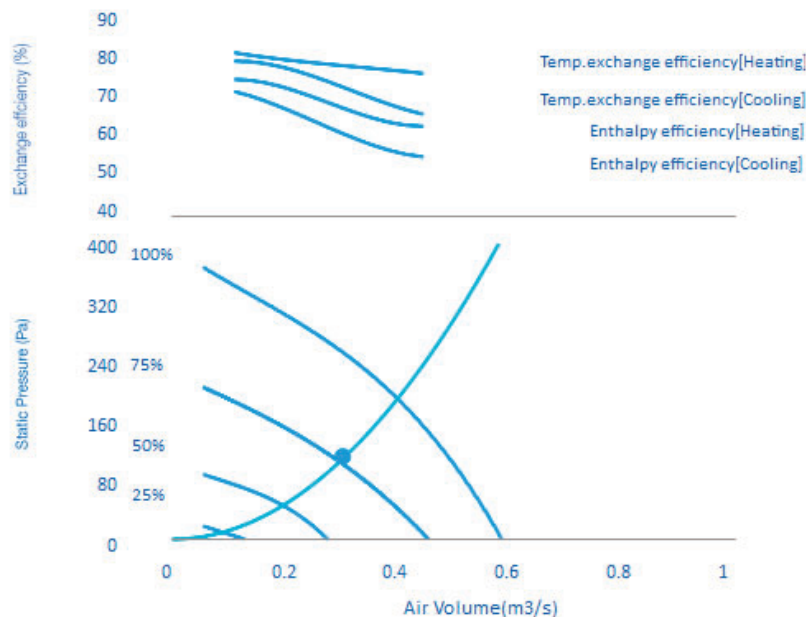

* Please refer to the specification sheet for the actual value.

Technical Data

Product Basic Information

Product Range	Energy Recovery
Impeller Type	Centrifugal
Casing Material	Galvanized steel sheet
Speed Control	100%/75%/50%/25%
Weight	96 kg
Electrical Supply	220-240V / 50Hz / Single-phase
Operating Conditions	0°C to 40°C, 80%RH or less

Actual Duty Specification

Requested Duty	0.307m ³ /s @ 112Pa
Actual Duty	0.3m ³ /s @ 112.3Pa
Tolerance	97.7%
Fan Speed Setting	75%
Power Input	308W
Specific Fan Power	1.03W/(l/s)
Sound Level - dB(A)	34dB@3m

The values obtained by the calculations in this application software are the values in the ideal state and are approximate values. It may differ from the actual value depending on the air volume, air condition, installation condition, etc.

ACOUSTIC INFORMATION

	125	250	500	1k	2k	4k	8k	Total LwA	dBA @3m
Inlet	(NA)	(NA)	(NA)	(NA)	(NA)	(NA)	(NA)	(NA)	(NA)
Outlet	(NA)	(NA)	(NA)	(NA)	(NA)	(NA)	(NA)	(NA)	(NA)
Breakout	66	59	50	44	38	33	28	55	34

-Sound power level were calculated based on laboratory measurement result.

-The measurement and the calculation were based on ISO 3744:2010.


-If the sound power level is below 15dB, it is showed "<15" in the chart.

-If you need induct acoustic information as reference data, please contact us.




SUPPLY AIR COMPARISON

(In Summer)

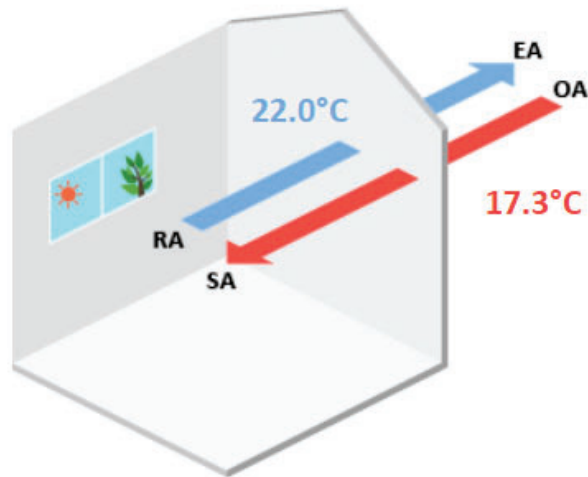

Conventional Ventilation Unit

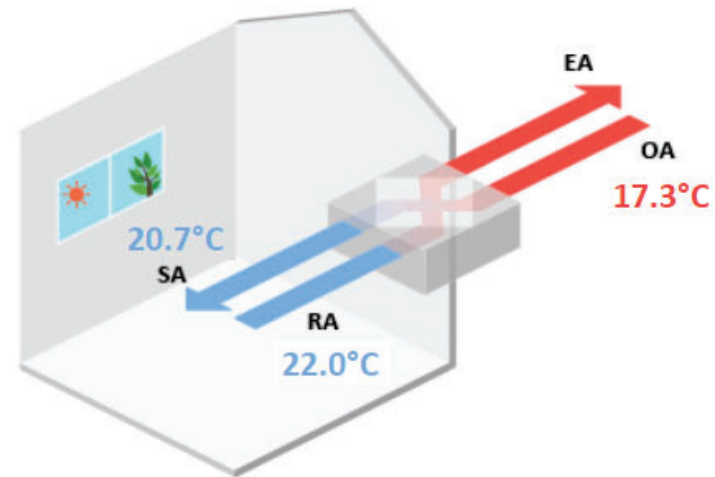

Lossnay Unit


	OA	SA	RA
Dry bulb temperature (°C)	17.3	20.7	22.0
Relative humidity (%)	70.0	54.0	50.0
Absolute humidity (g/kg(DA))	8.6	8.2	8.2
Enthalpy (kJ/kg(DA))	39.2	41.5	43.0

* The exchange efficiency is based on the specification sheet.

* The value is only for reference.



SUPPLY AIR COMPARISON (In Summer)

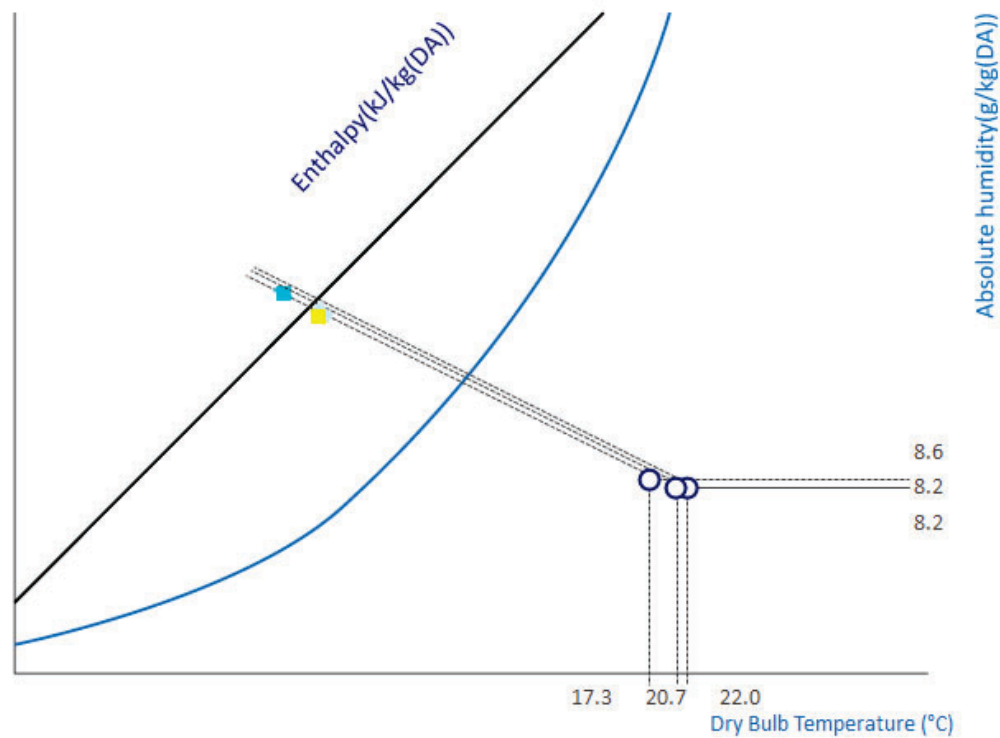

SA in Summer

- Air Conditioning Load with Conventional Ventilation Unit
- Air Conditioning Load with Lossnay Unit
- Saved Load by Lossnay Unit


	OA	SA	RA
Dry Bulb Temperature (°C)	17.3	20.7	22.0
Relative humidity (%)	70.0	54.0	50.0
Absolute humidity (g/kg(DA))	8.6	8.2	8.2
Enthalpy (kJ/kg(DA))	39.2	41.5	43.0

- * The exchange efficiency is based on the specification sheet.
- * The value is only for reference.




SUPPLY AIR COMPARISON

(In Winter)

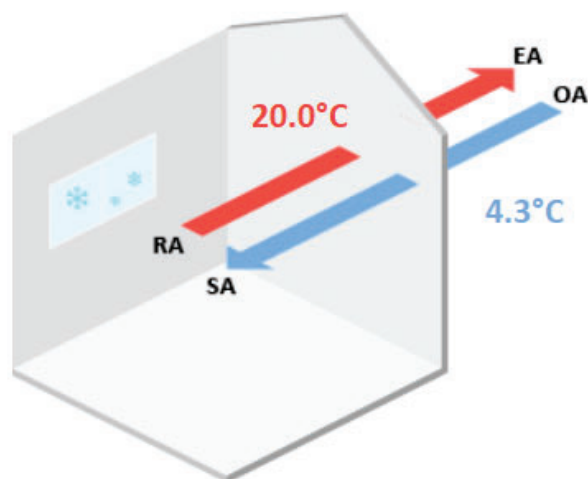

Conventional Ventilation Unit

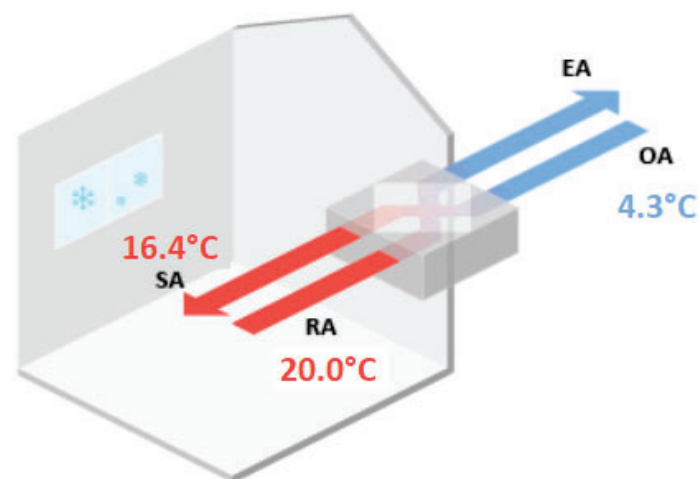

Lossnay Unit

	OA	SA	RA
Dry bulb temperature (°C)	4.3	16.4	20.0
Relative humidity (%)	85.0	49.0	50.0
Absolute humidity (g/kg(DA))	4.4	5.6	7.3
Enthalpy (kJ/kg(DA))	15.3	30.7	38.5


* The exchange efficiency is based on the specification sheet.

* The value is only for reference.



SUPPLY AIR COMPARISON

(In Winter)

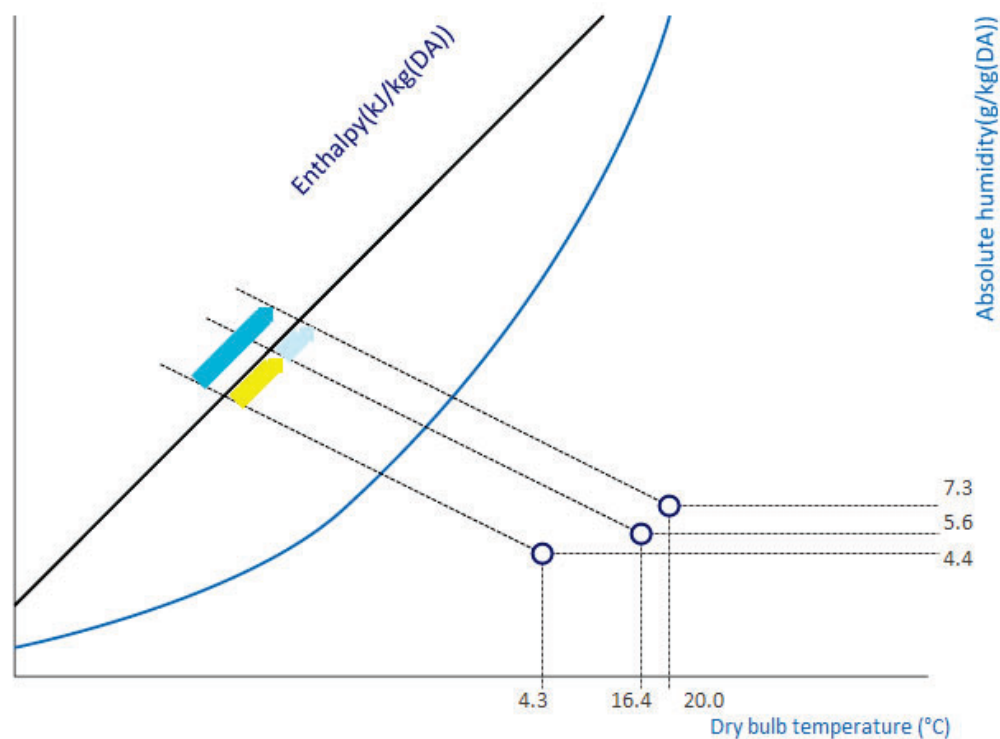

SA in Winter

- Air Conditioning Load with Conventional Ventilation Unit
- Air Conditioning Load with Lossnay Unit
- Saved Load by Lossnay Unit

	OA	SA	RA
Dry bulb temperature (°C)	4.3	16.4	20.0
Relative humidity (%)	85.0	49.0	50.0
Absolute humidity (g/kg(DA))	4.4	5.6	7.3
Enthalpy (kJ/kg(DA))	15.3	30.7	38.5

* The exchange efficiency is based on the specification sheet.

* The value is only for reference.