


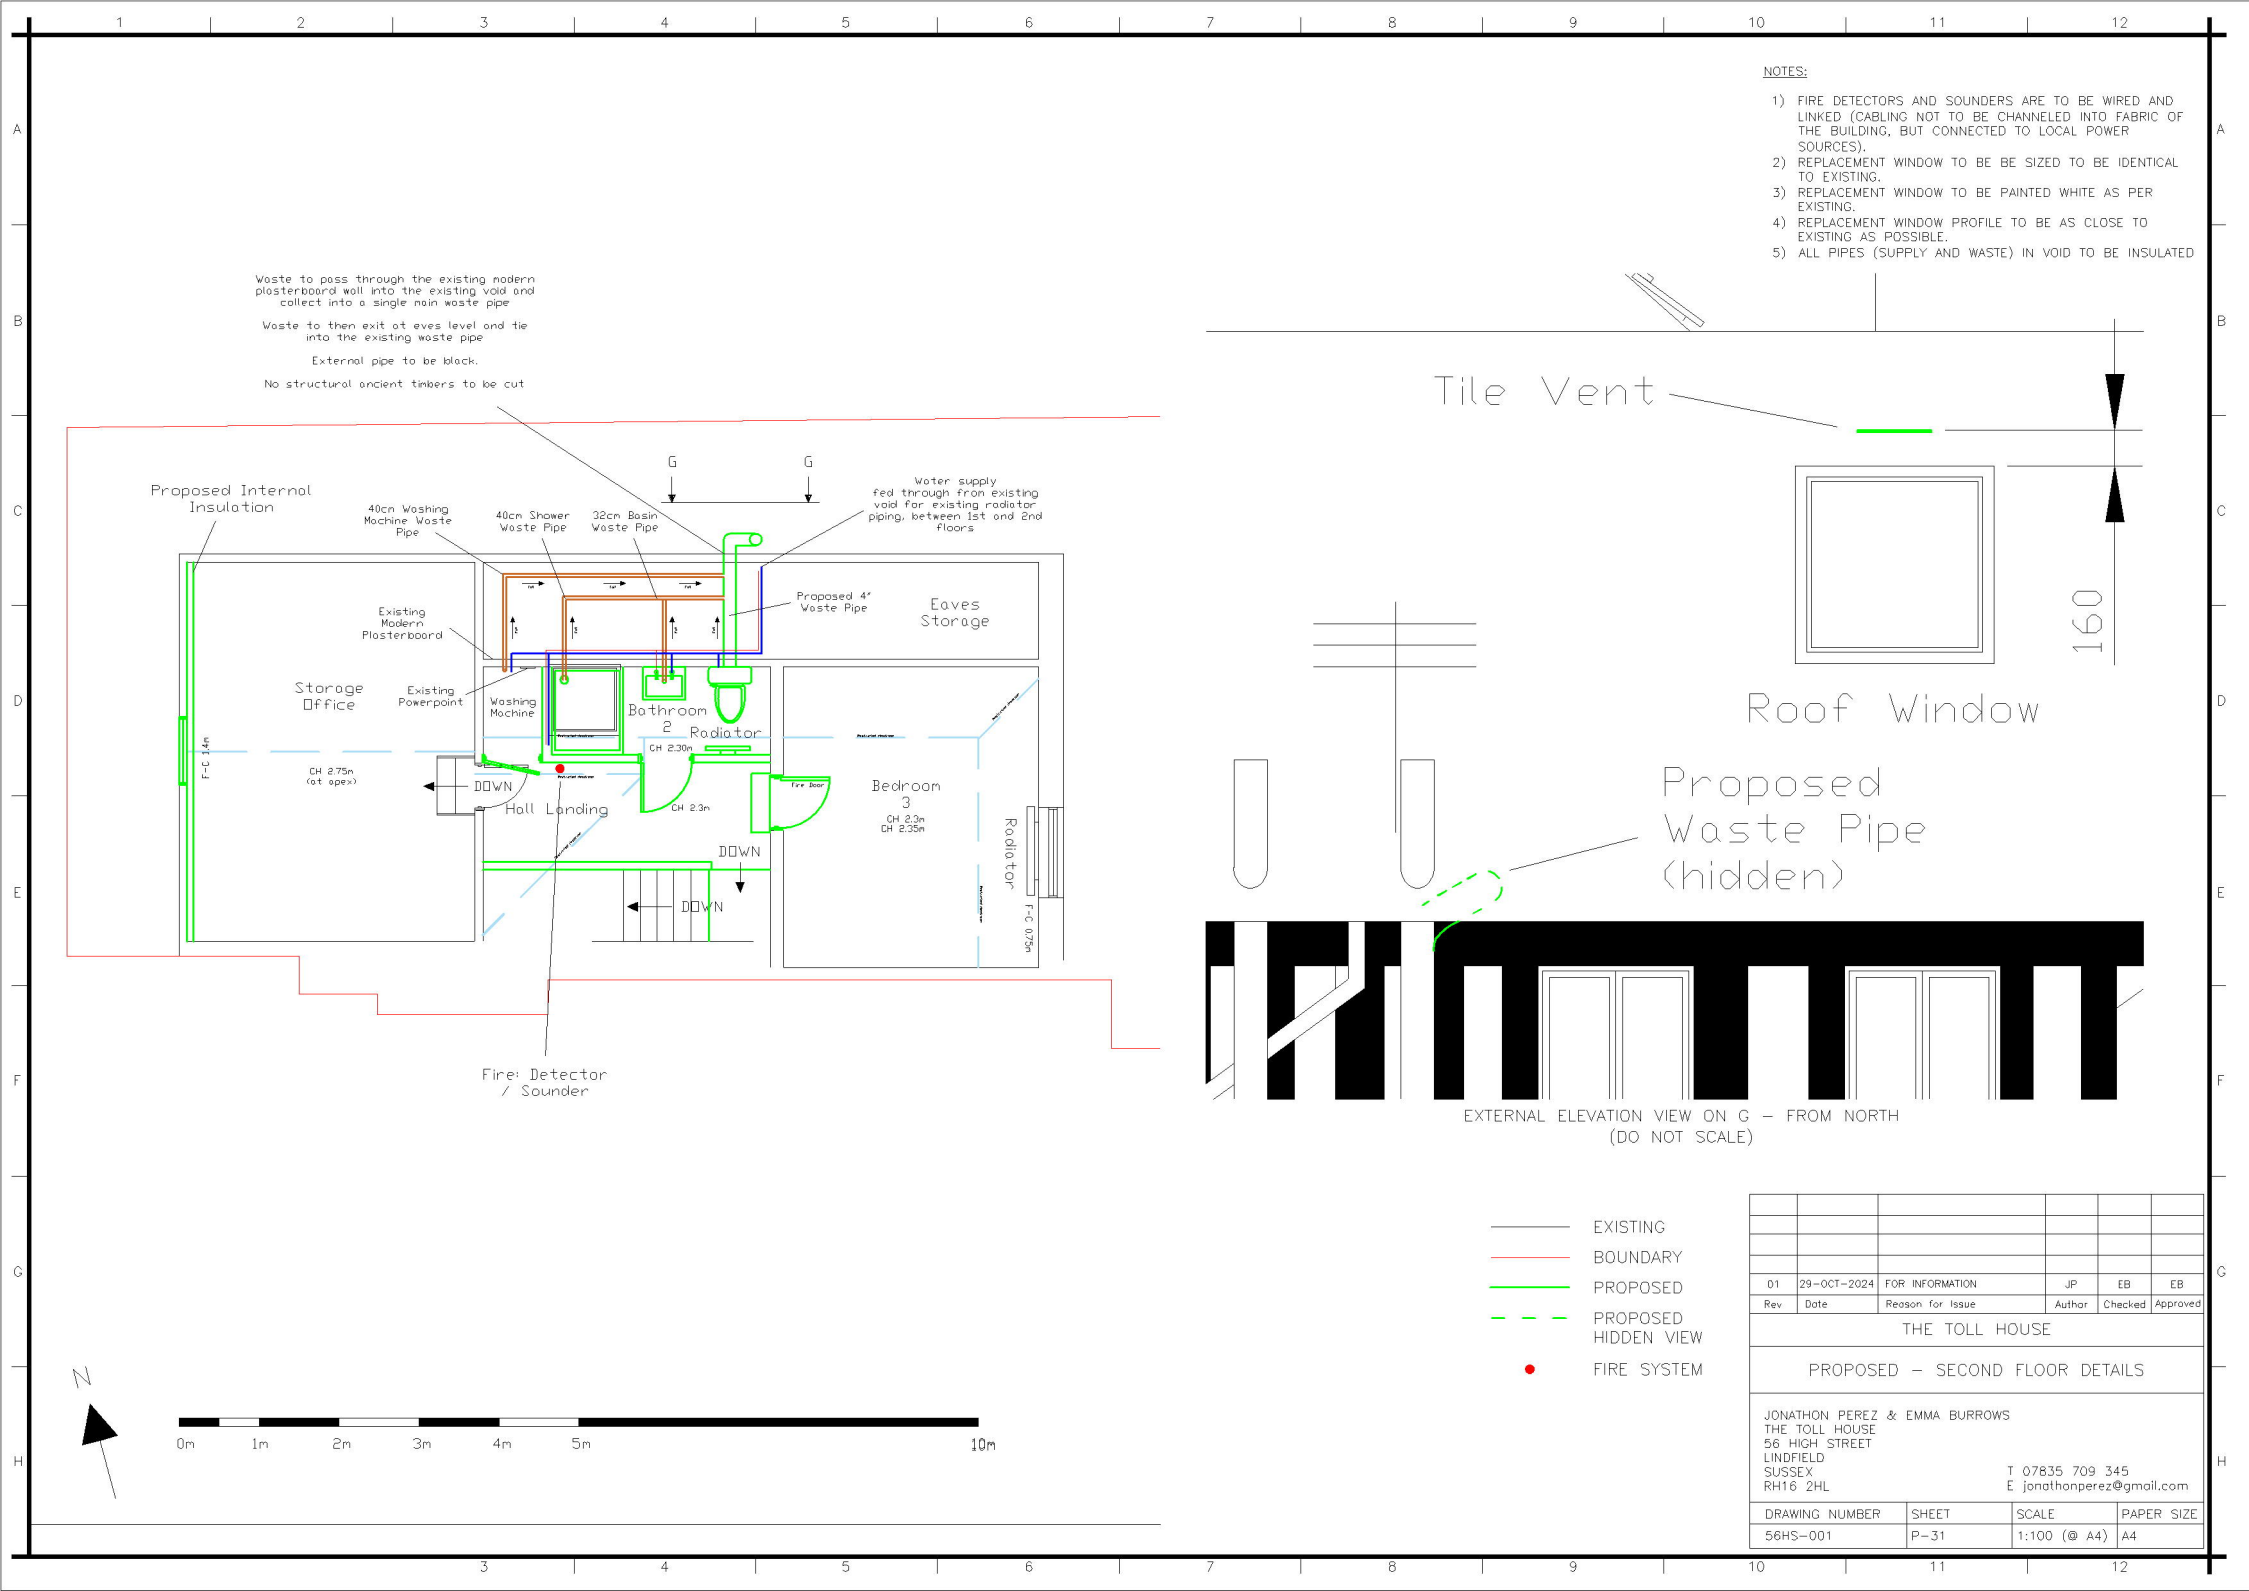

NOTES:

- 1) FIRE DETECTORS AND SOUNDERS ARE TO BE WIRED AND LINKED (CABLING NOT TO BE CHANNLED INTO FABRIC OF THE BUILDING, BUT CONNECTED TO LOCAL POWER SOURCES).
- 2) REPLACEMENT WINDOW TO BE BE SIZED TO BE IDENTICAL TO EXISTING.
- 3) REPLACEMENT WINDOW TO BE PAINTED WHITE AS PER EXISTING.
- 4) REPLACEMENT WINDOW PROFILE TO BE AS CLOSE TO EXISTING AS POSSIBLE.
- 5) ALL PIPES (SUPPLY AND WASTE) IN VOID TO BE INSULATED