


NOTES: UNLESS SPECIFIED OTHERWISE

1. ALL DIMENSIONS IN MM.
2. FOUNDATION DESIGN BY OTHERS.
3. THE LEGS / PADS NEED TO BE INSTALLED WITH THE TOPS LEVEL $\pm 5\text{mm}$. THE LEGS ALSO NEED TO BE INSTALLED IN LINE $\pm 5\text{mm}$ AND SQUARE. IF THE LEGS ARE NOT INSTALLED WITHIN TOLERANCE THEN THE STRUCTURE ABOVE WILL NOT FIT TOGETHER.
4. THE FOUNDATIONS NEED TO BEAR ON A GOOD NATURAL FORMATION WITH A MINIMUM GROUND BEARING PRESSURE OF 40 kN/m^2 . THIS WILL NEED TO BE CHECKED ON SITE BEFORE CASTING THE FOUNDATIONS. A MINIMUM DEPTH OF 0.9m TO THE UNDERSIDE OF THE FOUNDATIONS IS RECOMMENDED, WITH ALL TOP SOIL AND FILL MATERIAL BEING REMOVED TO REACH A GOOD NATURAL FORMATION LEVEL. THE FOUNDATIONS SHOULD BE TAKEN TO DEEPER THAN 0.9m IF REQUIRED TO ACHIEVE THIS.
5. CONCRETE SHOULD BE MINIMUM GRADE C20 ONE LAYER OF A393 REINFORCING MESH TO THE TOP SURFACE (50mm COVER TO MESH.)


TOLERANCES UNLESS OTHERWISE SPECIFIED.

DIMENSION:-	<10	<100	<250	>250	DEG
$\pm$	0.5	1	2	3	0.5

SECTION A-A (1:25)

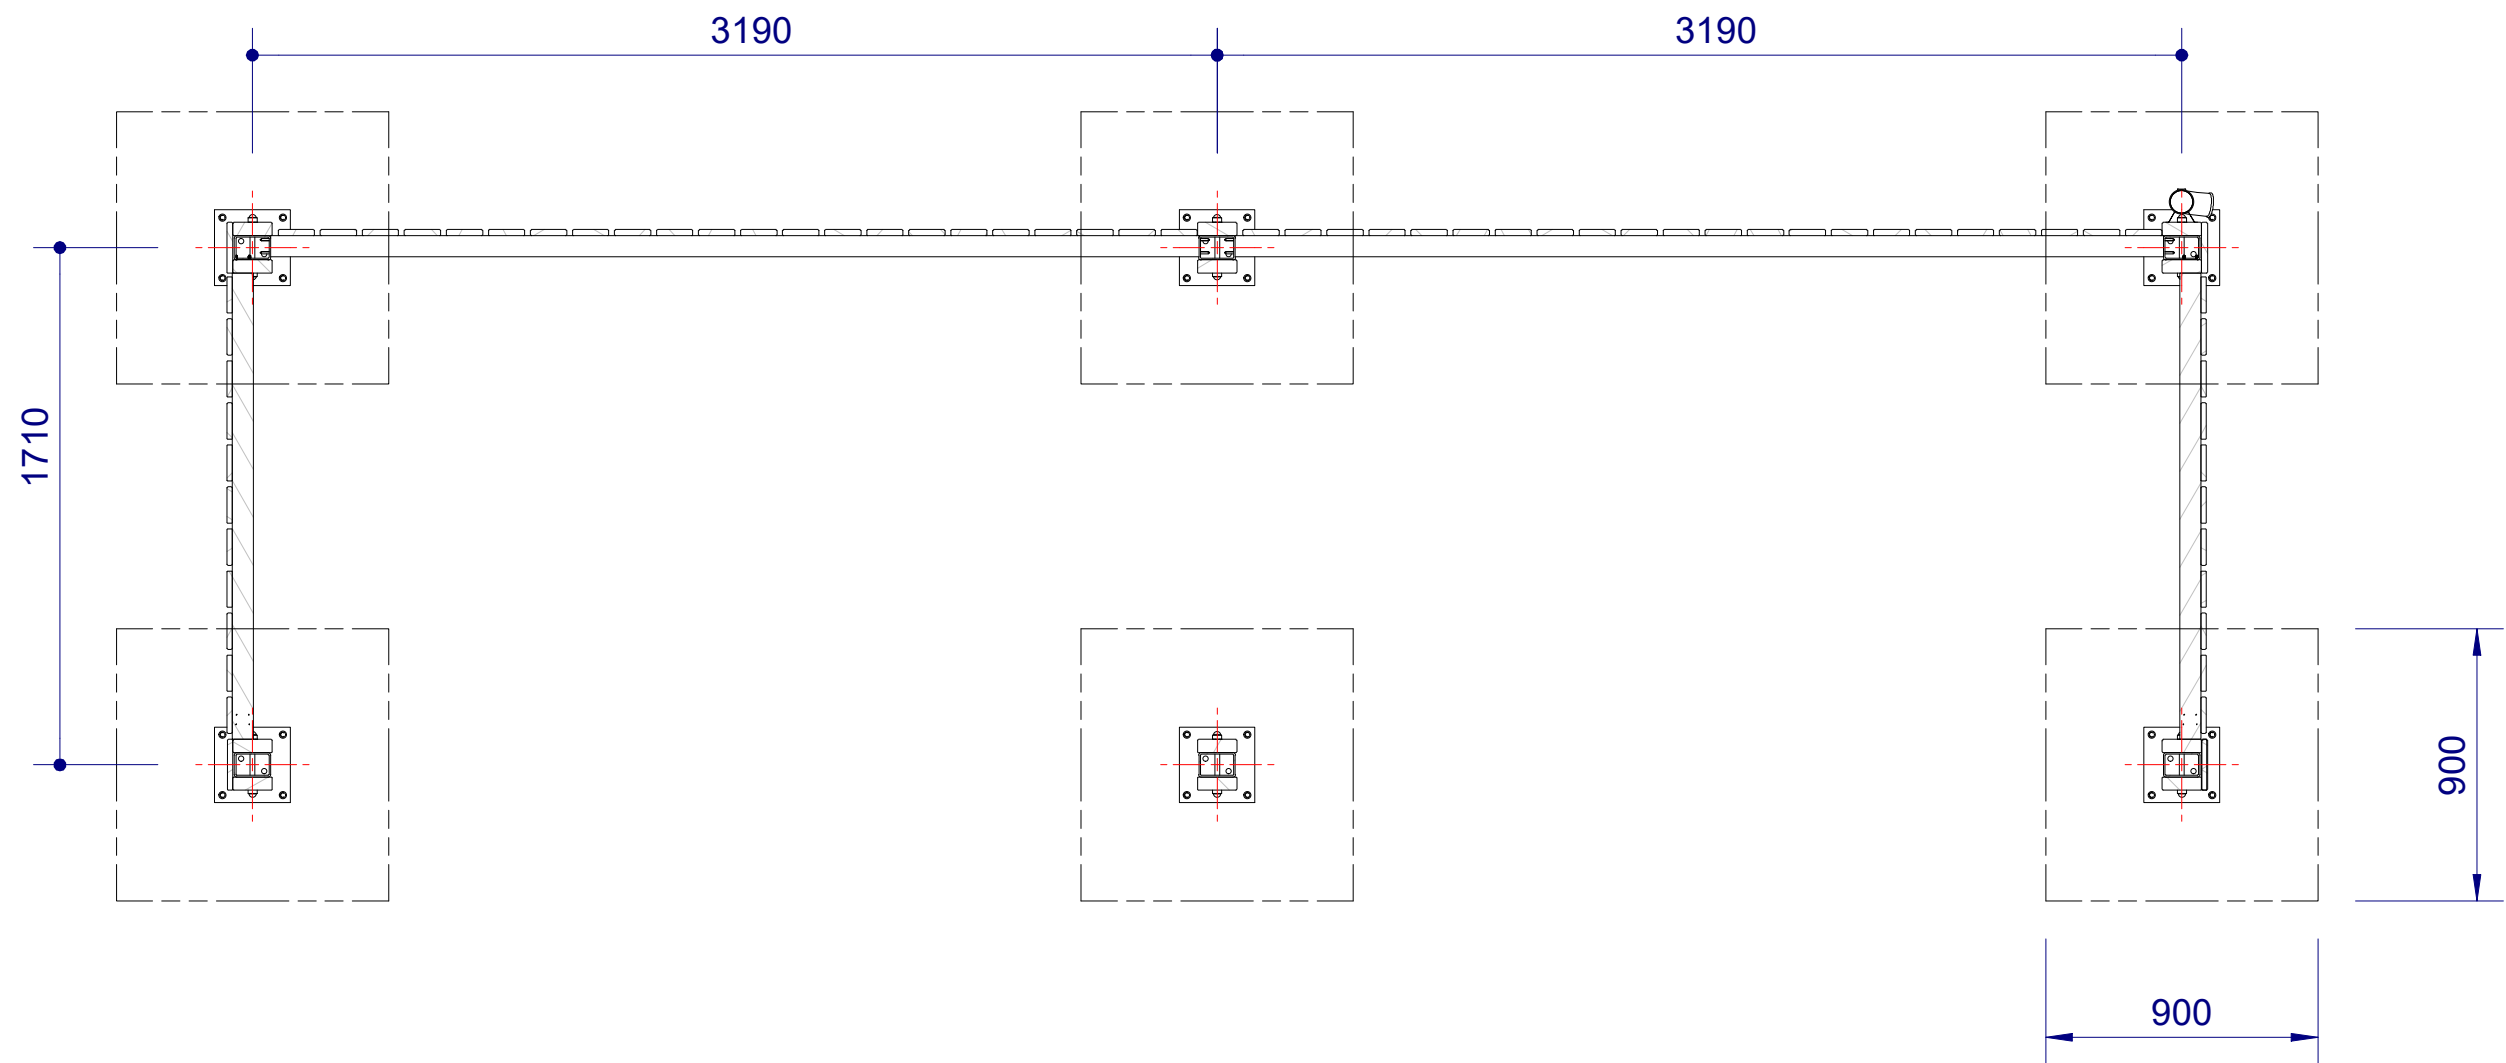

Front Elevation (1:25)

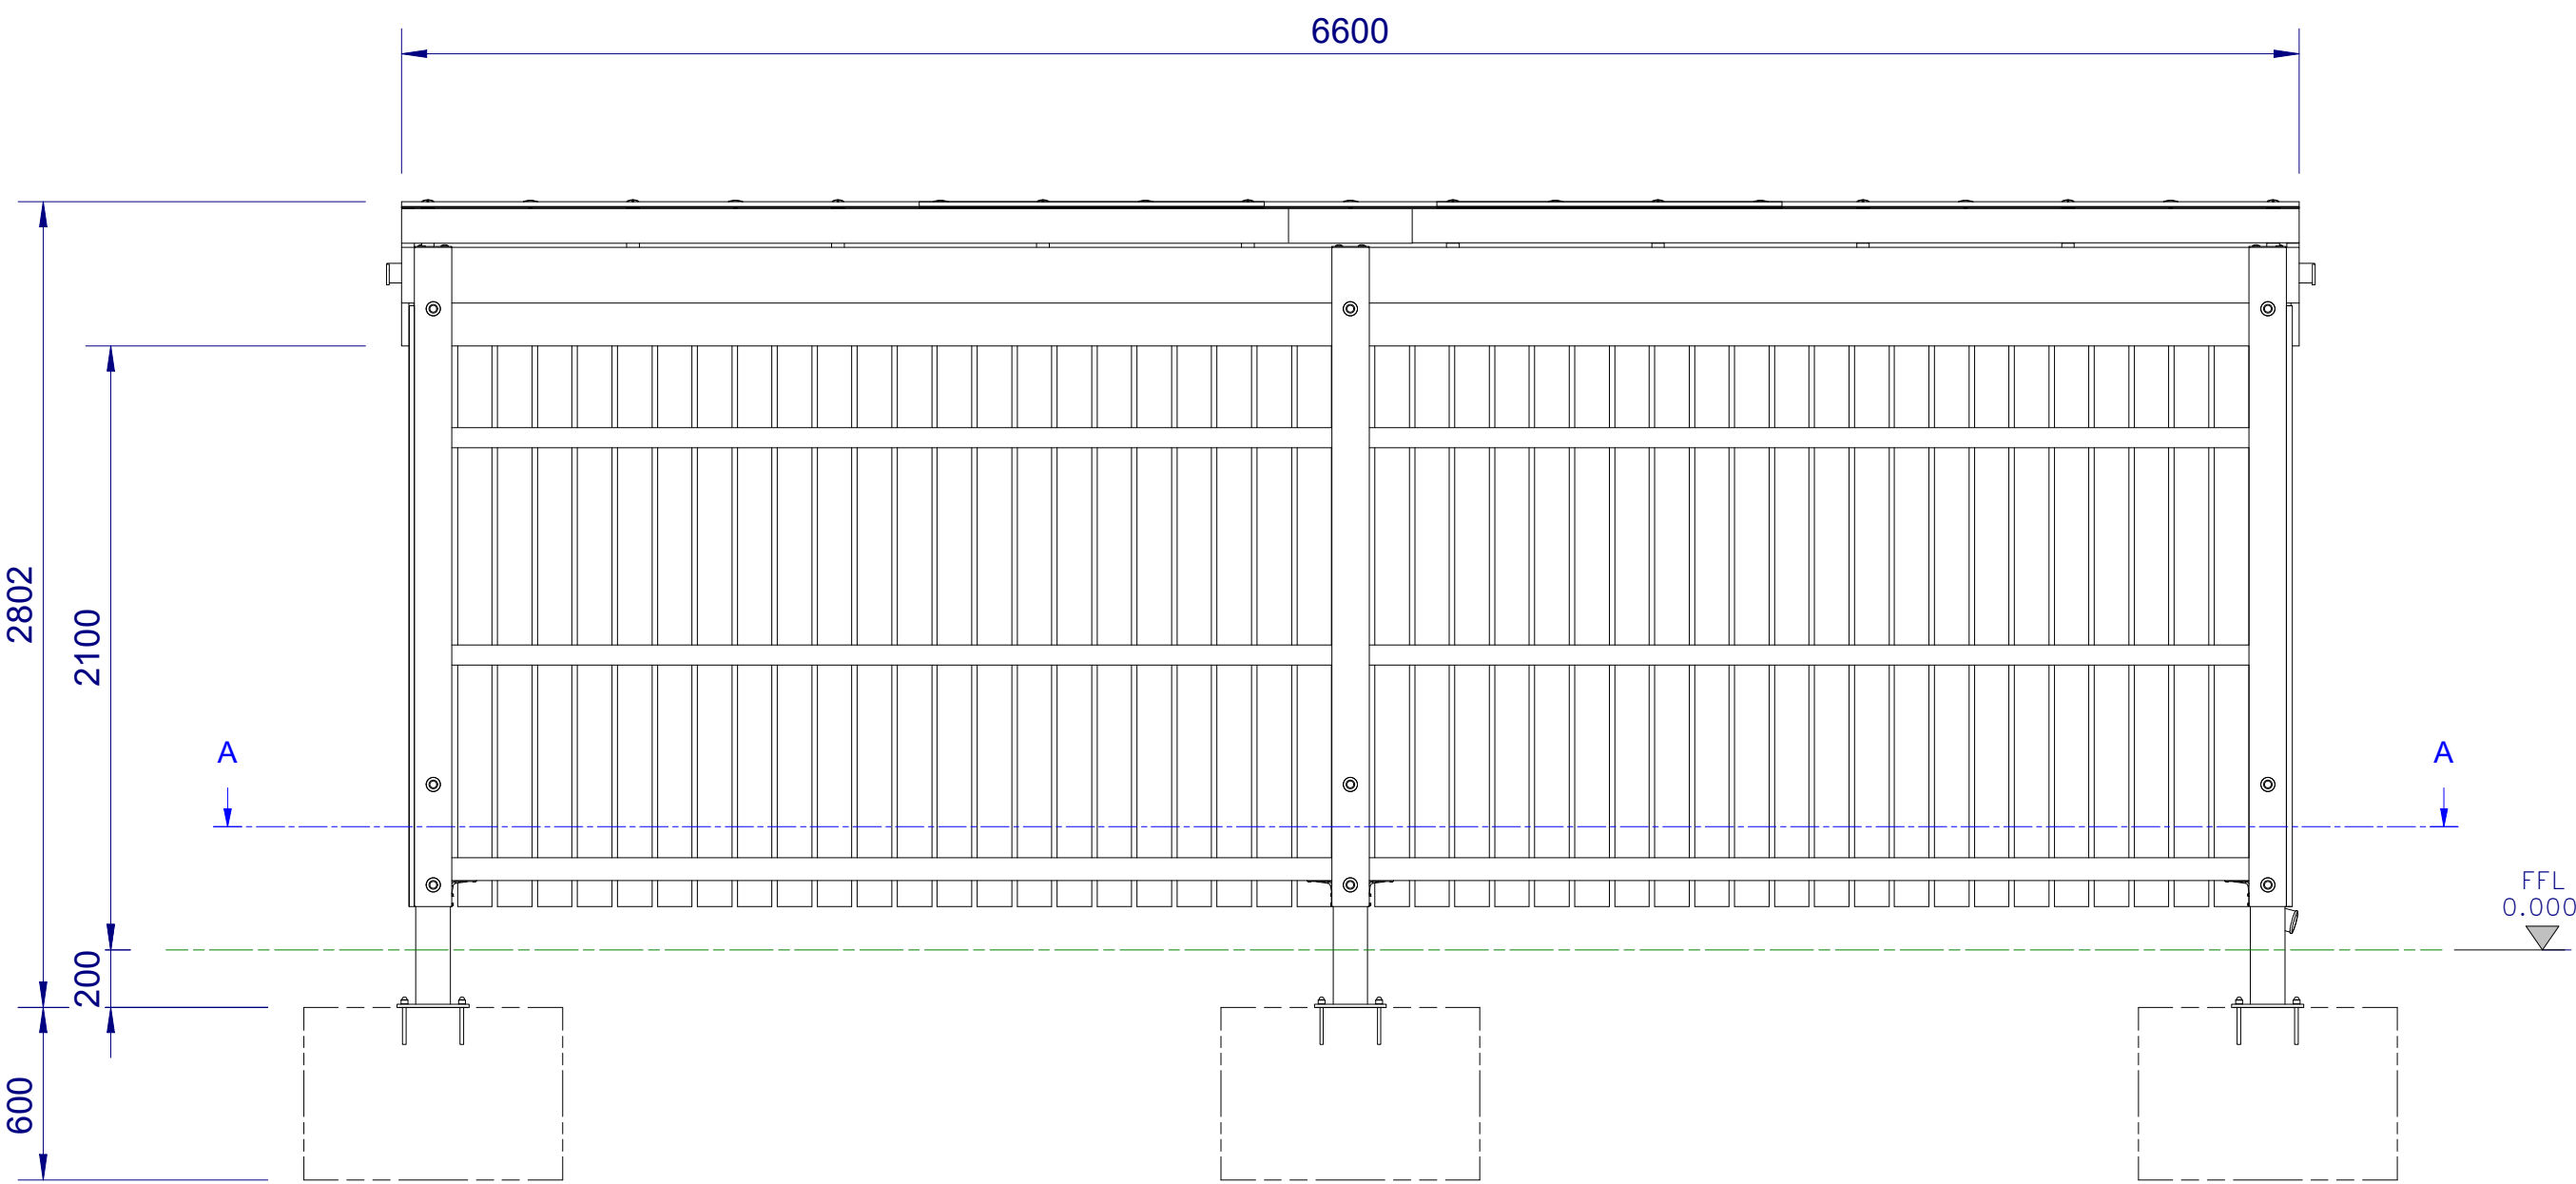

2	14/03/2025	Revised following comments	Andy Clegg	
1	19/02/2025	INITIAL ISSUE	Herbie Hodson	
REV	DATE	DESCRIPTION	DRAWN BY	CHECKED BY

REVISION HISTORY

--	--