




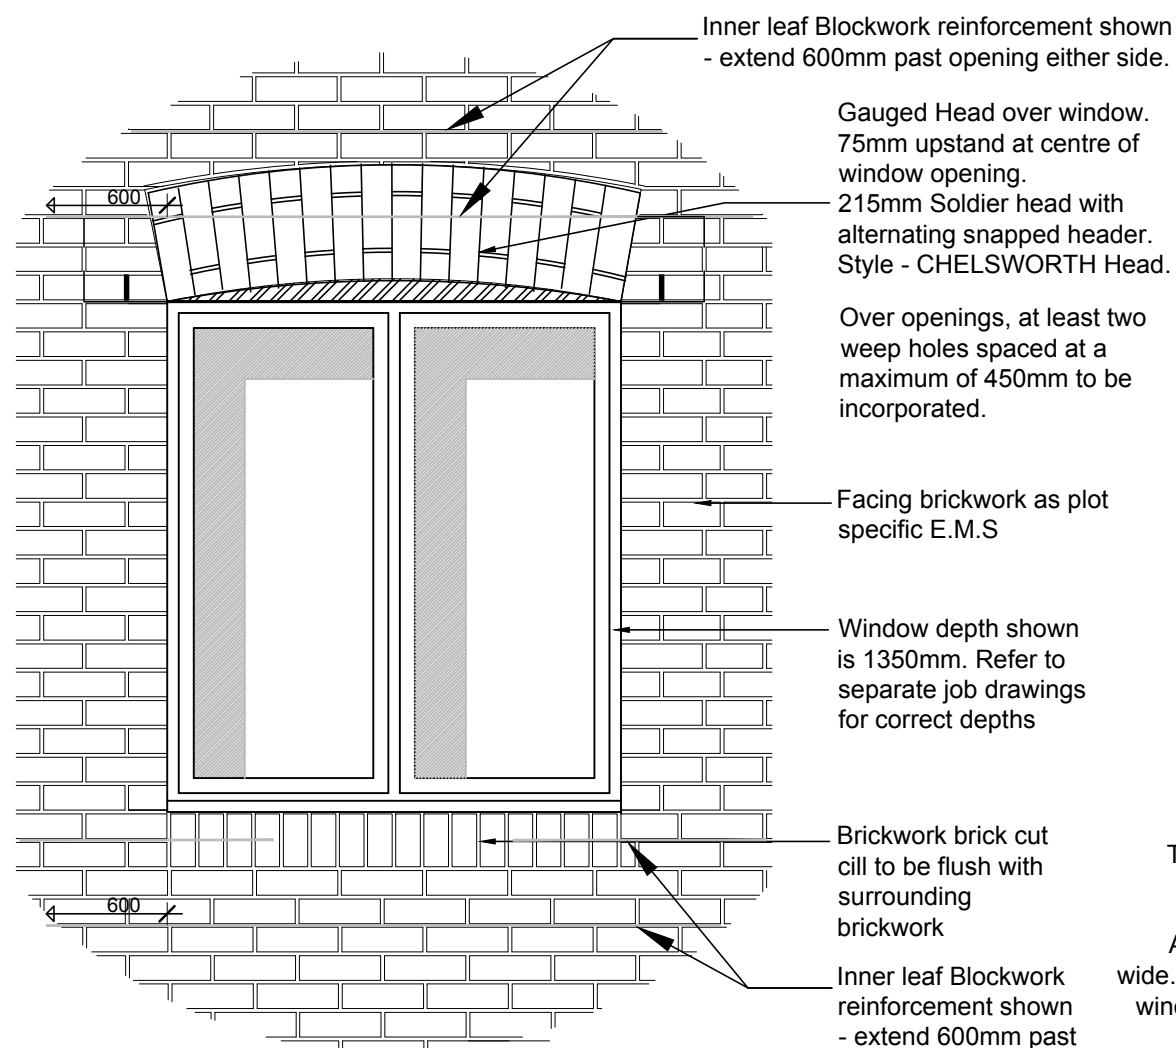


Elevation
(scale 1:20)

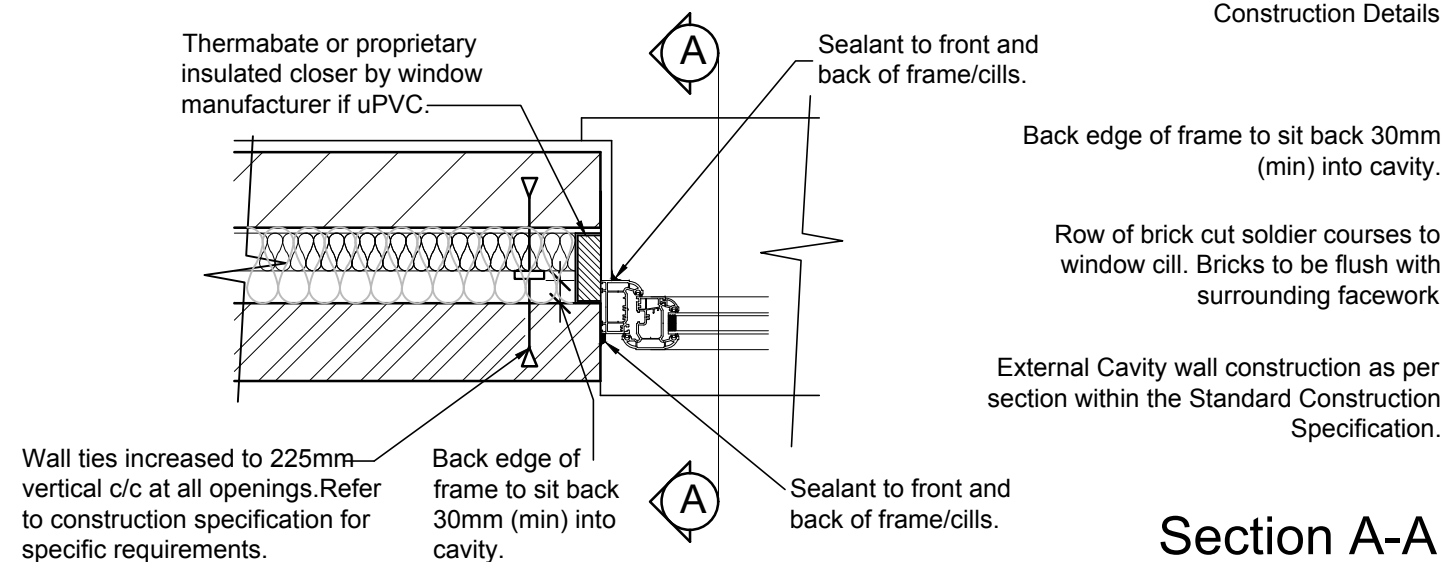

Plan
(scale 1:10)

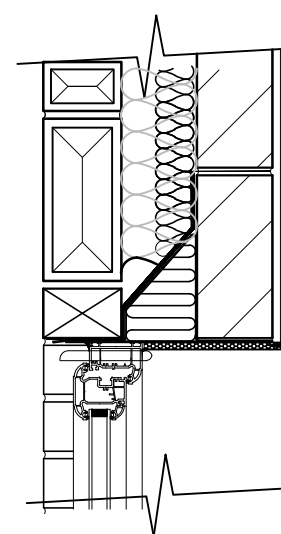

Alternative Lintel with Solid Base Plate
(scale 1:10)

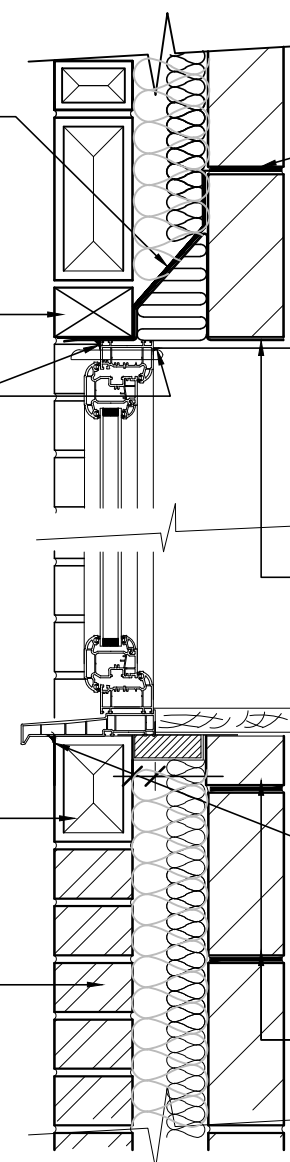

Section A-A
(scale 1:10)

**PARTIAL AND FULL FILL INSULATION
OPTIONS SHOWN.
REFER TO JOB SPECIFIC SAP
CALCULATIONS FOR SPECIFICATION.**

22mm Gyproc Thermaline
Basic insulated
plasterboard to soffit area

Cavity trays should be provided at all interruptions to the cavity unless otherwise protected eg by overhanging eaves.

To be installed in accordance with the NHBC specification, section 6.1; External Masonry Walls.

Masonry Joint reinforcement in cs above head as specified by Engineers -minimum in 2 course above - extend 600mm past opening.

Continuous ribbon of adhesive to top and bottom of wall, around all openings and at internal/external corners. Over openings, at least two weep holes spaced at a maximum of 450mm to be incorporated.

Lintel to Engineers recommendations

Sealant to front and back of frame/cills

Masonry Joint reinforcement in cs below cills as specified by Engineers -minimum in 2 course above - extend 600mm past opening.

Notes

All dimensions to be checked on site prior to the commencement of construction and any discrepancy should be reported to the Site Manager.

This drawing may not be reproduced in any part or form without written consent.

All copyrights reserved.

Sub-Contractors MUST ensure that they have the latest issue drawing before they commence work on site.

A	Sept 2015	Insulation Updated	HR
Rev	Date	Description	Init.



Job title

Standard Details

Drawing title

Gauged Head Detail

Scale	Drawn
1:10/1:20 @ A3	SJR
Dwg No.	Date
SD/3042	Jul. 2014
	Rev.
	A