



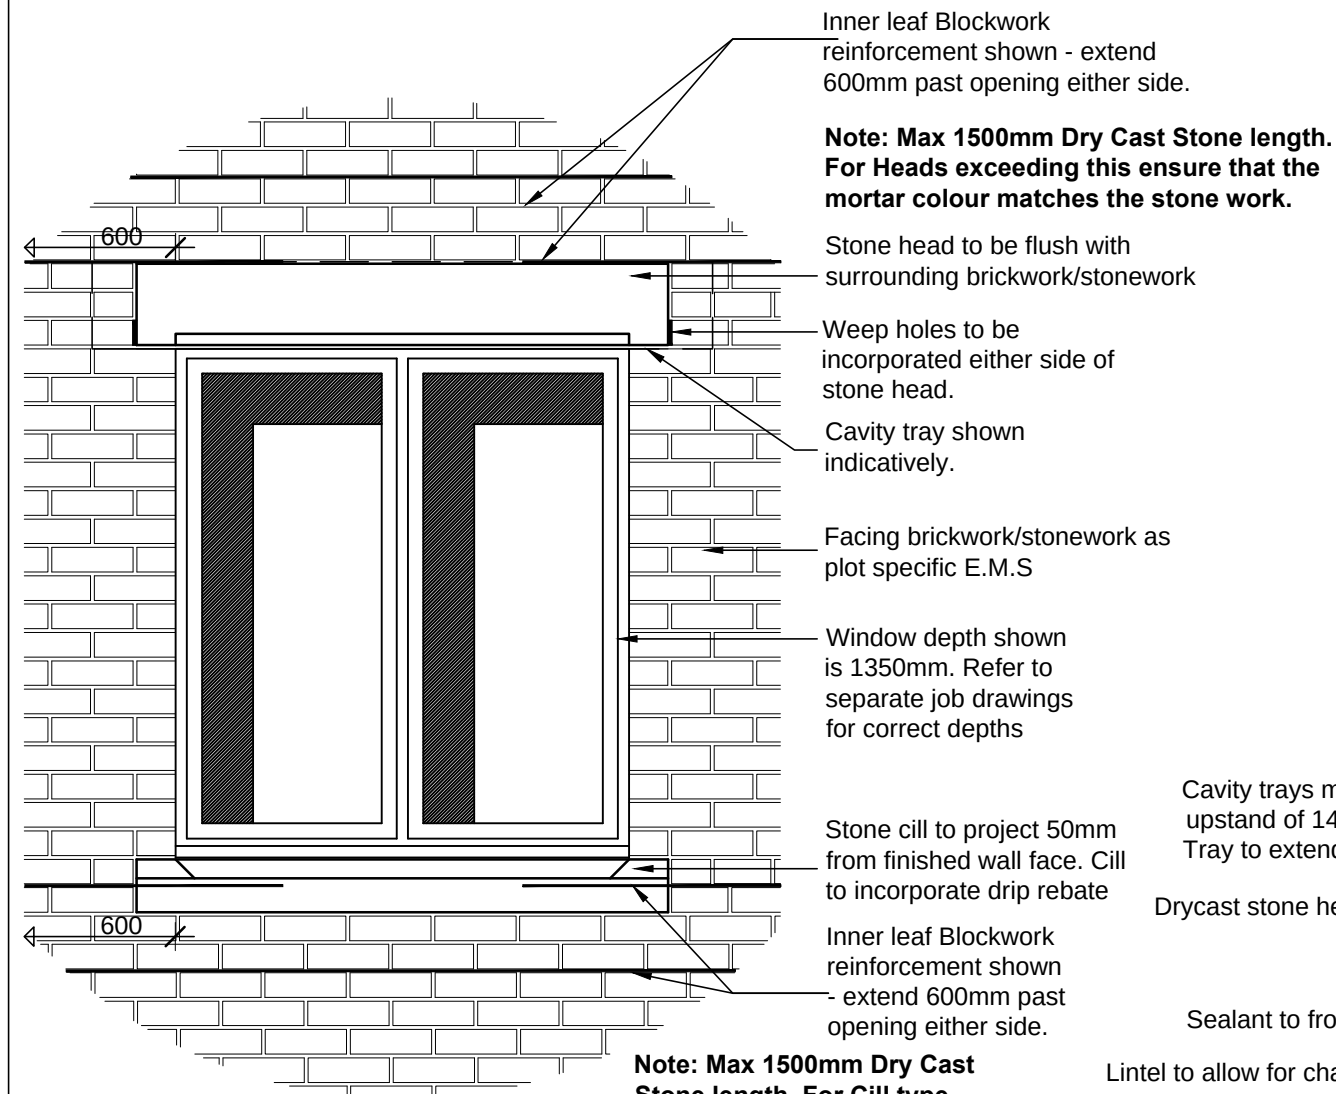

Elevation
(scale 1:20)

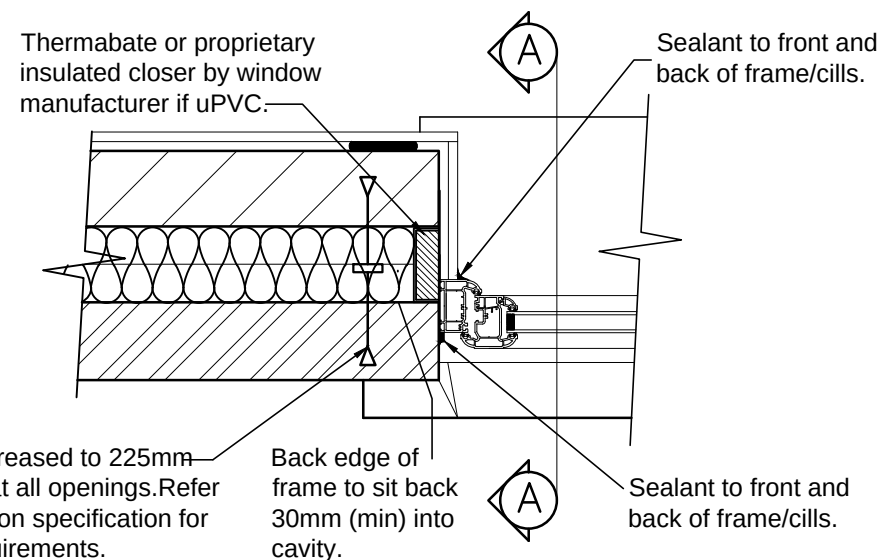

Plan
(scale 1:10)

**ALL STONEMWORK ELEMENTS
MUST BE PROTECTED DURING
THE CONSTRUCTION PHASE**

Cavity trays must have a minimum upstand of 140mm and stop ends. Tray to extend a min. 150mm past lintel.

Drycast stone head. Stone colour as specified on E.M.S

Sealant to front and back of frame

Lintel to allow for chamfer on stone head.

Openings to be sealed in accordance with Robust Details and the Accredited Construction Details


Back edge of frame to sit back 30mm (min) into cavity.

Drycast stone cill block. Stone colour as specified on E.M.S

DPC to be incorporated to underside & rear of cill as indicated (5mm projection to U/S)

External Cavity wall construction as per section within the Standard Construction Specification.

Section A-A
(scale 1:10)

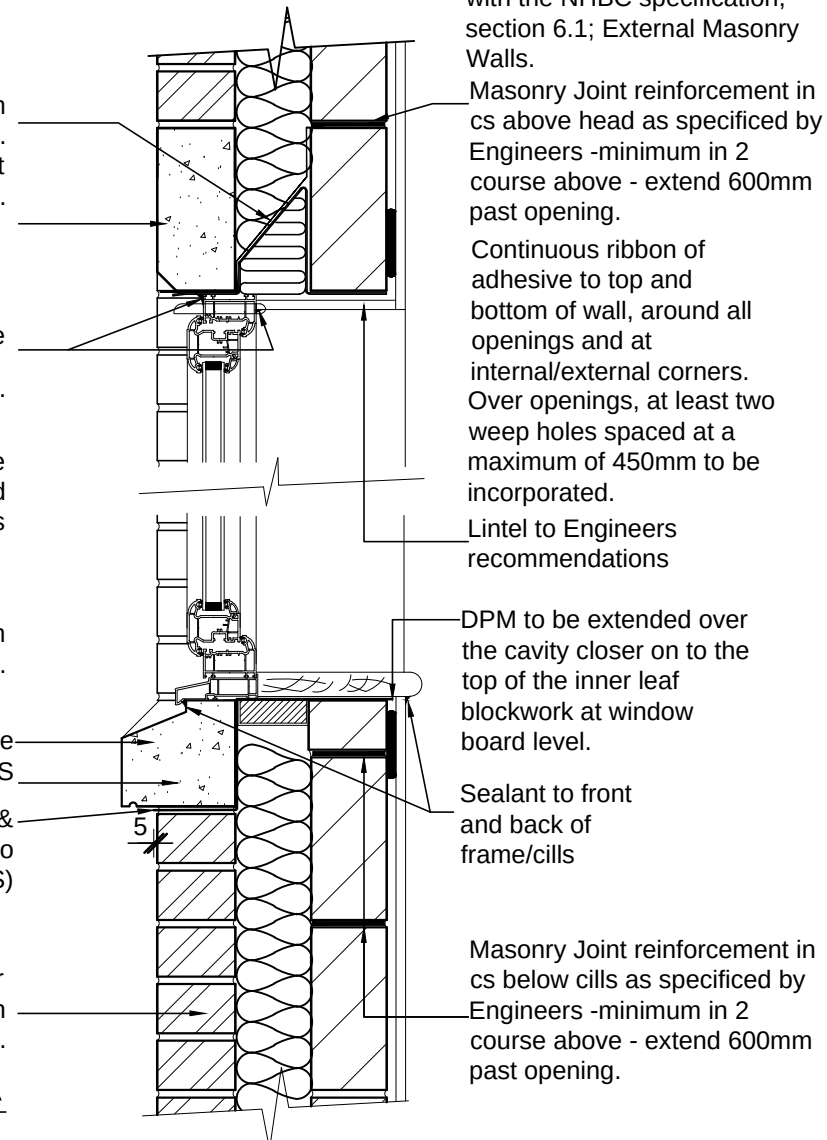

Notes

All dimensions to be checked on site prior to the commencement of construction and any discrepancy should be reported to the Site Manager.

This drawing may not be reproduced in any part or form without written consent.

All copyrights reserved.

Sub-Contractors MUST ensure that they have the latest issue drawing before they commence work on site.

B	March 2017	partial insulation removed	BB
		Stonework note added	
A	Sept 2015	Insulation Updated	HR
Rev	Date	Description	Init.



Job title

Standard Details

Drawing title

Stone Cill & Head Detail

Scale	Drawn
1:10/1:20 @ A3	SJR
Dwg No.	Date
SD/3001	Jul. 2014
	Rev.
	B