



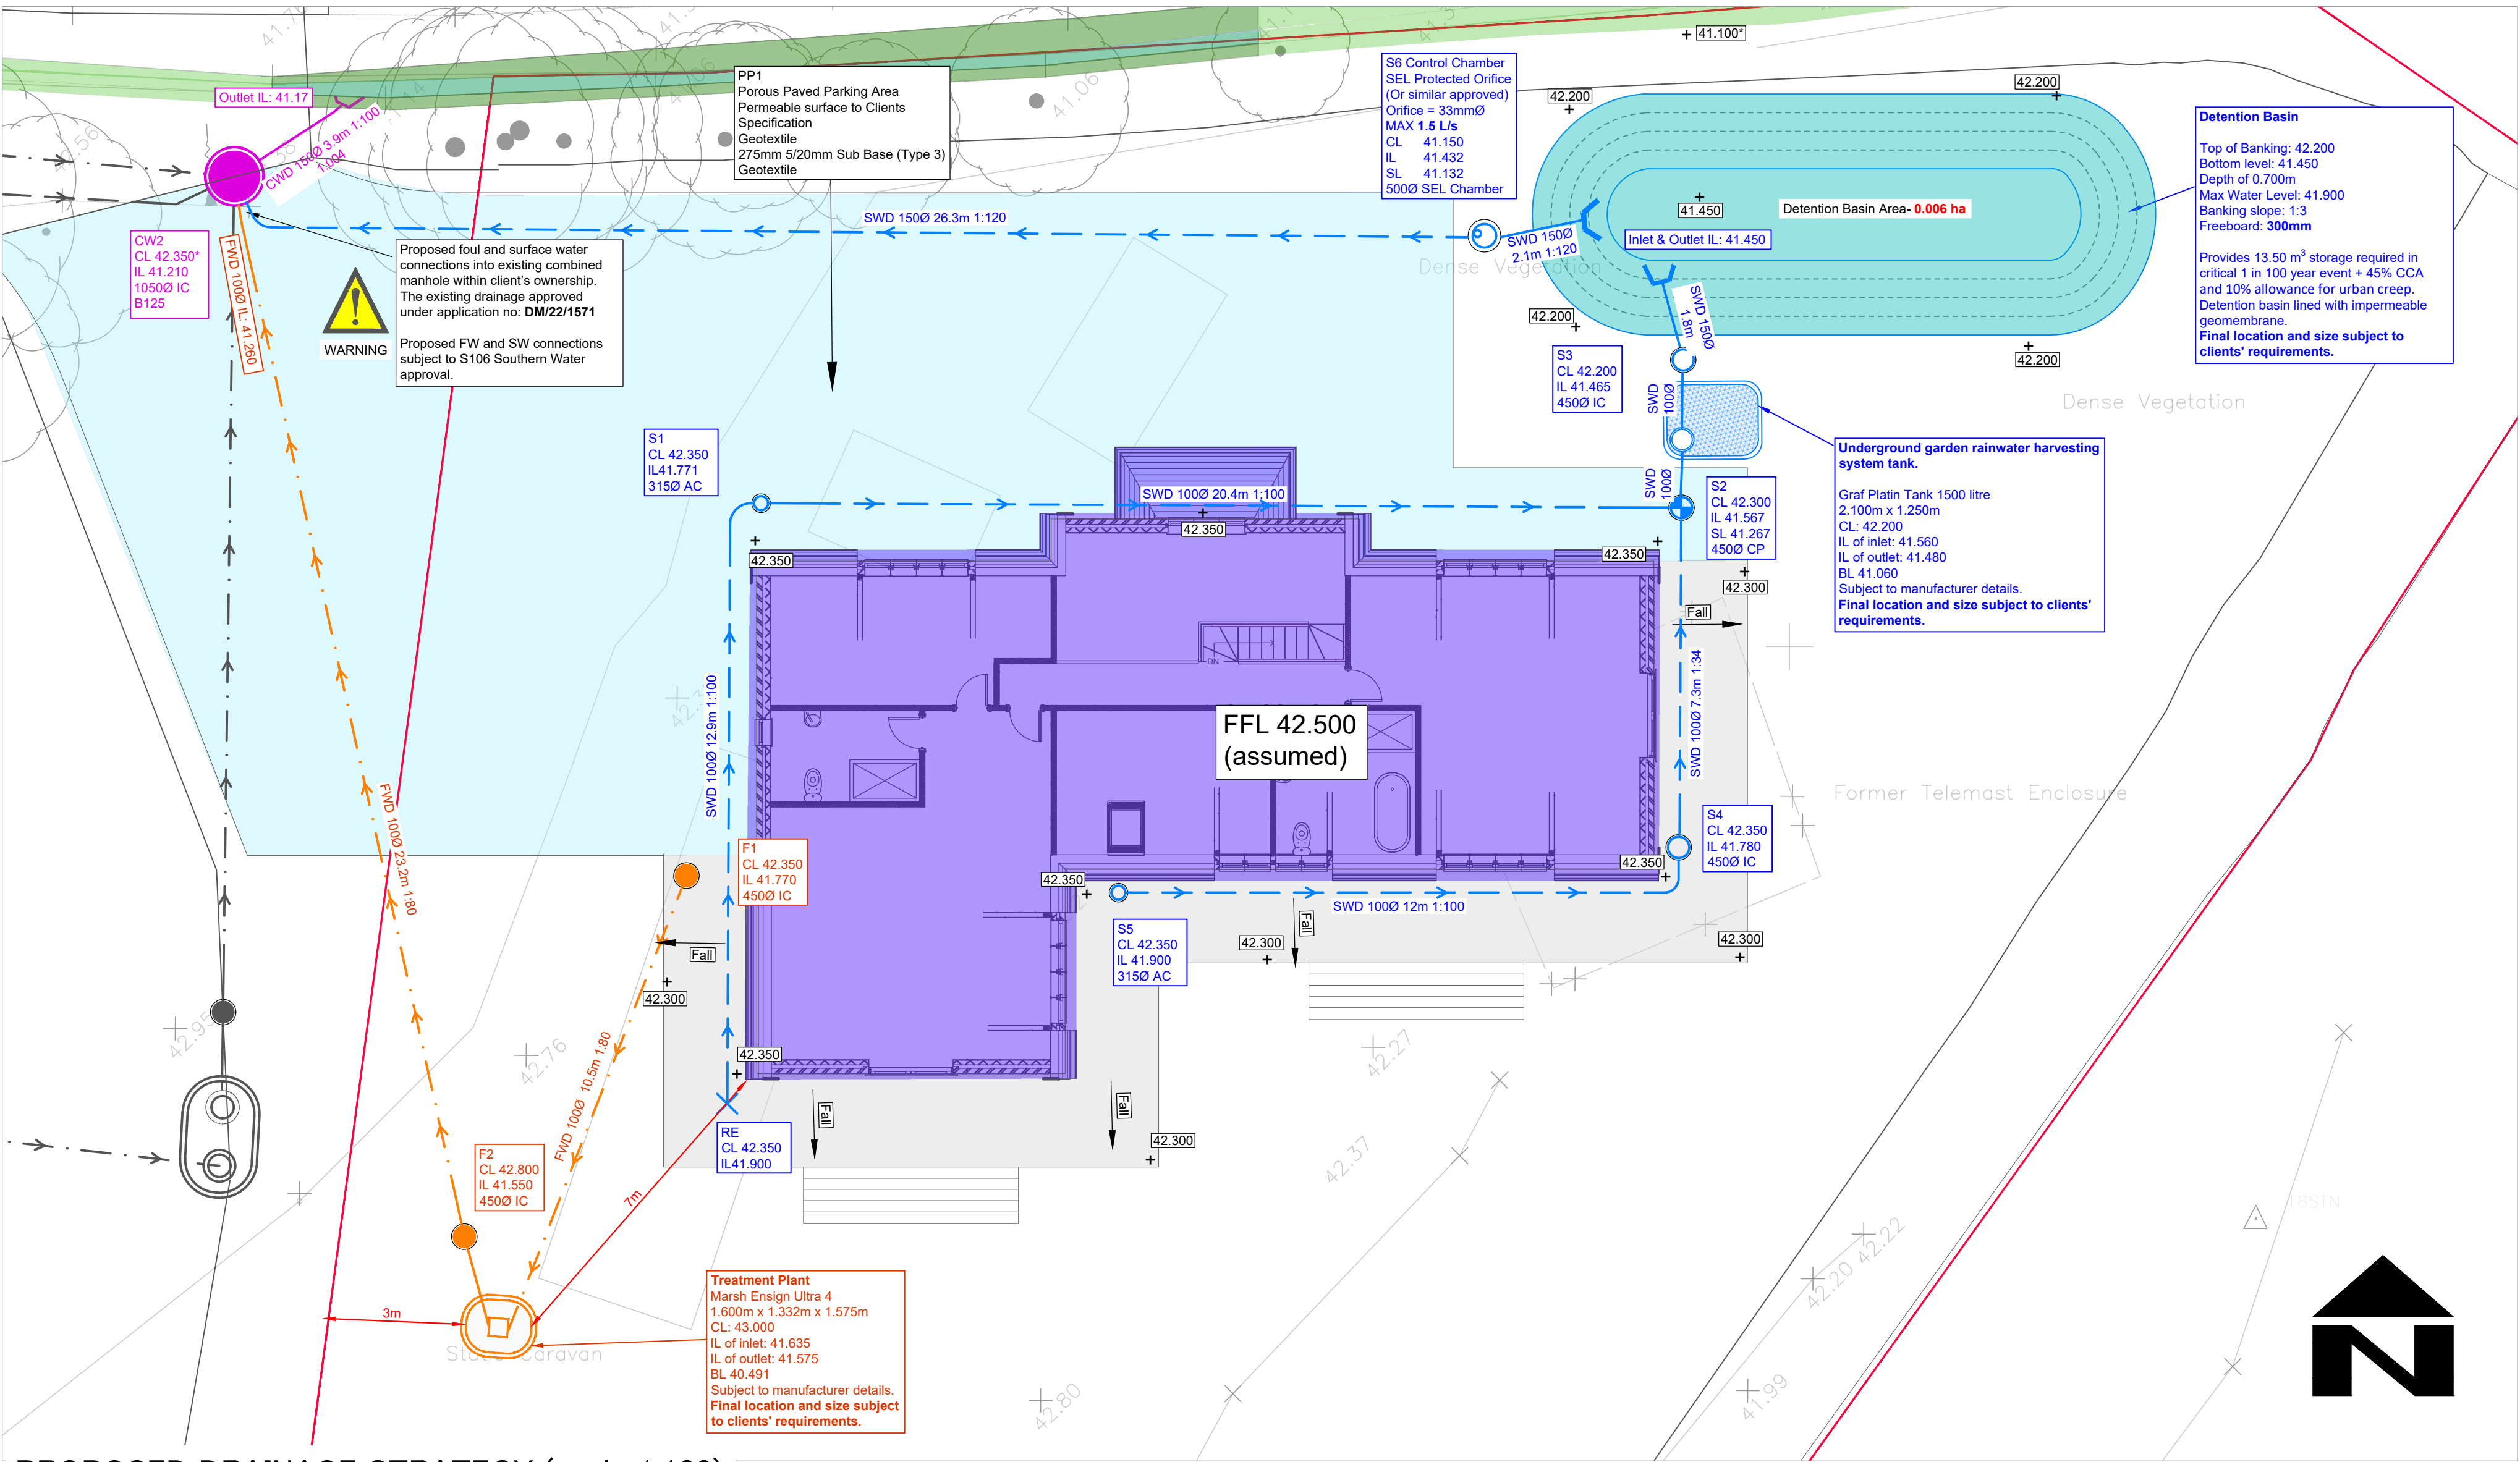


PROPOSED DRAINAGE STRATEGY (scale 1:100)

DRAINAGE LEGEND

EXISTING FEATURES

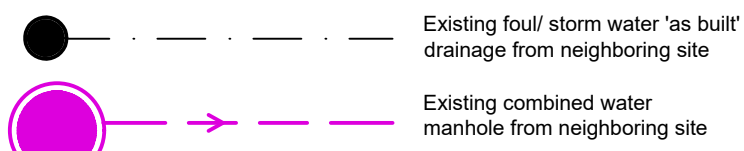

PROPOSED FEATURES

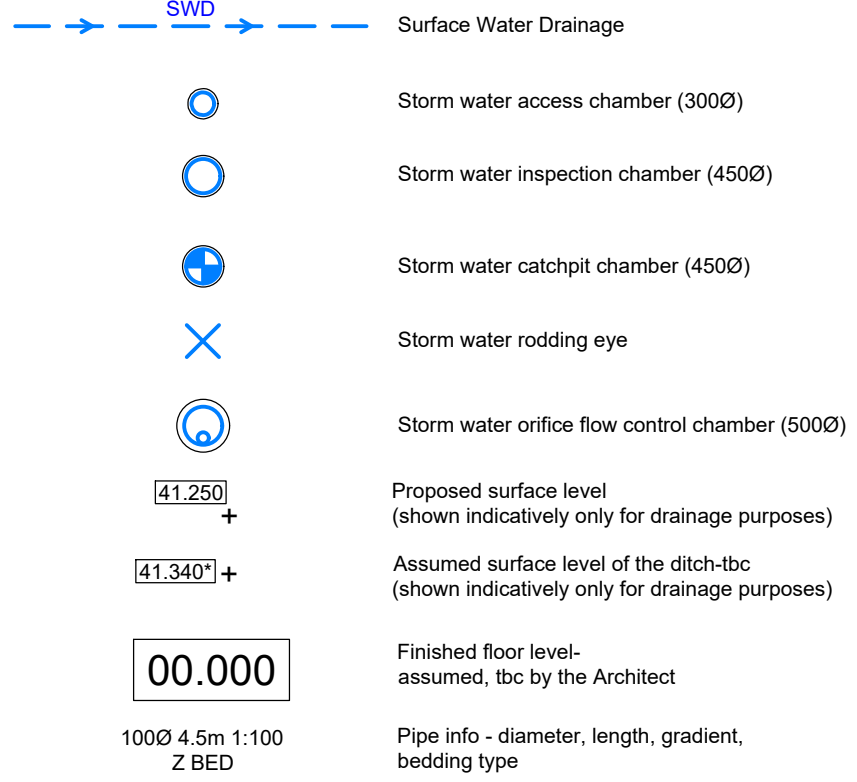

ABBREVIATIONS

- MH - MANHOLE
- IC - INSPECTION CHAMBER
- AC - ACCESS CHAMBER
- CP - CATCHPIT
- BC - BRAKE CHAMBER
- RE - RODDING EYE
- IL - INVERT LEVEL
- SL - SUMP LEVEL
- RA - RESTRICTED ACCESS COVER
- CL - COVER LEVEL
- TL - TOP OF CELLULAR SA
- BL - BASE OF CELLULAR SA
- FL - FORMATION LEVEL

Site Boundary
(as taken from M.J. Humphrey Ltd
Site Plan February 2025 draw no:
2025/20)

Proposed roof area 0.018 ha

Proposed detention basin 0.006 ha

Extent of permeable paving with porous sub-base

Proposed Footpath

STANDARD DRAINAGE NOTES

- DO NOT SCALE FROM THIS DRAWING. REFER TO FIGURED DIMENSIONS ONLY. THE CONTRACTOR SHOULD CHECK ALL DIMENSIONS ON SITE.
- ALL DIMENSIONS IN MILLIMETRES AND ALL LEVELS ARE IN METERS UNLESS NOTED OTHERWISE.
- THIS DRAWING SHOULD BE READ IN CONJUNCTION WITH ALL OTHER RELEVANT ARCHITECT AND ENGINEERING DETAILS, DRAWINGS AND SPECIFICATIONS.
- ANY DISCREPANCIES SHOULD BE REPORTED TO THE ARCHITECT AND/OR ENGINEER IMMEDIATELY, SO THAT CLARIFICATION CAN BE SOUGHT PRIOR TO THE COMMENCEMENT OF WORK.
- BEFORE COMMENCING CONSTRUCTION THE CONTRACTOR MUST CHECK THE INVERT LEVELS OF EXISTING SEWERS TO WHICH CONNECTIONS ARE MADE. IN ADDITION THE CONTRACTOR MUST LOCATE AND DETERMINE INVERT LEVELS OF THE EXISTING SEWERS TO WHICH CONNECTIONS ARE PROPOSED. ANY DISCREPANCIES ARE TO BE NOTIFIED TO THE ENGINEER IMMEDIATELY, PRIOR TO CONSTRUCTION.
- ALL DRAINAGE WORKS SHOULD COMMENCE AT THE PROPOSED DOWNSTREAM CONNECTION POINT. THE WORKS CONTINUING UPSTREAM FOLLOWING CONFIRMATION OF THE TIE-IN INVERT LEVELS TO THE ENGINEER. CONNECTIONS TO MANHOLES OR LARGER SIZED PIPES ETC. SHOULD BE SOFFIT TO SOFFIT UNLESS OTHERWISE INSTRUCTED BY THE ENGINEER, IF THIS IS NOT POSSIBLE INFORM THE ENGINEER IMMEDIATELY.
- COVER LEVELS SHOWN ARE APPROXIMATE. COVERS AND FRAMES SHALL BE SET TO FINISHED GROUND LEVELS AND FALLS.
- ALL UN-REFERENCED PIPES ARE TO BE 100mm DIA.
- ALL PIPES TO BE ADOPTED, OR CONNECTING TO ADOPTED SEWERS, TO BE VITRIFIED CLAY TO BS EN 295 AND BS95 (SWS ONLY), OR CONCRETE PIPES TO BE EN 1916 AND BS5911-PART 1.
- ROAD GULLY OUTLET PIPES ARE TO BE 150mm DIA. WITH CONCRETE SURROUND AND FLEXIBLE JOINTS. ALL GULLIES SHALL BE FITTED WITH GRADE D400 GRATINGS AND FRAMES TO BS EN124, UNLESS OTHERWISE STATED.
- ALL ADOPTABLE SEWERS SHALL BE CONSTRUCTED TO THE STANDARDS AND SPECIFICATION LAID DOWN IN 'SEWERS FOR ADOPTION' 6th EDITION, WITH A VIEW TO ADOPTION UPON COMPLETION OF WORKS.
- ALL PRIVATE DRAINAGE TO BE IN ACCORDANCE WITH THE BUILDING REGULATIONS APPROVED DOCUMENT PART-H, AND TO THE SATISFACTION OF THE BUILDING CONTROL INSPECTOR.
- THE CONTRACTOR IS TO KEEP A RECORD OF ANY VARIATIONS MADE ON SITE, INCLUDING THE RELOCATION OF SEWERS OR DRAINS, SO THAT AN AS CONSTRUCTED DRAWING CAN BE PREPARED UPON COMPLETION OF THE PROJECT.
- STUB CONNECTIONS TO ADOPTABLE MANHOLES SHALL BE MADE FROM VITRIFIED CLAY AND CONSIST OF TWO ROCKER PIPES LAID AT THE SAME GRADIENT AS THE UP OR DOWNSTREAM PIPE.
- IF ANY SUB SOIL DRAINAGE SYSTEMS ARE UNCOVERED DURING THE WORKS CONTACT THE ENGINEER FOR INSTRUCTIONS. SUB SOIL DRAINS ARE TO BE DIVERTED AROUND NEW WORKS AND CONNECTED INTO THE SURFACE WATER.
- NO PRIVATE AREAS ARE TO DRAIN ONTO ADOPTABLE AREAS AND VICE VERSA.
- ALL EXISTING MANHOLE COVER'S, GULLIES, ETC. ARE TO BE RAISED/LOWERED TO SUIT NEW LEVELS.
- IT IS THE RESPONSIBILITY OF THE CONTRACTOR TO CONFIRM THE LOCATION AND DEPTH OF ALL EXISTING SERVICES AND UTILITIES THAT MAY BE PRESENT
- UPON COMPLETION BUT PRIOR TO HANDOVER, CONTRACTOR TO CARRY OUT FULL CCTV SURVEY OF DRAINAGE SYSTEM WHICH IS TO BE REVIEWED BY ENGINEER TO ENSURE SATISFACTORY INSTALLATION
- PROPRIETARY PRODUCTS TO BE INSTALLED IN FULL ACCORDANCE WITH MANUFACTURER'S GUIDANCE.
- MANHOLE AND CHAMBER COVER GRADES:
 - 'A15' IN ALL LANDSCAPED AREAS AND ON FOOTPATHS
 - 'B125' IN ALL DRIVEWAYS
 - 'C250' IN PRIVATE PARKING AREAS
 - 'D400' IN CARRIAGEWAY/ACCESS ROAD

Site Specific Notes

- Proposed surface and foul water drainage strategy has been designed based on available data from the BGS Map Viewer and the existing drainage design approved under application reference: DM22/1571.
- Proposed detention basin storage volume and flow control are designed to the critical 1 in 100-year storm event, with a 45% allowance for climate change and a 10% allowance for urban creep.
- Surface water flow discharge rate from the new development area has been restricted to 1.5 l/s, reflecting the greenfield runoff rate for the site for the 1-in-1-year rainfall event.
- Proposed surface water runoff is to be collected and discharged into the existing combined sewer. The existing combined sewer approved under application reference: DM22/1571).
- Proposed foul and storm water connections is to be agreed under S106 application with Southern Water.

Prefixed to drawing numbers shall signify the following:-

PL = PLANNING	Shall not be used for contract or construction purposes
P = PRELIMINARY	Shall not be used for contract or construction purposes
T = TENDER	Shall not be used for construction purposes
C = CONSTRUCTION	These are the only drawings that shall be used for construction purposes
R = RECORD	Record of actual completed work

PL4	16.06.26	UPDATED TO LLFA COMMENTS	KCK	CS	CS
PL3	29.05.26	UPDATED TO LLFA COMMENTS	KCK	CS	CS
PL2	02.02.26	UPDATED TO LLFA COMMENTS	KCK	CS	CS
PL1	10.12.25	UPDATED TO NEW SITE PLAN	KCK	CS	CS
P	24.10.25	PRELIMINARY ISSUE	MR	CS	CS
REV	DATE	DESCRIPTION	BY	CHK	APP




CLIENT	HEATHLAND HURSTPIERPOINT LTD				
ARCHITECT	M.J. HUMPHREY LTD				
JOB TITLE	LAND ADJACENT TO THE MEADOW LITTLE PARK LANE , HURSTPIERPOINT				
DRAWING TITLE	PROPOSED DRAINAGE STRATEGY & EXCEEDANCE FLOW ROUTES				
DRAWN	MR	ENGINEER	CS	CHECKED	CS
DATE	OCTOBER 2025	SCALE @ A1	AS SHOWN		
JOB No.	C1900A	STATUS	PL	DRAWING No.	101
REV.					PL4

FOR PLANNING ONLY

DESIGN SUBJECT TO THE APPROVAL OF:
PLANNING AUTHORITY
BUILDING CONTROL
WATER AUTHORITY

DESIGN SUBJECT TO THE CONFIRMATION OF:
EXTERNAL LEVELS DESIGN
GROUNDWATER DEPTH
ORDINARY WATERCOURSE APPROVAL
LOCATION AND DEPTH OF EXISTING UTILITIES
ROOT PROTECTION AREAS

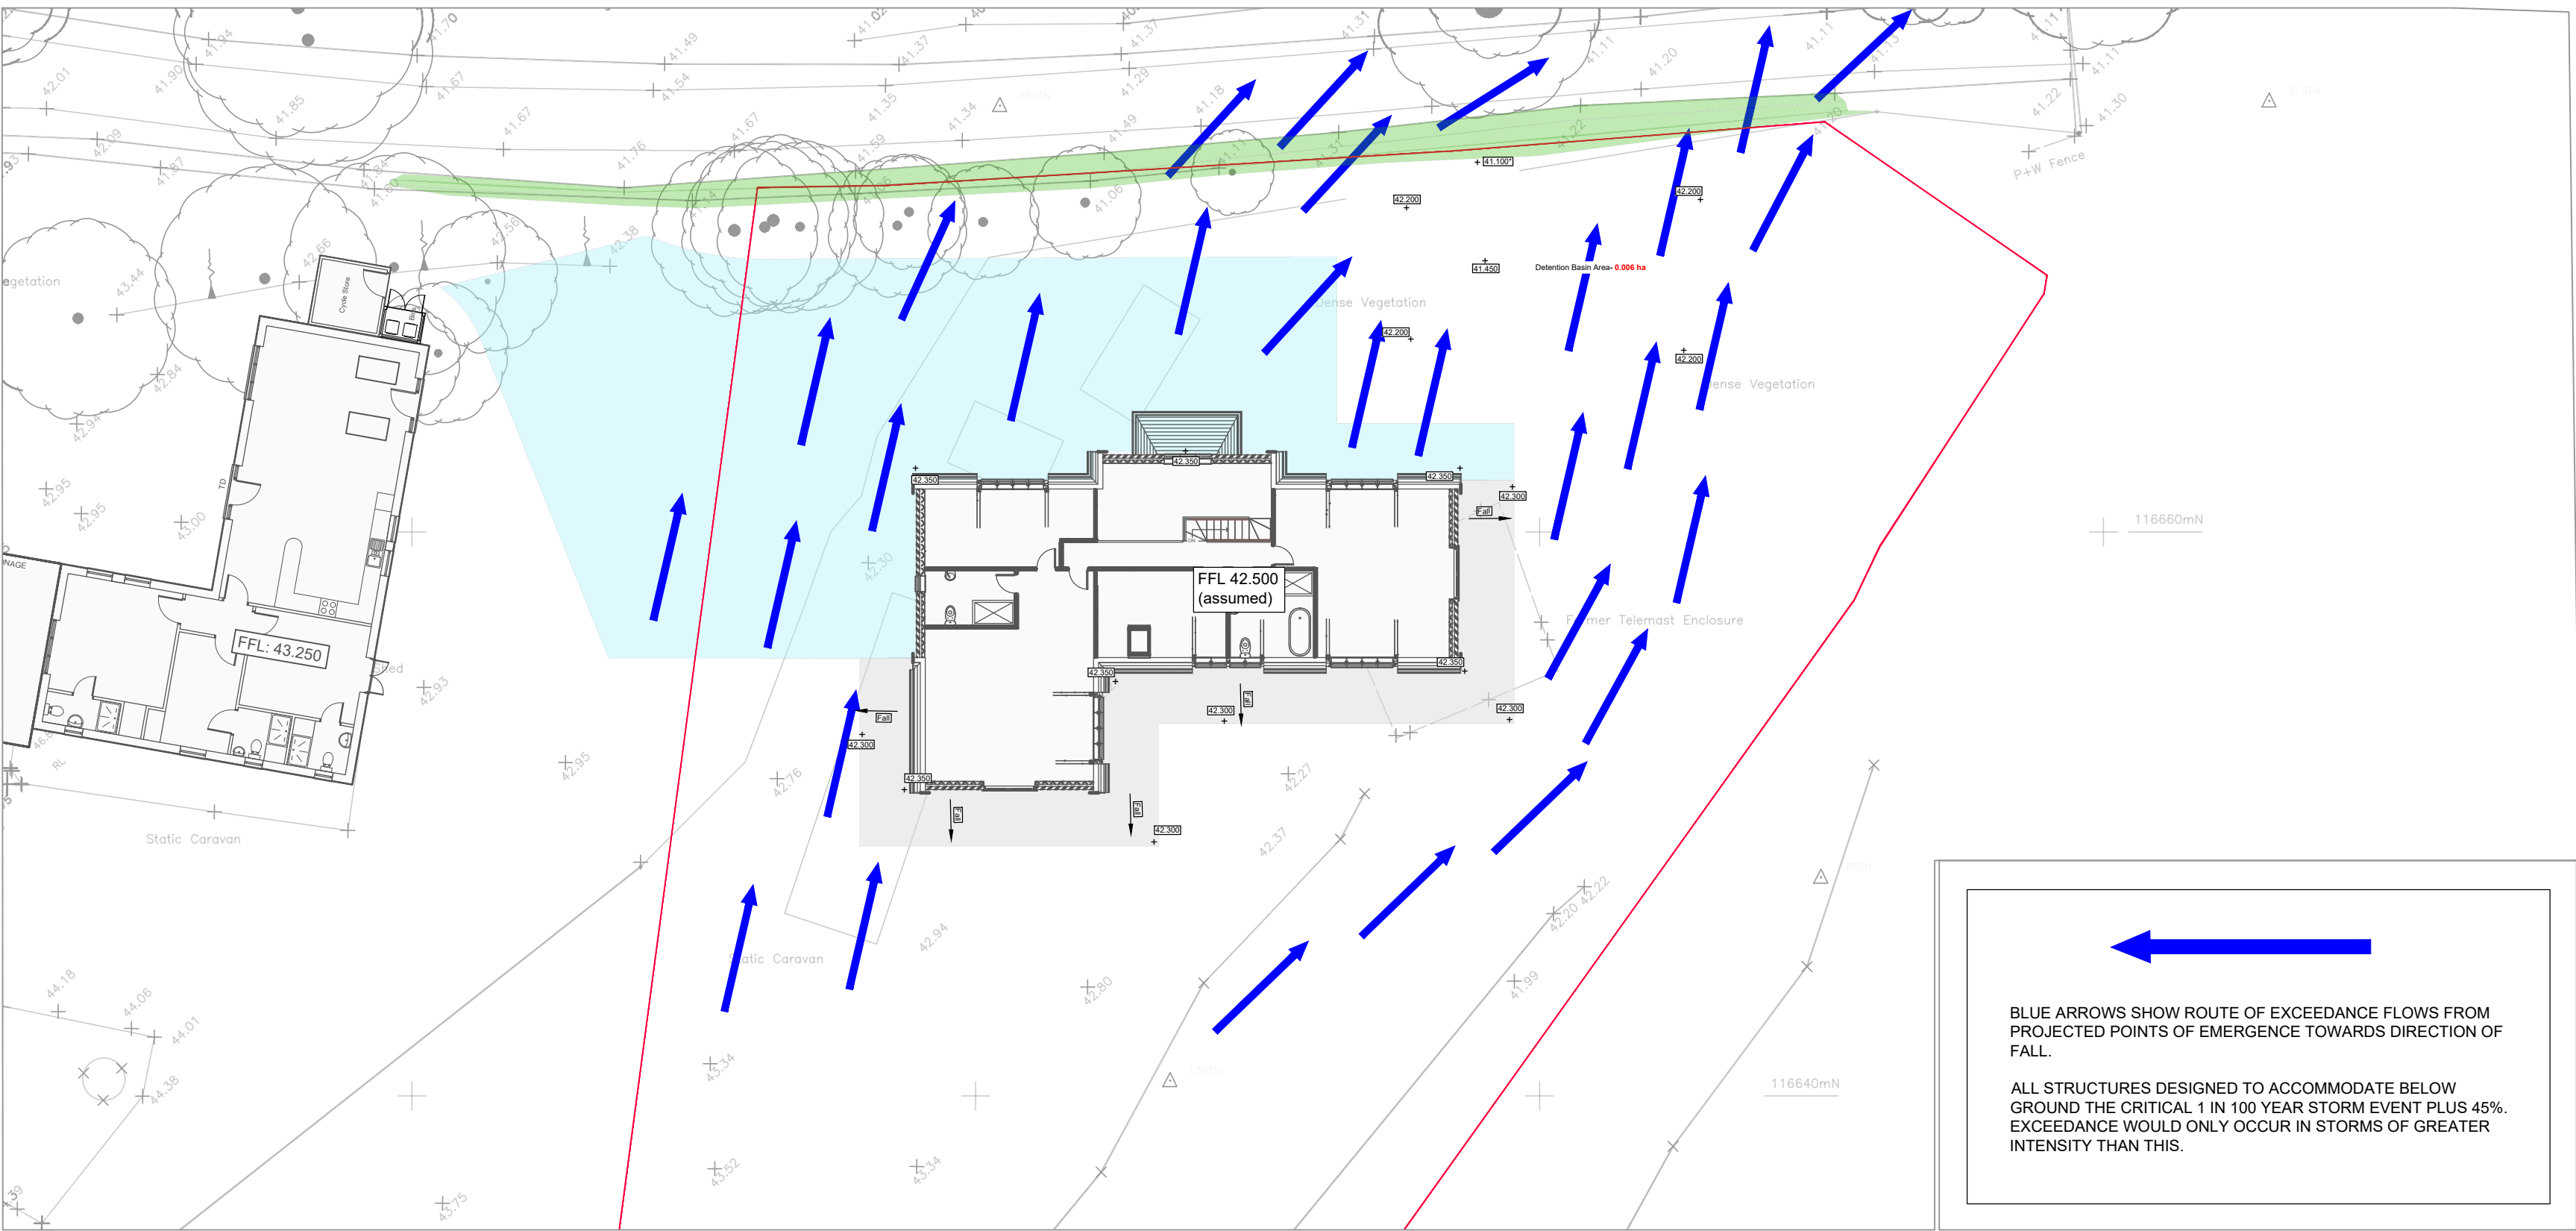

EXCEEDANCE FLOW ROUTES (scale 1:200)

BLUE ARROWS SHOW ROUTE OF EXCEEDANCE FLOWS FROM PROJECTED POINTS OF EMERGENCE TOWARDS DIRECTION OF FALL.

ALL STRUCTURES DESIGNED TO ACCOMMODATE BELOW GROUND THE CRITICAL 1 IN 100 YEAR STORM EVENT PLUS 45% EXCEEDANCE WOULD ONLY OCCUR IN STORMS OF GREATER INTENSITY THAN THIS.