




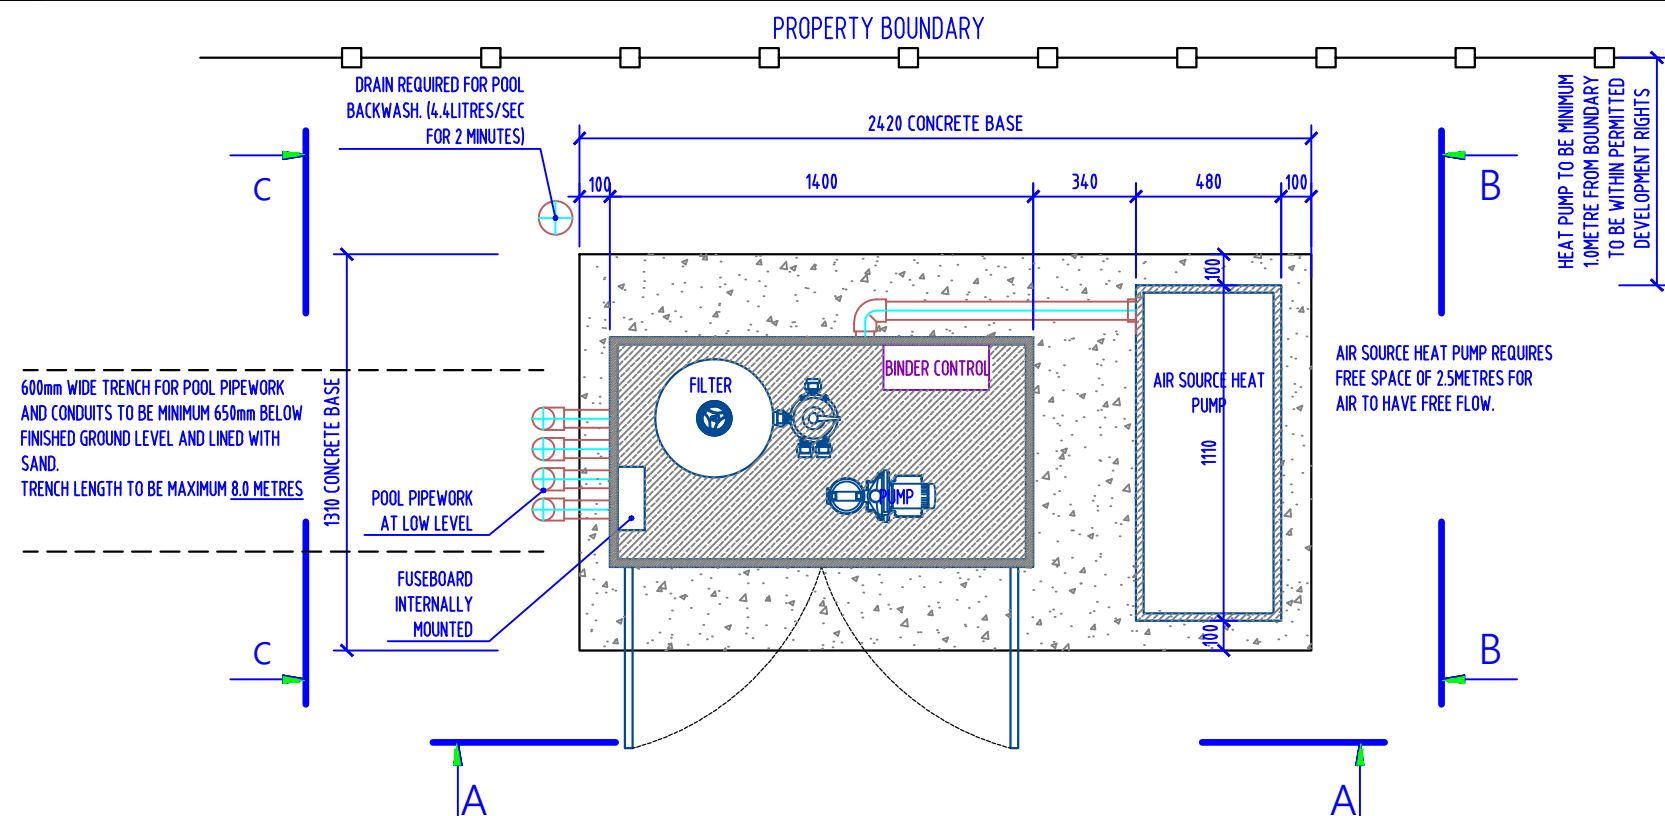


Plant Pod Plan
Scale 1-25

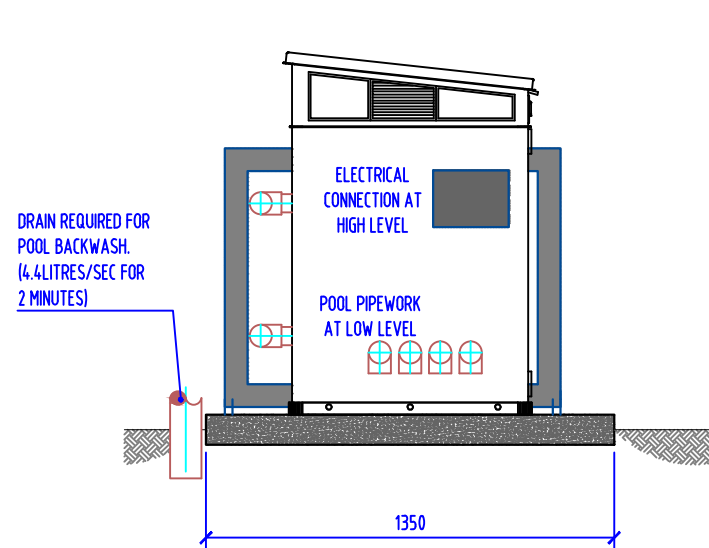

Plant Pod Elevation C-C
Scale 1-25

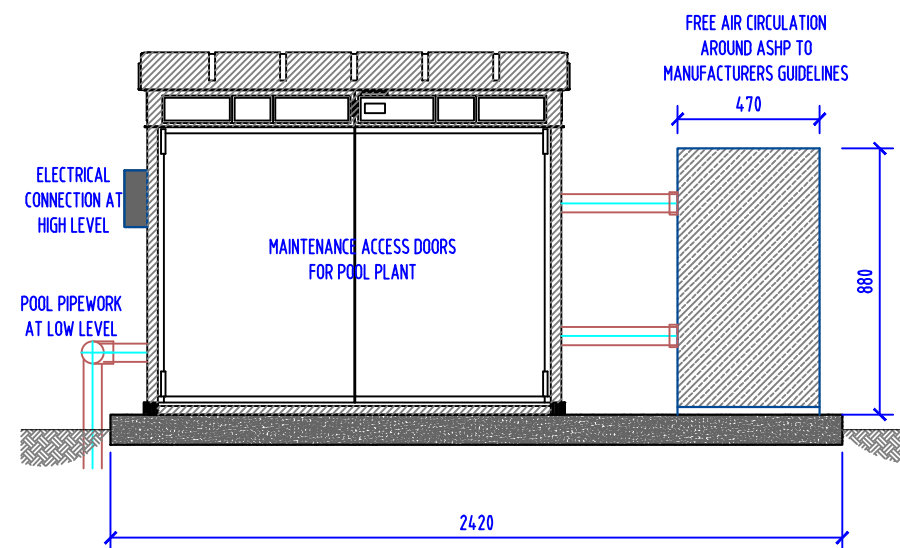

Plant Pod Elevation A-A
Scale 1-25

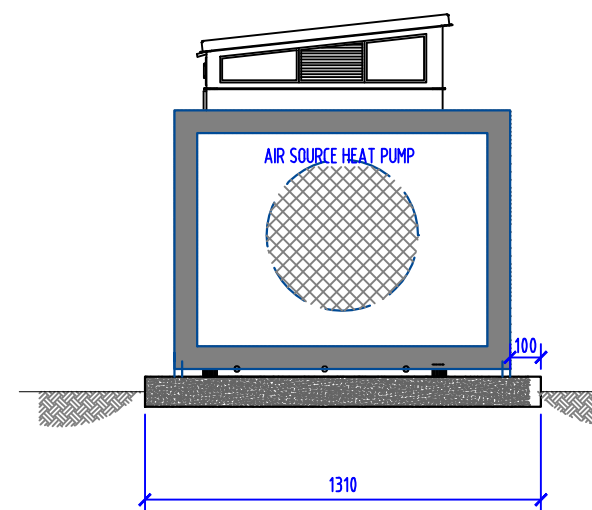

Plant Pod Elevation B-B
Scale 1-25

NOTES:
DO NOT SCALE THIS DRAWING.
ANY DISCREPANCIES TO BE CHECK ON SITE.

POOL FILTRATION SYSTEM REQUIRES LOCAL DRAIN CAPABLE OF TAKING BACKWASH FLOW OF 4.4LITRES / SECOND FOR A PERIOD OF 2 MINUTES (APPROXIMATELY FORTNIGHTLY). IF PROPERTY IS ON PRIVATE SEWAGE SYSTEM, A HOLDING TANK SYSTEM IS REQUIRED.

PIPE AND CONDUIT TRENCH FROM POOL TO PLANT LOCATION TO BE NO LONGER THAN 8.0m

TRENCH TO BE MINIMUM 600mm WIDE AND 650mm BELOW FINISHED GROUND LEVEL. SAND LINED TO PROTECT PIPES.

ELECTRICAL SUPPLY TO PLANT ROOM TO BE 2 x 16amp CEEFORM FOR FILTRATION AND HEAT PUMP.



Project Name and Address	
EVi 8 Pool	
Plant Layout	

Project EVi 8	Sheet 03
Date AUGUST 2022	
Scale 1:25 @ A3	