


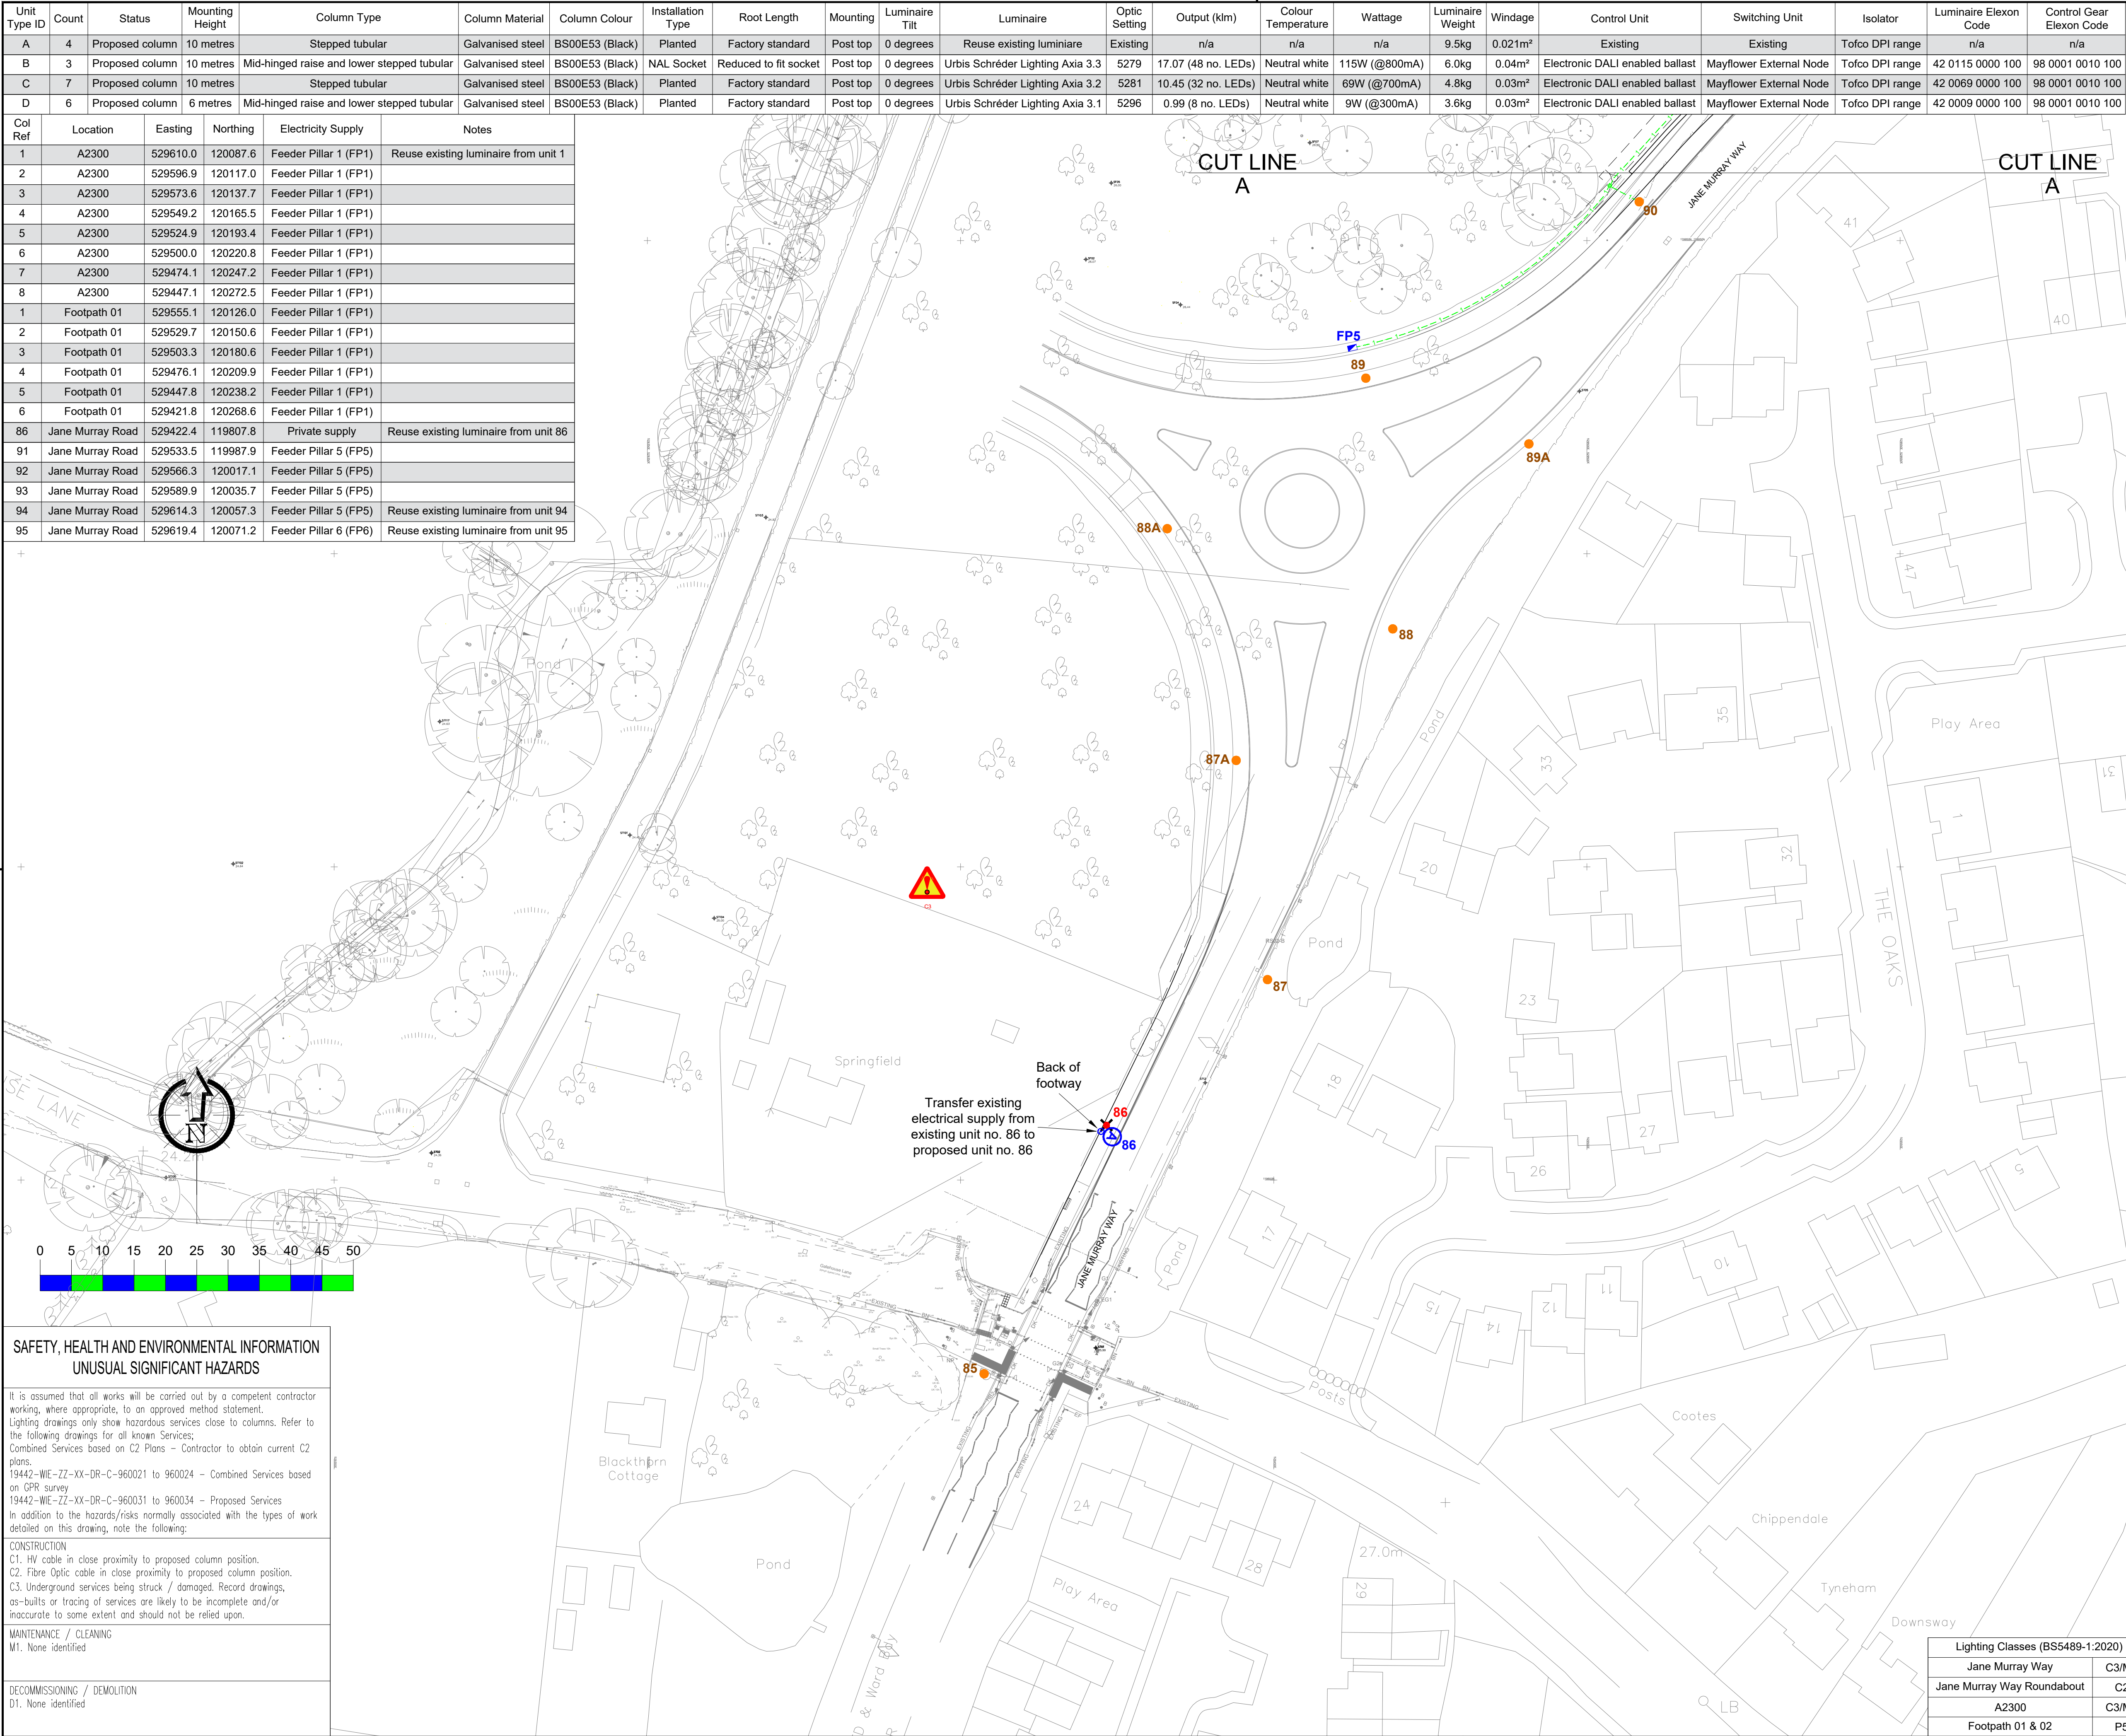

SAFETY, HEALTH AND ENVIRONMENTAL INFORMATION

UNUSUAL SIGNIFICANT HAZARDS

It is assumed that all works will be carried out by a competent contractor working, where appropriate, to an approved method statement.

Lighting drawings only show hazardous services close to columns. Refer to the following drawings for all known Services;

Combined Services based on C2 Plans – Contractor to obtain current C2 plans.

19442–WIE–ZZ–XX–DR–C–960021 to 960024 – Combined Services based on GPR survey

19442–WIE–ZZ–XX–DR–C–960031 to 960034 – Proposed Services

In addition to the hazards/risks normally associated with the types of work detailed on this drawing, note the following:

CONSTRUCTION

C1. HV cable in close proximity to proposed column position.
C2. Fibre Optic cable in close proximity to proposed column position.
C3. Underground services being struck / damaged. Record drawings, as-builts or tracing of services are likely to be incomplete and/or inaccurate to some extent and should not be relied upon.

MAINTENANCE / CLEANING

M1. None identified

DECOMMISSIONING / DEMOLITION

D1. None identified