


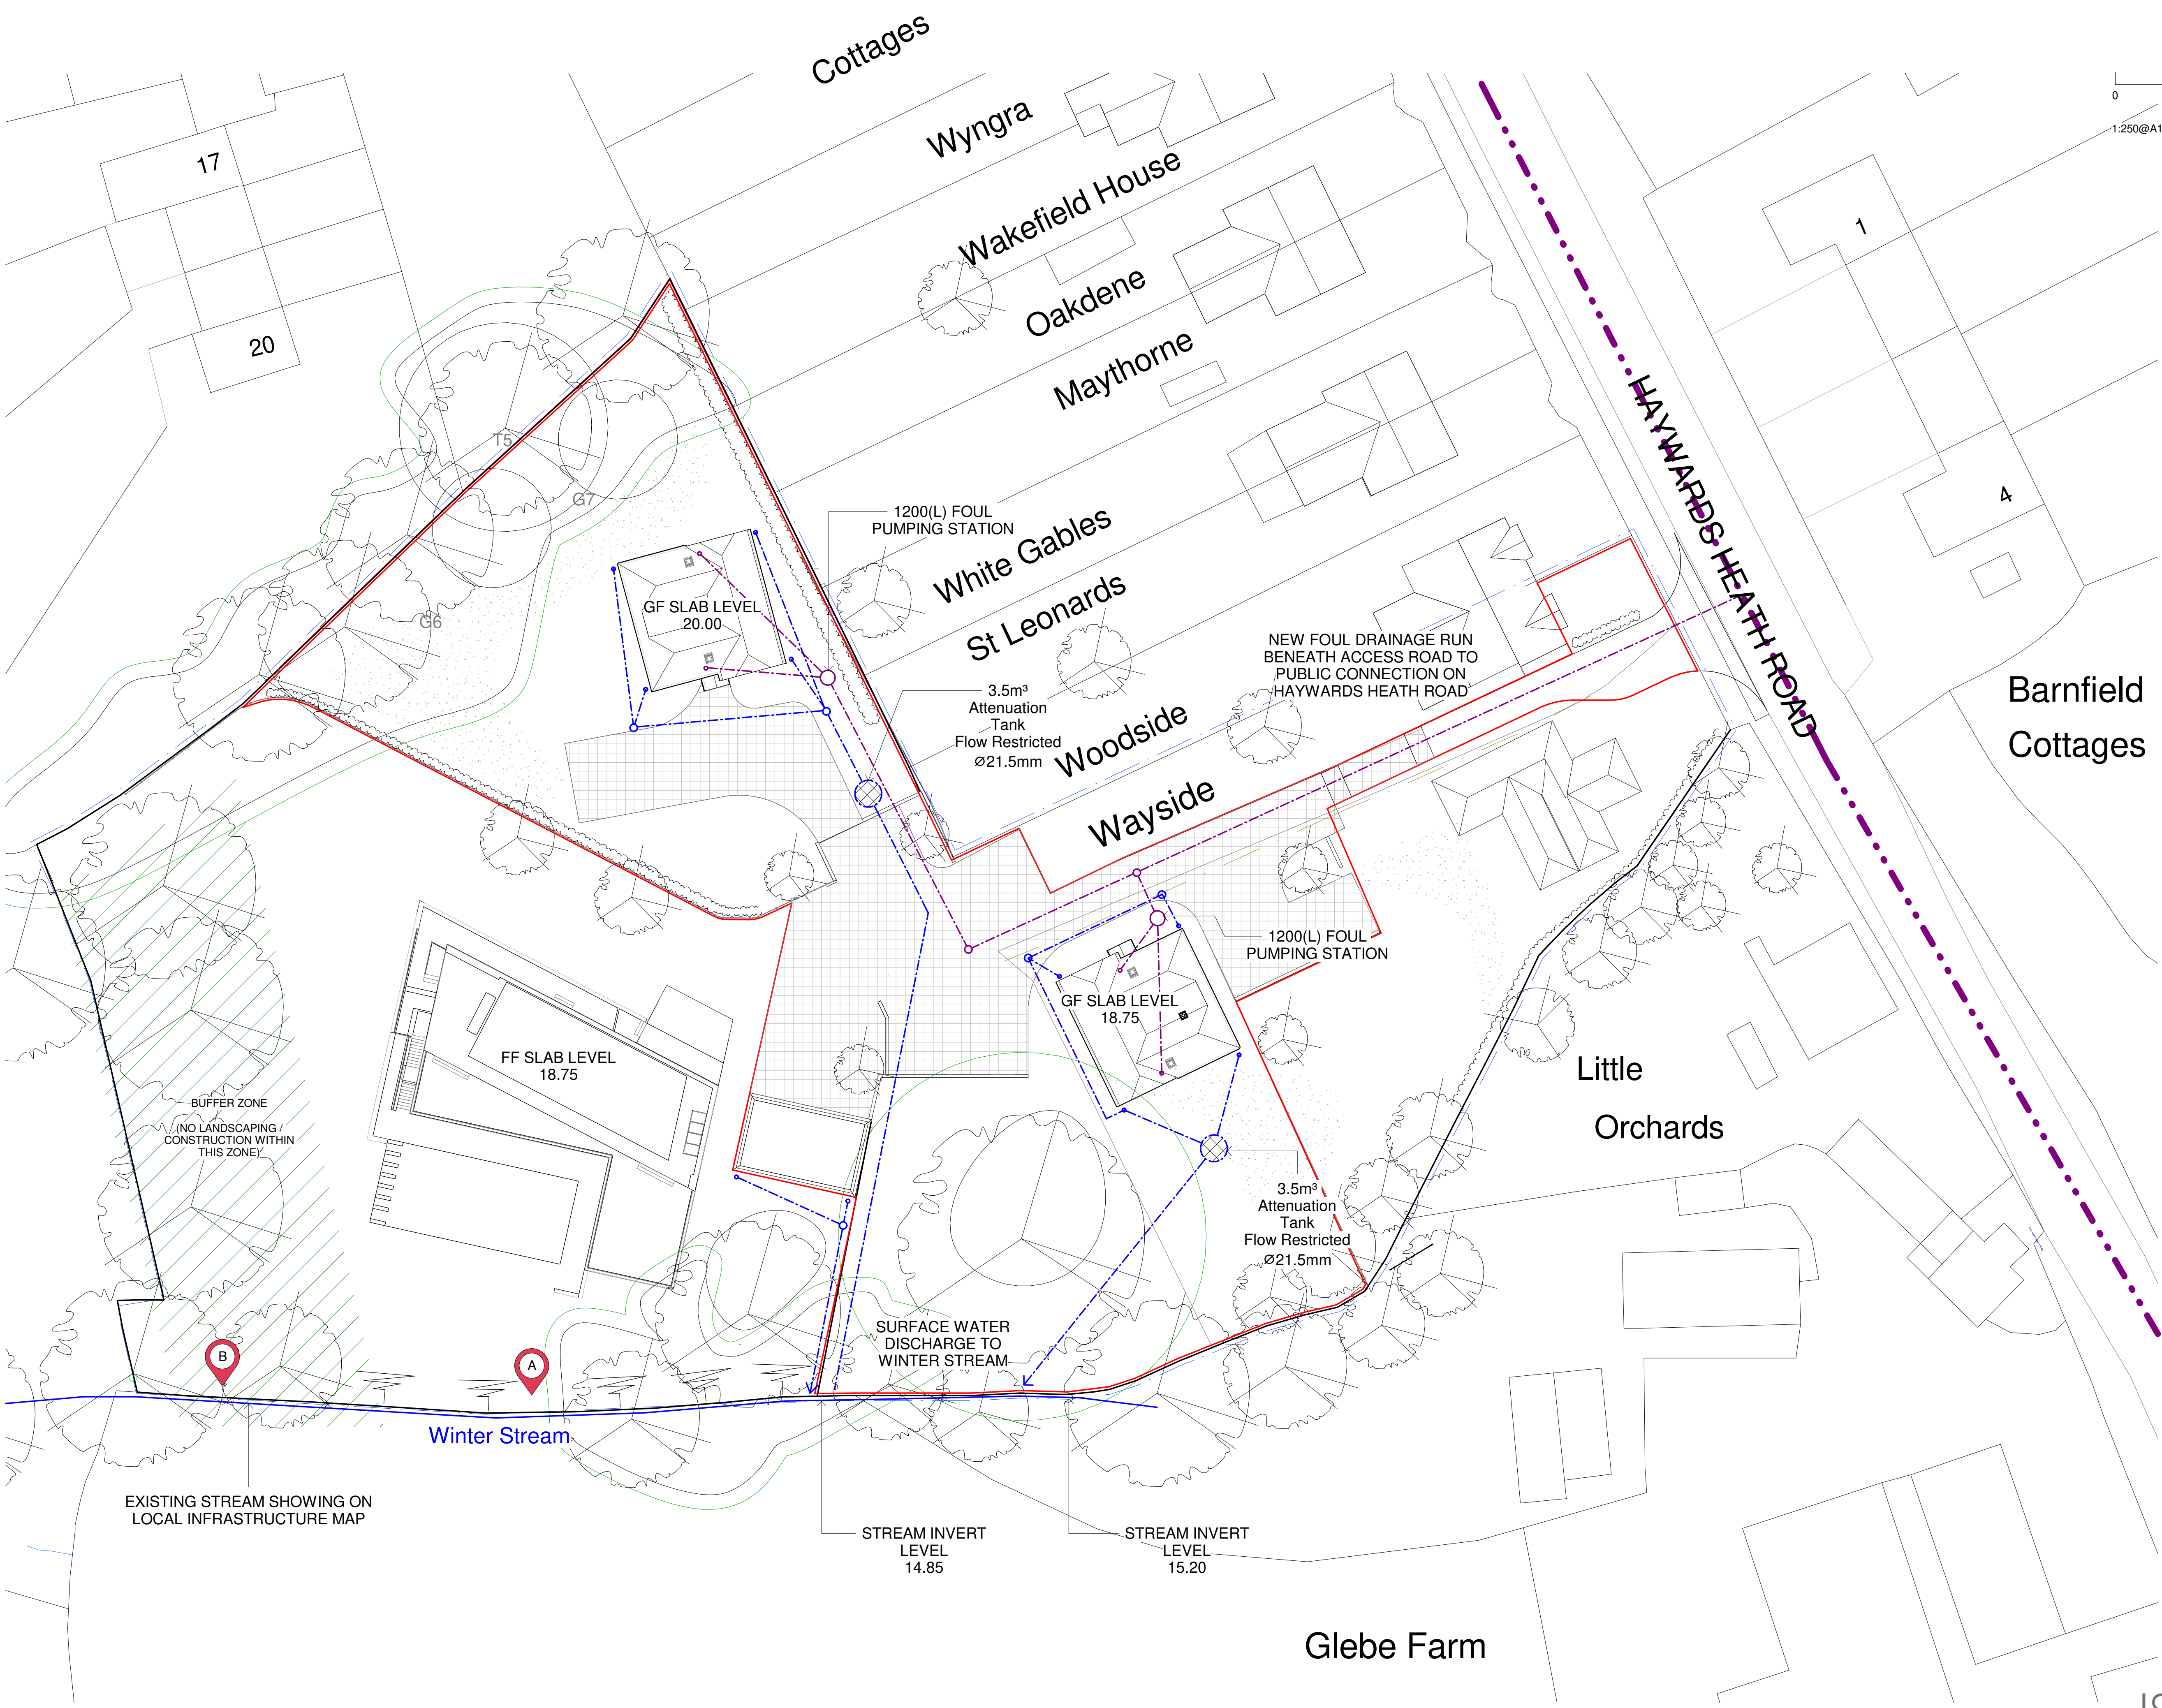

0 5 10 15 25 m

1:250@A1

PUBLIC FOUL SEWER

FOUL DRAINAGE

PUMPING STATION

SURFACE WATER

ATTENUATION TANK

WINTER STREAM


PERMEABLE DRIVE BUILD-UP:
50mm Bedding
---Geofabric---
250mm (+20mm Single Size Stone)
---Geofabric---
FORMATION

Camera Position

<var <varies> ies>	<varies>	GE	BH	
rev	description	date	dwn	chk
1	250 @ A1	drawn : GE	check : BH	issued : 30/06/2025
Client : Matsim				
Project : Wayside Development				
Drawing Name : Water Infrastructure				
Drawing N : 20024-PA-015				Rev : B

design

Do not scale from this drawing



architecture@lomag.design

Do not scale from this drawing