

notes:


light duty covers fmh1, swmh 2, and swmh 3 needs to be medium duty covers

fmh2 steel covers needs further assessment as it cant be opened

swmh1 steel cover handle is broken and cannot be opened

swmh 1 & 2 are assumed surface water

swmh 3 to 6 to be checked and confirmed if surface water

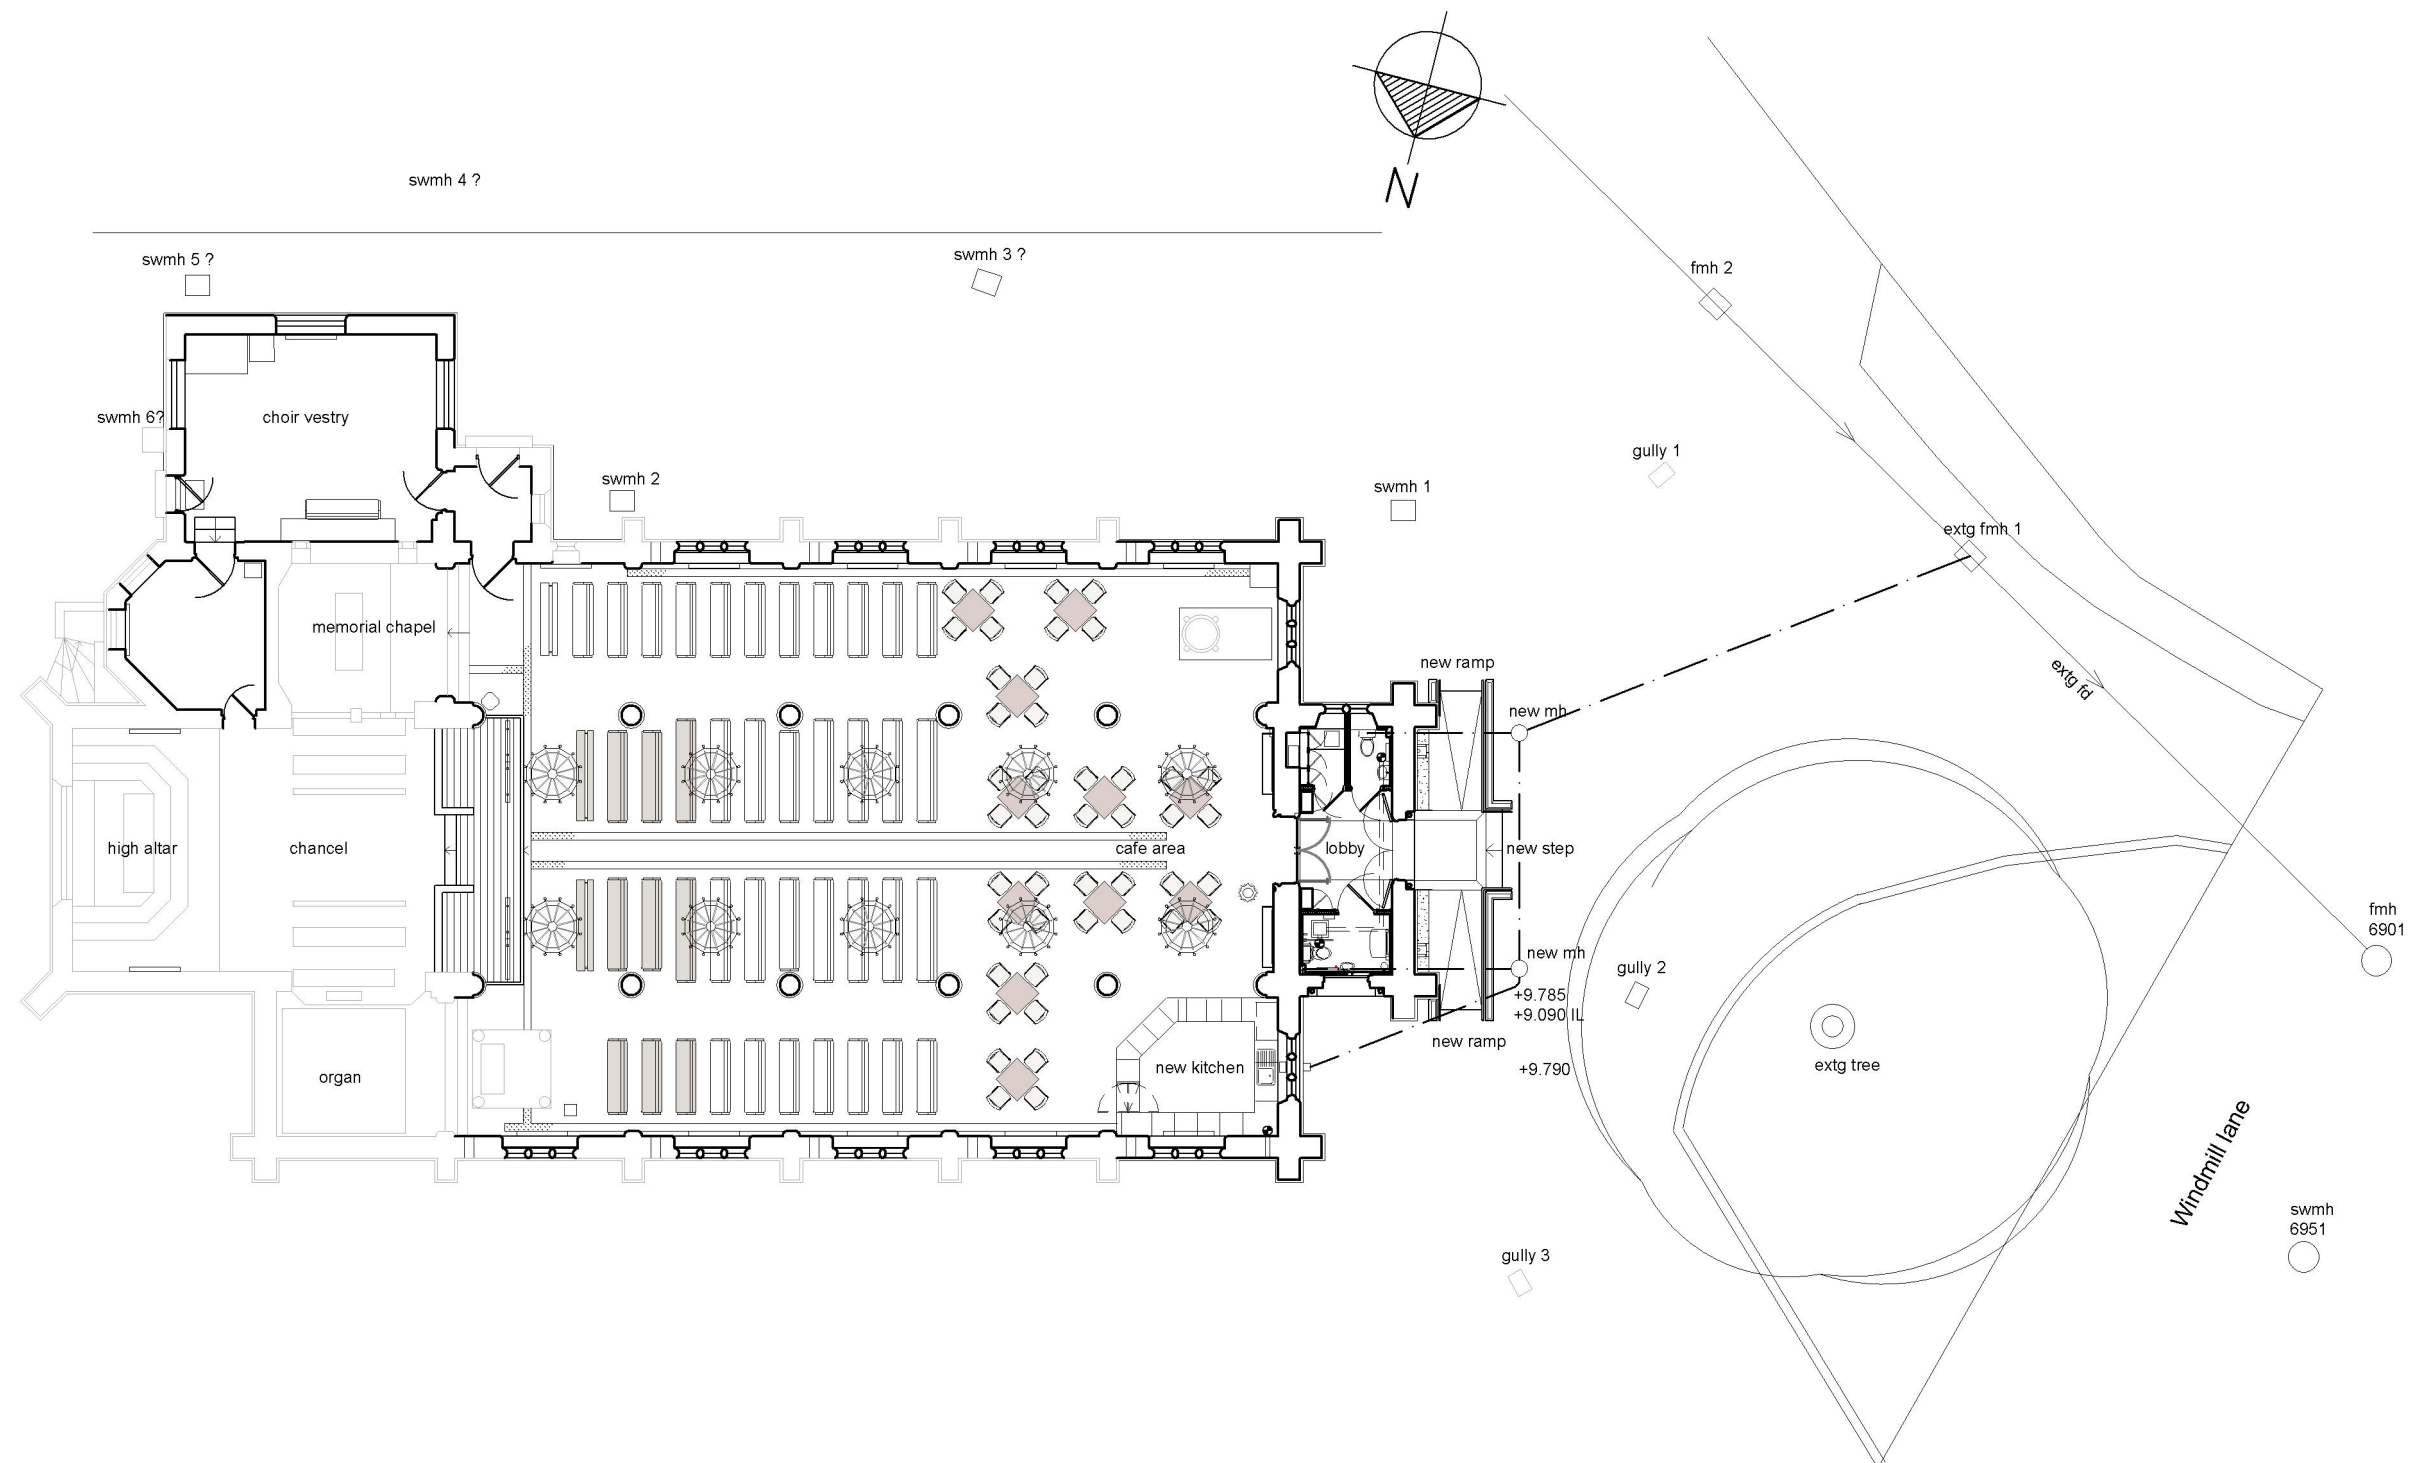

Part site plan/key plan 1:200

